SEE SHEET AI FOR DRAWING INDEX

IF PRINTED ON 11X17, ALL SCALE IS HALF.

CONTRACTOR TO VERIFY ALL DIMENSIONS
AND SETBACKS PRIOR TO CONSTRUCTION


WEYMOUTH, MA 02191

CELL: (181)-953-1142

EMAIL: DEEDEE3849COMCAST.NET

POMPEO-MALTBY RESIDENCE

126 WESSAGUSSETT ROAD WEYMOUTH, MA @2191

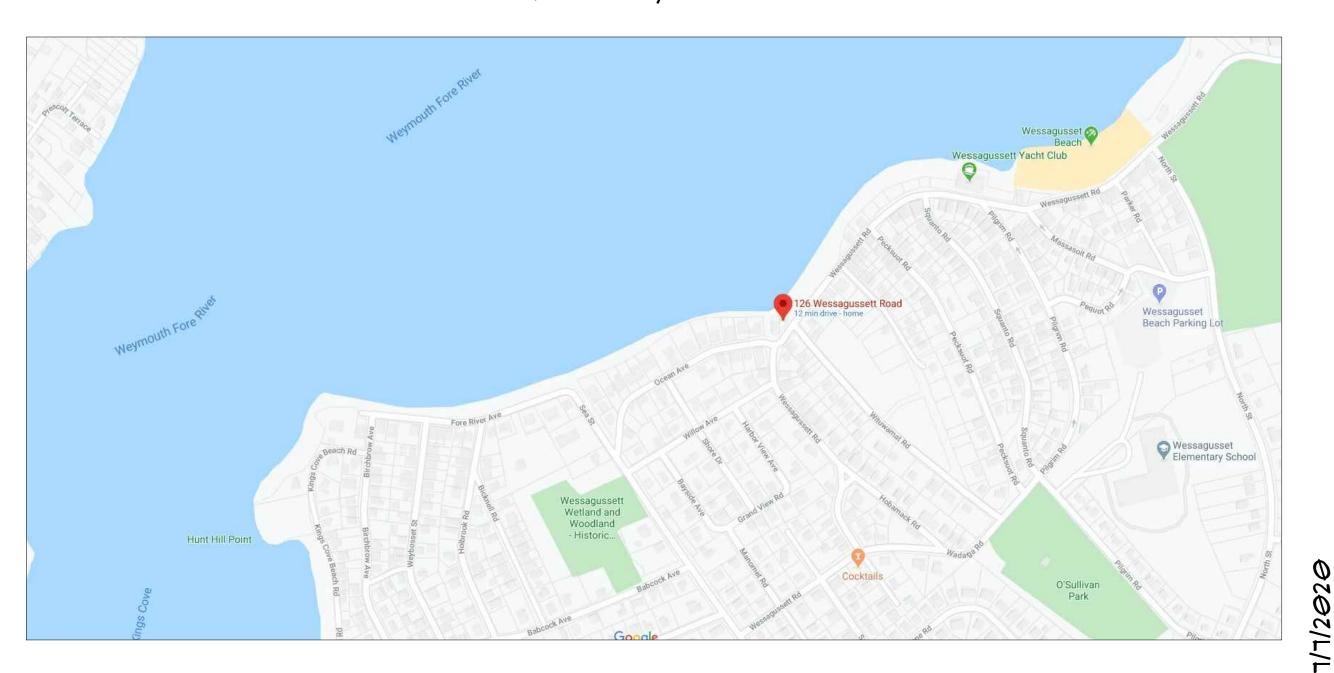

LOCUS MAP

DESIGNER:

OWNER:

BRUCE \$ DIANE POMPEO-MALTBY

126 WESSAGUSSETT ROAD

ROCKWOOD DE9IGN, INC.

1020 PLAIN STREET - 9UITE 320

MAR9HFIELD, MA 02050

PHONE: (181)-831-3140

FAX: (181)-831-3126

EMAIL: PHILAROCKWOODDE9IGN.COM

WEBSITE: WWW.ROCKWOODDE9IGN.COM

STRUCTURAL ENGINEER:

Pockwood

Rockwood

Bosign, Inc.

1020 Plain Street – Suite 320
Marshfield, MA 02050
Phone: (781)–837–3140
Fax: (781)–837–3126
Email: phil@rockwooddesign.com
Website: www.rockwooddesign.com

PROGRESS PRINT: NOT FOR CONSTRUCTION

PRODUCT OF SEA O

SEE SHEET AI FOR DRAWING INDEX

IF PRINTED ON 11X17, ALL SCALE IS HALF.

CONTRACTOR TO VERIFY ALL DIMENSIONS

AND SETBACKS PRIOR TO CONSTRUCTION

GENERAL NOTES:

- GENERAL CONTRACTOR TO CONFORM TO ALL LOCAL AND STATE BUILDING CODE REQUIREMENTS.
- GENERAL CONTRACTOR TO VERIFY ALL CONDITIONS AND DIMENSIONS SHOWN ON THE DRAWINGS AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES.
- 3. THE ENGINEER IS RESPONSIBLE ONLY FOR INFORMATION SHOWN ON THE CERTIFIED ENGINEER'S DRAWINGS. THE DESIGN AND LAYOUT OF ALL OTHER INFORMATION IS THE RESPONSIBILITY OF OTHERS AND MUST CONFORM TO THE MASSACHUSETTS BUILDING CODE REQUIREMENTS. REFER TO STRUCTURAL ENGINEERING BY OTHERS FOR CERTIFIED BEAM CALCULATIONS AND CERTIFIED WIND DESIGN DETAILS.
- 4. ALL HEATING, PIPING, INSULATION, ELECTRICAL, FIREPROOFING AND OTHER REQUIREMENTS ARE THE
- 5. NOTIFY THE ENGINEER OF ANY ARCHITECTURAL MODIFICATIONS OR DIMENSION CHANGES THAT MAY AFFECT THE STRUCTURAL DESIGN

STRUCTURAL STEEL NOTES:

 $\overline{\underline{Q}}$

RUCTI

 $\overline{\sigma}$

Ŭ

O OX

S

- ALL STEEL BEAMS SHALL BE NEW STEEL CONFORMING TO THE ALISIC, SPECIFICATIONS FOR DESIGN FABRICATION AND ERECTION OF STRUCTURAL STEEL FOR BUILDINGS AND A.S.IN. - GRADE 50. ALL CAP AND BASE PLATES AND OTHER MISCELLANEOUS STEEL MAY BE A.S.I.M. GRADE A36.
- ALL 9CHEDULE 40 PIPE 9HALL BE NEW STEEL CONFORMING TO THE A.I.9.C. 9PECIFICATIONS FOR DESIGN, FABRICATION AND ERECTION OF STRUCTURAL STEEL FOR BUILDINGS AND A.S.T.M. SPECIFICATION A53, TYPE "E" OR "S". GRADE "E". WITH A MINIMUM YIELD STRESS OF 35 K.S.I.
- ALL SHOP AND FIELD WELDS SHOWN SHALL BE MADE BY APPROVED CERTIFIED WELDERS AND SHALL CONFORM TO THE A.W.S. CODE FOR BUILDINGS. ALL WELDS SHALL DEVELOP THE FULL STRENGTH OF THE MATERIAL BBING WELDED. USE EXX 19 ELECTRODES.
- NO PERMANENT CONNECTIONS SHOULD BE MADE UP UNTIL THE STRUCTURE HAS BEEN PROPERLY ALIGNED PROVIDE TEMPORARY BRACING AS REQUIRED.
- 5. STEEL FABRICATOR 19 RESPONSIBLE FOR FINAL LENGTHS, CONNECTION DETAILS AND DESIGN IN ACCORDANCE WITH THE MINIMUM REQUIREMENTS OF THE LATEST EDITION OF THE A115.C. DETAILING MANUAL SUBMIT SHOP DRAWINGS WITH ALL DETAILS TO THE GENERAL CONTRACTOR PRIOR TO FABRICATION.
- 6. USE 1/2" MINIMUM CAP PLATE AND BASE PLATES (6X6 MINIMUM) FULLY WELDED ALL AROUND AT COLUMNS WITH 3/6" FILLET WELD, OR AS OTHERWISE SPECIFIED ON THE DRAWINGS. ALL STEEL COLUMN EXTERIOR BASE PLATE SHALL BE BOLTED TO THE CONCRETE FOUNDATIONS WITH 4-5/8" DIAMETER ANGHOR BOLTS.
- ALL STEEL SHALL HAVE TWO COATS OF RUST-INHIBITOR PRIMER PAINT. TOUCH UP ALL WELDS, SCRATCHES OR SCRAPES IN PAINT AFTER ERECTION.
- 9TEEL BEAM MAY BE 9PLICED AT 9TEEL COLUMN CAP PLATE WITH A MAXIMUM GAP BETWEEN BEAMS OF 1/4". USE 1/4" TIE PLATE WELDED TO WEBS.
- FRAME JOISTS TO TOP OF BEAM ON A 2X8 TOP NAILER THRU-BOLTED WITH I/2" DIAMETER BOLTS STAGGERED AT 24" O.C. JOISTS TO BE ANCHORED TO THE TOP NAILER WITH SIPMSON H4 HURRICANE CLIPS. FLUSH FRAME JOISTS TO THE FULL DEPTH WEB BLOCKING FASTENED TO THE BEAM WITH I/2" DIAMETER THRU-BOLTS AT 24" O.C. STAGGERED TOP AND BOTTOM.

FRAMING NOTES:

- 1. ALL FRAMING LUMBER SHALL BE HEM-FIR GRADE NO. 2 OR S.P.F. (SPRUCE-PINE-FIR) GRADE NO. 2 OR APPROVED EQUAL (UNLESS OTHERWISE SPECIFIED) AND SHALL MEET THE REQUIREMENTS OF THE AMERICAN FOREST AND PAPER ASSOCIATION. THE MINIMUM ALLOWABLE BENDING STRESS (FB) SHALL BE 1050 P.S. THE MINIMUM ALLOWABLE COMPRESSION STRESS (FC) SHALL BE 450 P.S. THE MINIMUM ALLOWABLE MODILUS OF ELASTICITY (E) SHALL BE 1,400,000 P.S. TOHER FRAMING ATTERIAL FOR INTERIOR NON-LOAD BEARING STUDS MAY DE SUBSTITUTED ONLY UPON APPROVAL OF THE ENGINEER.
- 2. ALL PRESSURE TREATED (CCA TREATED) DIMENSIONAL FRAMING LUMBER SHALL BE SOUTHERN YELLOW PINE GRADE NO. 2. THE MINMUM ALLOWABLE BENDING STRESS (FB) SHALL BE 1,050 P.S.I. THE MINIMUM ALLOWABLE COMPRESSION STRESS (FC) SHALL BE 565 P.S.I. THE MINIMUM ALLOWABLE MODULUS OF ELASTICITY (E) SHALL BE 1,600,000 P.S.I.
- 3. ALL LYLS TO BE MANUFACTURED BY TRUS JOIST, GEORGIA PACIFIC OR APPROVED EQUAL. THE MINMUM ALLOWABLE DENDING STRESS (FB.) SHALL BE 2,900 P.SI. THE MINMUM ALLOWABLE COMPRESSION STRESS (FC.) PERPENDICULAR TO THE GRAIN SHALL BE 150 P.SI. THE MINMUM ALLOWABLE MODILULS OF ELASTICITY (E) SHALL BE 2,000,000 P.SI. ALL PARALAMS EXPOSED TO THE WEATHER SHALL BE PRESSURE TREATED (CCA TREATED). INSTALL MICROLAMS AND PARALAMS IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS.
- 4. USE 3/4" TONGUE AND GROVE STRUCTURAL GRADE FIT PLYWOOD FLOOR SHEATHING, 5/8" EXTERIOR STRUCTURAL GRADE FIR (C.D.X.) PLYWOOD ROOF SHEATHING AND 1/2" EXTERIOR STRUCTURAL GRADE FIR (C.D.X.) AT WALLS. ALL JOINTS SHALL BE BLOCKED WITH LIMBER OR OTHER APPROVED SUPPORTS.
- 5. ALL EXTERIOR AND INTERIOR STUD WALLS TO BE 2X4 MINIMUM @ 16" O.C. UNLESS NOTED OTHERWISE.
- 6. PROVIDE ADEQUATE WALL RESISTANCE TO RAKING BY DIAGONAL CORNER WIND BRACING ANCHORED TO SILL
- 1. PROVIDE SOLID BLOCKING BETWEEN FLOOR JOISTS AND/OR DOUBLE ALL JOISTS UNDER EACH PARTITION.
- USE FULLY NAILED METAL CONNECTORS (TECO, SIMPSON OR EQUAL), JOIST OR BEAM HANGERS WHEN JOISTS OR BEAMS FRAME INTO OTHER JOISTS OR BEAMS. PROVIDE METAL POST CAPS AND BASES FOR ALL POSTS.
- 9. FOR NONBEARING ROUGH WINDOW OPENINGS AND INTERIOR DOOR OPENINGS UP TO 3 FEET, USE 2-2X6
 HEADER BEAMS. FROM 3 FEET TO 5 FEET, USE 2-2X8 HEADER BEAMS AND FROM 5 FEET TO 1 FEET, USE 2-2X10
 HEADER BEAMS AND USE LYLS FOR SPANS EXCEEDING 1 FEET, EXCEPT AS NOTED OTHERWISE ON THE
 PLANS OR SPECIFICATIONS, USE TRIPLES FOR 2X6 WALLS, IF LYLS ARE SPECIFIED ON THE PLANS,
 PROVIDE DOUBLE JACK STUD SUPPORTS OR AS OTHERWISE SPECIFIED ON THE PLAN.
- 10. ALL FRAMING TO BE INSTALLED IN ACCORDANCE WITH THE MASSACHUSETTS BUILDING CODE REQUIREMENTS AND GENERAL FRAMING PRACTICE AS DETAILED IN THE "ARCHITECTURAL GRAPHICS STANDARDS", BY RAMSEY § 91 FEPFER
- ALL PLYWOOD FLOOR SHEATHING SHALL BE GLUED TO SUPPORTING WOOD FRAMING MEMBERS USING AMERICAN PLYWOOD ASSOCIATION (A.P.A.) GLUED FLOOR SYSTEM. WOOD GLUE TO BE CONTECH, INC. PL400 SUBFLOOR CONSTRUCTION ADHESIVE. OR APPROVED EQUAL
- 12. ALL WALL STUDS TO ALIGN WITH FLOOR JOISTS AND ROOF RAFTERS.
- THE CROSS WALLS AND TIE BEAMS ARE TO PROVIDE THE LATERAL RESTRAINT FOR THE BUILDINGS AND SHOULD BE SECURELY ATTACHED AT EACH END AND/OR TO THE EXTERIOR WALLS.
- 14. BUILT-UP BEAMS (3 PIECES MAXIMUM) USING CONVENTIONAL FRAMING LUMBER SHALL BR FULLY SPIKED TOGETHER WITH 27-IBD NAILS AT 8" O.C. AND LYLS WITH 27-IBD NAILS (TOP AND BOTTOM) AT 8" O.C., OR AS OTHERWISE NOTED ON THE DRAWINGS, OR AS RECOMMENDED BY THE MANUFACTURER.
- 5. ALL NAILS, FASTENERS AND CONCRETE EXPOSED TO THE WEATHER SHALL BE HOT-DIP GALVANIZED
- . ALL LUMBER THAT COMES IN CONTACT WITH CONCRETE SHALL BE PRESSURE TREATED.

FOUNDATION \$ CONCRETE NOTES:

- SPREAD FOOTINGS SHALL BEAR LEVEL ON UNDISTURBED SOIL HAVING AN ALLOWABLE BEARING CAPACITY OF TWO TONS PER SQUARE FOOT.
- IF BEARING MATERIALS WITH A LOWER BEARING CAPACITY THAN TWO TONS PER SQUARE FOOT ARE ENCOUNTERED AT THE SPECIFIED ELEVATIONS, THE UNDERLYING UNSUITABLE MATERIAL SHALL BE REMOVED AND REPLACED WITH SUITABLE MATERIAL TO BE APPROVED BY THE ENGINEER/ARCHITECT.
- 3. THE ENGINEER ASSUMES NO RESPONSIBILITY FOR THE VALIDITY OF SUBSURFACE CONDITIONS
- 4. NO FOUNDATION SHALL BE PLACED IN WATER OR ON FROZEN GROUND.
- 5. FOOTINGS SHALL BE PROTECTED AGAINST FROST UNTIL PROJECT IS COMPLETED.
- 6. BACKFILL UNDER ANT PORTION OF THE FOOTINGS AND SLABS SHALL BE COMPACTED IN 6" LIFTS OF 95% COMPACTED GRAVEL AS APPROVED BY THE ENGINEER.
- CONCRETE WORK SHALL CONFORM TO THE LATEST AMERICAN CONCRETE INSTITUTE CODE FOR "BUILDING CODE REQUIREMENTS FOR REINFORCED CONCRETE" AND "SPECIFICATIONS FOR STRUCTURAL CONCRETE FOR BUILDINGS".
- 8. CONCRETE FOUNDATION WALLS AND FOOTINGS SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 3,000 P.S.I. AT 120 DAYS AND 3,500 P.S.I. FOR SLABS, WITH A SLUMP OF NO MORE THEN 4" AND AIR ENTRAINMENT OF 4-6%. THE USE OF CALCIUM CHLORIDE IS NOT PERMITTED. PROVIDE PROPER CONCRETE PROTECTION FOR HEAT IN COLD WEATHER AND MAINTAIN PROPER CURING PROCEDURES IN ACCORDANCE WITH THE ACI.
- 9. STEEL REINFORCEMENT SHALL CONFORM TO A.S.T.M. 615, GRADE 60.
- 10. ALL CONCRETE SLABS ON THE GROUND SHALL BE REINFORCED WITH 6X6-10/10 (MIN.) WELDED WIRE FABRIC PLACED AT MID-DEPTH, OR AS OTHERWISE SHOWN ON THE DRAWINGS WELDED WIRE FABRIC REINFORCEMENT SHALL CONFORM TO A.S.T.M. A185, AND SHALL LAP 6" MINIMUM OR ONE SPACE, WHICHEVER IS LARGER, AND SHALL BE WIRED TOGETHER. PROVIDE SUFFICIENT CHAIR OR SUPPORT BARS AS NECESSARY TO POSITION WELDED WIRE FABRIC.
- . WHERE CONTINUOUS BARS ARE CALLED FOR THEY SHALL BE RUN CONTINUOUSLY AROUND CORNERS AND LAPPED AT NECESSARY SPLICES OR HOOKED AT DISCONTINUOUS ENDS. LAPS SHALL BE 40 BAR DIAMETERS, UNLESS OTHERWISE SHOUN.
- NOTIFY BUILDING DEPARTMENT FOR INSPECTION OF COMPLETED INSTALLATION OF REINFORCEMENT AT LEAST 24 HOURS PRIOR TO SCHEDULED PLACEMENT OF CONCRETE.
- 13. PLACEMENT OF CONCRETE POURS FOR FOUNDATION WALLS SHOULD HAVE A VERTICAL 2"X4" KEY WITH CONTINUOUS REINFORCING (40 BAR DIAMETER MINIMUM) THRU THE CONSTRUCTION JOINT.
- 14. ALL REINFORCING BARS SHALL BE COLD BENT IN ACCORDANCE TO THE PROPER RADII ESTABLISHED BY THE AMERICAN CONCRETE INSTITUTE. UNDER NO CONDITIONS SHALL HEAT BE APPLIED TO THE BARS TO OBTAIN BENDS.
- 15. THE USE OF CONTROL JOINTS IN THE SLAB IS RECOMMENDED TO CONTROL CRACKING. SAW CUT TO A DEPTH ONE HALF INCH NOT-TO-EXCEED IØ FEET BY IØ FEET.
- 16. DAMP PROOF ALL FOUNDATION WALLS BELOW GRADE, OTHER THAN FROST WALLS.


QUANTITY ID LETTER MANUFACT. MODEL TYPE ROUGH OPENING COMMENTS

(WINDOWS SHOWN FOR ESTIMATING AND PERMITTING ONLY

FINAL ORDER TO BE VERIFIED AND APPROVED BY OWNER)

WINDOW SCHEDULE


EXTERIOR DOOR SCHEDULE						
QUANTITY	ID LETTER	MANUFACT.		TYPE	ROUGH OPENING	COMMENTS





SEE "STRUCTURAL ENGINEERING AND WFCM ANALYSIS" BOOKLET NO. 20- BY ENGINEERING. LLC DATED JUNE/_/2020 FOR ADDITIONAL NOTES AND DETAILS ALL NEW FOUNDATION WALLS SHALL BE DAMP PROOFED WITH A BITUMINOUS COATING 6 SQ. FT. OF VENTILATION REQUIRED FOR EVERY 1,500 SQ. FT. OF BASEMENT AREA. OPENING FOR UNDER-FLOOR VENTILATION: 9Q. FT, OPENING/150 9Q. FT. OF CRAWL SPACE AREA DENOTES FOUNDATION WALL DENOTES EXISTING DENOTES PROPOSED FOUNDATION WALL ATOP FOOTING DENOTES PROPOSED LOW FOUNDATION WALL W/2X6 STUD WALL ATOP DENOTES ARCHITECTURAL BUILDING SECTION S2 DENOTES DETAIL IN "STRUCTURAL ELEMENTS" BOOKLET BY STRUCTURAL ENGINEER

FOUNDATION NOTES/LEGEND:

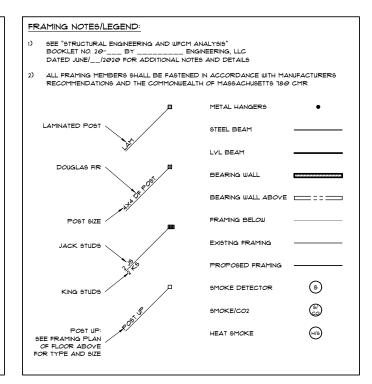



PROJECT:

BRUCE & DIANE POMPEO-MALT
126 WESSAGUSSETT ROAD
WEYMOUTH, MA 02191

- 1/1/2020

| Rockwood | Design, Inc. | 1020 Plan Street - Suite 320 Plan Stre


DATE
1/1/2020
PRAIN BY:
PB CHECKED BY:
BCALE


COPYRIGHT () 978 BY ROCKWOOD DESIGN, INC. THE ARCHITECTURAL PLANS, DRAWINGS, DESIGNS, SPECIFICATIONS AND DIVER ARRANGEMENTS ON THIS SHEET ARE AND SHALL BE COPIED, DISCLOSED TO OTHERS, OR USED IN CONSECTION WITH ANY WORK OR PROJECT, OTHER THAN THE SPECIFIED PROJECT, OTHER THAN T

SEE SHEET AI FOR DRAWING INDEX

IF PRINTED ON 11X17, ALL SCALE IS HALF.

CONTRACTOR TO VERIFY ALL DIMENSIONS AND SETBACKS PRIOR TO CONSTRUCTION

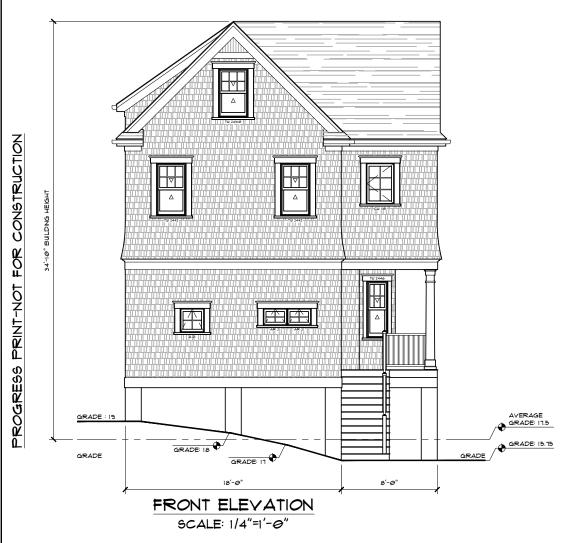

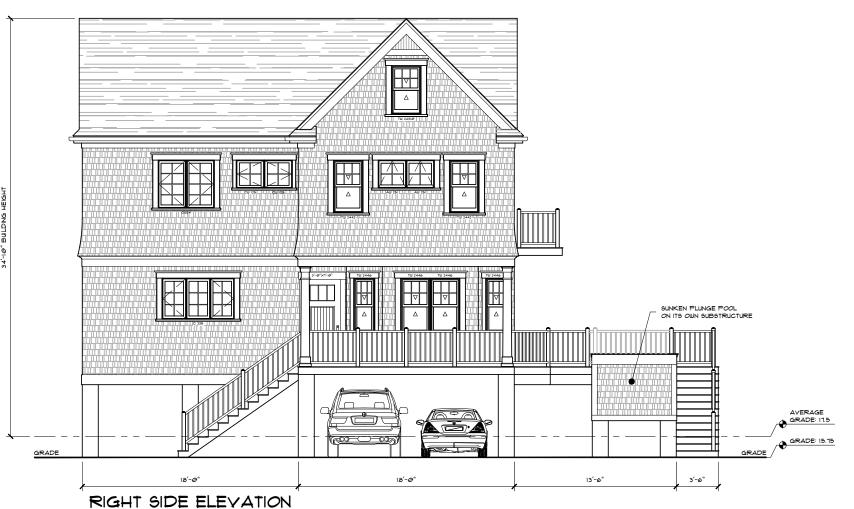

SET BZA

BRUCE ⊈ DIANE POMPEO-MALTBY 126 WE99AGU99ETT ROAD WEYMOUTH, MA Ø2191

SCALE: 1/4"=1'-0"

SEE SHEET AI FOR DRAWING INDEX

IF PRINTED ON 11X17, ALL SCALE IS HALF.

CONTRACTOR TO VERIFY ALL DIMENSIONS
AND SETBACKS PRIOR TO CONSTRUCTION

SEAR ELEVATION

REAR ELEVATION

SCALE: 1/4"=1'-0"



LEFT SIDE ELEVATION

SCALE: 1/4"=1'-0"

BZA SET - 1/1/2020

DATE: 1/1/2020 DRAWN BY: PB


DRAWN BY: PB CHECKED BY:

BRUCE ¢ DIANE POMPEO-MALTBY 126 WESSAGUSSETT ROAD WEYMOUTH, MA Ø2131

A2.

TRIGHT () 3978 BY ROCKWOOD DESIGN, INC. THE ARCHITECTURAL PLANS, DRAWINGS, DESIGNS, SPECIFICATIONS AND DEVELOPED, WITHOUT THE EXPRESS KNOWLEDGE AND WRITTEN CONSENT OF ROCKWOOD DESIGN, INC.

NO PART THEREOF SHALL BE COPIED, DISCLOSED TO OTHERS, OR USED IN CONSECTION WITH ANY WORK OR PROJECT, OTHER THAN THE SPECIFIED PROJECT, OTHER THAN THE SPECIFIED PROJECT, OTHER THAN THE SPECIFIED PROJECT FOR WHICH THEY HAVE BEEN PREPARED AND DEVELOPED, WITHOUT THE EXPRESS KNOWLEDGE AND WRITTEN CONSENT OF ROCKWOOD DESIGN, INC.

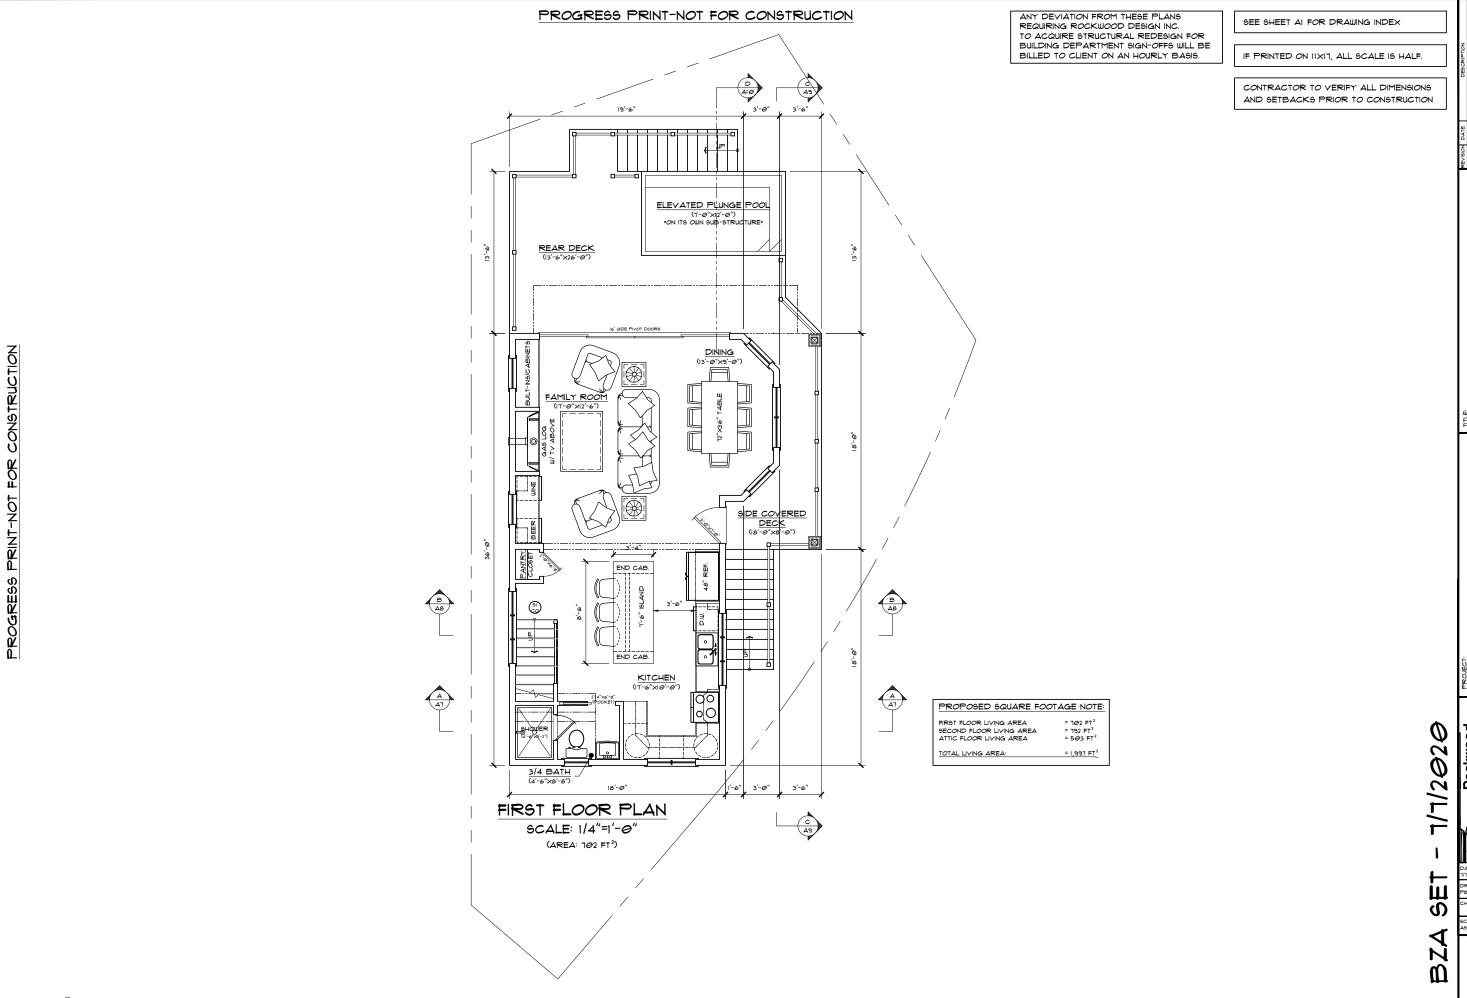

BRUCE ¢ DIANE POMPEO-MALTBY 126 WE99AGU99ETT ROAD WEYMOUTH, MA Ø2191



COPYRIGHT () 2010 BY ROCKWOOD DESIGN, INC. THE ARCHITECTURAL PLANS, DRAWINGS, DESIGNS, SPECIFICATIONS AND OTHER ARRANGEMENTS ON THIS SHEET ARE AND SHALL REMAIN THE PROPERTY OF ROCKWOOD DESIGN, INC. OP PART THEREOF SHALL BE COPIED, DISCLOSED TO OTHERS, OR USED IN CONNECTION WITH ANY WORK OF PROJECT, OTHER THAN THE SPECIFIED PROJECT FOR WHICH THEY HAVE BEEN PREPARED AND DEVELOPED, WITHOUT THE EXPRESS KNOWLEDGE AND WRITTEN CONSENT OF ROCKWOOD DESIGN, INC.

TILE:
SECOND FLOOR PLAN

BRUCE & DIANE POMPEO-MALIBY 126 WESSAGUSSETT ROAD WEYMOUTH, MA @2191

| Rockwood | | Pockwood | | Poc



DATE: 1/1/2020 DRAWN BY: PB

DRAWN BY: PB CHECKED BY:

SCALE: AS NOTED

4

SEE SHEET AI FOR DRAWING INDEX

CONTRACTOR TO VERIFY ALL DIMENSIONS AND SETBACKS PRIOR TO CONSTRUCTION


ATTIC

BRUCE ¢ DIANE POMPEO-MALTBY 126 WE99AGU99ETT ROAD WEYMOUTH, MA Ø2191



SET

COPYRIGHT () 2010 BY ROCKWOOD DESIGN, INC. THE ARCHITECTURAL PLANS, DRAWINGS, DESIGNS, SPECIFICATIONS AND OTHER ARRANGEMENTS ON THIS SHEET ARE AND SHALL REMAIN THE PROPERTY OF ROCKWOOD DESIGN, INC. OP PART THEREOF SHALL BE COPIED, DISCLOSED TO OTHERS, OR USED IN CONNECTION WITH ANY WORK OF PROJECT, OTHER THAN THE SPECIFIED PROJECT FOR WHICH THEY HAVE BEEN PREPARED AND DEVELOPED, WITHOUT THE EXPRESS KNOWLEDGE AND WRITTEN CONSENT OF ROCKWOOD DESIGN, INC.

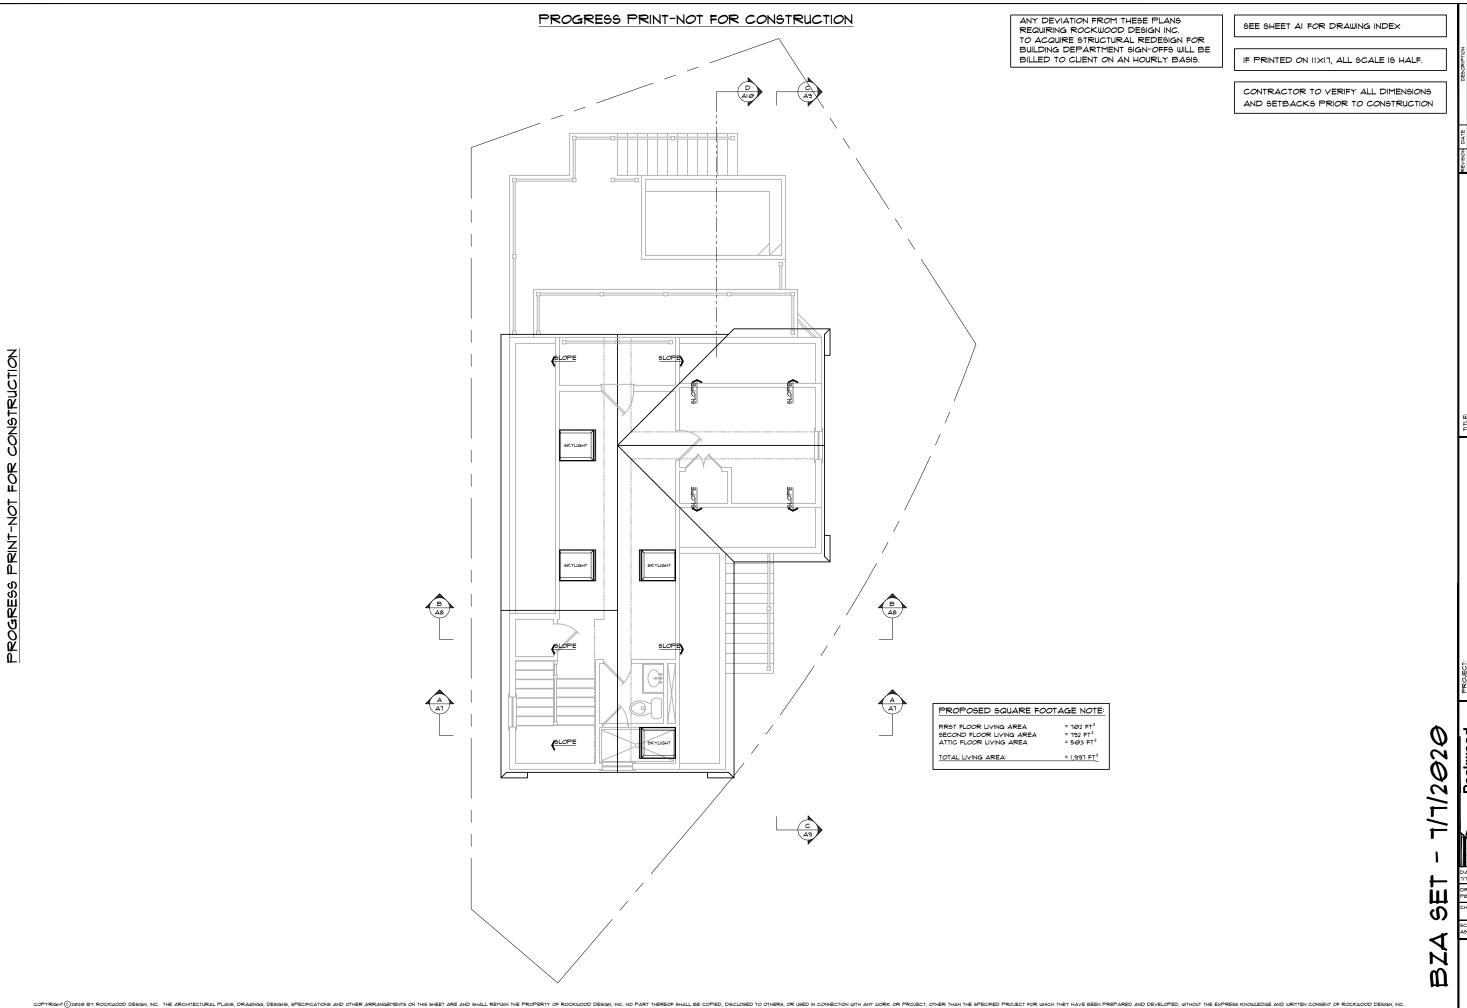

BRUCE ¢ DIANE POMPEO-MALTBY 126 WESSAGUSSETT ROAD WEYMOUTH, MA Ø2131





SEE SHEET AI FOR DRAWING INDEX

IF PRINTED ON 11X17, ALL SCALE IS HAL

CONTRACTOR TO VERIFY ALL DIMENSIONS
AND SETBACKS PRIOR TO CONSTRUCTION


CANTILEVER 2X8 PT DECK JOISTS ø ELEVATED PLUNGE POOL (7'-0"×12'-0") *ON ITS OWN SUBSTRUCTURE* 2X8 PT @ 12" O.C. AVERAGE GRADE: 17.5 GRADE: 15.15 GRADE VARIES 6'-6" 7'-0" ELEVATED PLUNGE POOL
SECTION "D-D"
SCALE: 3/8"=1'-0"

PROGRESS

BZA SET - 1/1/2020

Ale Ale

RIGHT () 2020 BY ROCKWOOD DESIGN, INC. THE ARCHITECTURAL PLANS, DRAWINGS, DESIGNS, SPECIFICATIONS AND OTHER ARRANGEMENTS ON THIS SHEET ARE AND SHALL REMAN THE PROPERTY OF ROCKWOOD DESIGN, INC. NO PART THEREOF SHALL BE COPIED, DISCLOSED TO OTHERS, OR USED IN CONNECTION WITH ANY WORK OR PROJECT, OTHER THAN THE SPECIFIED PROJECT FOR WHICH THEY HAVE BEEN PREPARED AND DEVELOPED, WITHOUT THE EXPRESS KNOWLEDGE AND WRITTEN CONSENT OF ROCKWOOD DESIGN, INC.

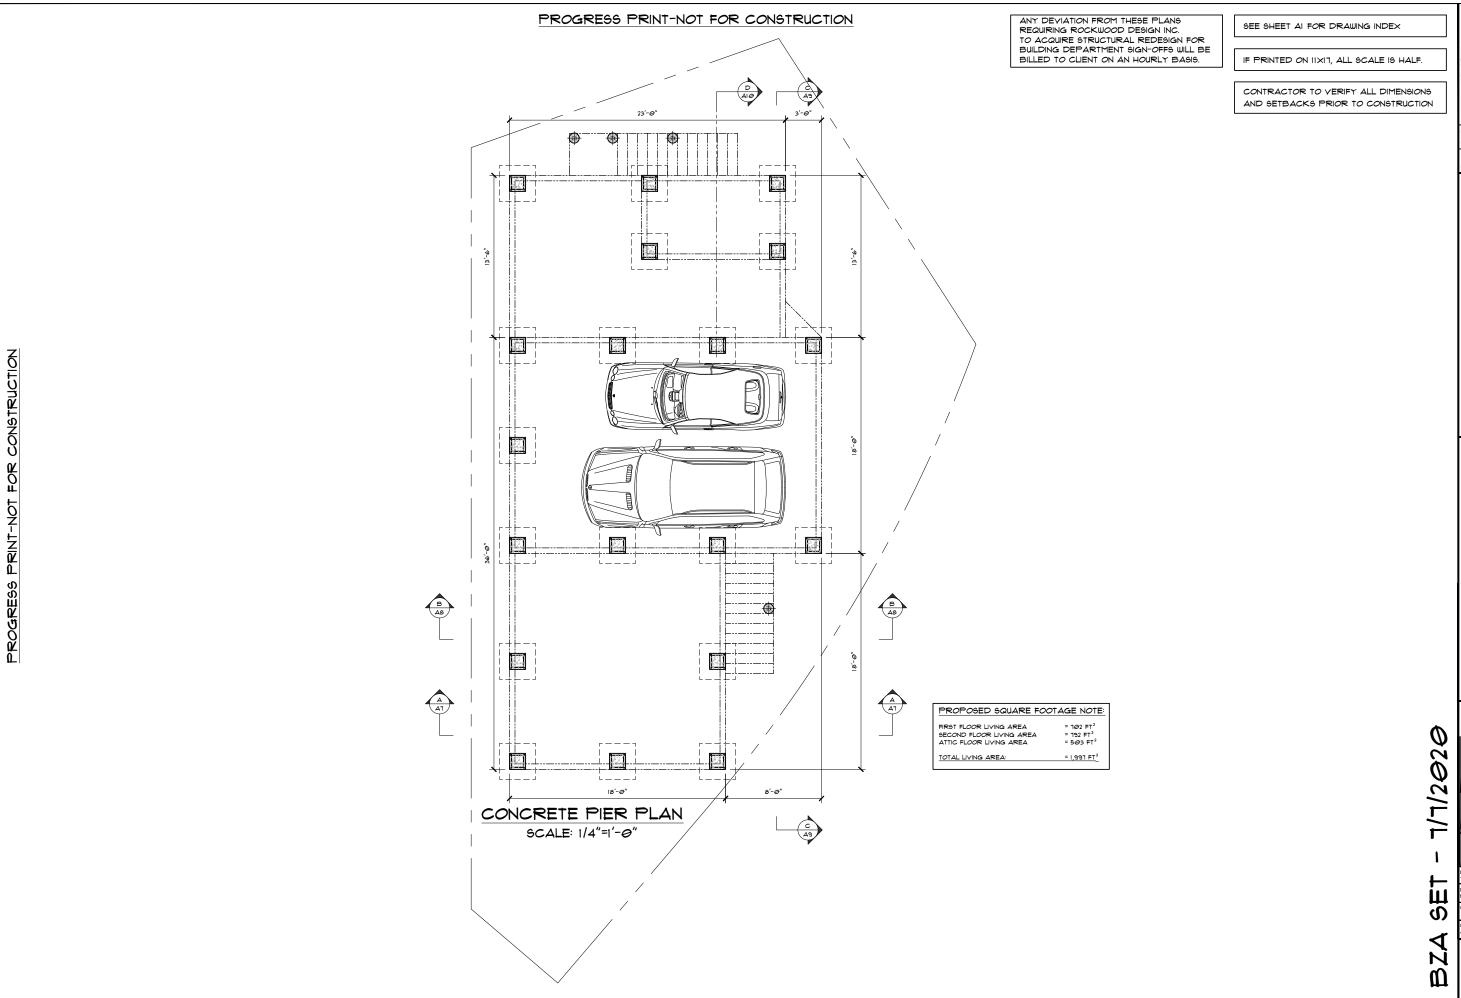

TITLE
PEO-MALTBY FOUNDATION PLAN
DAD

PROJECT:
BRUCE ¢ DIANE POMPEO-MALTBY
126 WESSAGUSSETT ROAD
WEYMOUTH, MA Ø2191



DATE: 1/1/2020 DRAWN BY: PB

DRAWN BY: PB CHECKED BY:

SI

ノ| ∞56

COPYRIGHT () 2010 BY ROCKWOOD DESIGN, INC. THE ARCHITECTURAL PLANS, DRAWINGS, DESIGNS, SPECIFICATIONS AND OTHER ARRANGEMENTS ON THIS SHEET ARE AND SHALL REMAIN THE EXPRESS KNOWLEDGE AND WRITTEN CONSENT OF ROCKWOOD DESIGN, INC.