

**DRAINAGE CALCULATIONS AND
STORMWATER MANAGEMENT PLAN**

For:

**SITE DEVELOPMENT
550-560 WASHINGTON STREET
(APN 29-330-3)
WEYMOUTH, MASSACHUSETTS**

Located:

**550-560 WASHINGTON STREET
WEYMOUTH, MASSACHUSETTS**

Submitted to:

TOWN OF WEYMOUTH

Prepared For:

**UNION REALTY TRUST
560 WASHINGTON STREET
WEYMOUTH, MASSACHUSETTS 02188**



**Professional Civil Engineering • Project Management • Land Planning
150 Longwater Drive, Suite 101, Norwell, Massachusetts 02061
Tel.: (781) 792-3900 Facsimile: (781) 792-0333
www.mckeng.com**

MARCH 24, 2023

TABLE OF CONTENTS

1. NARRATIVE	<u>Page</u>
▪ Project Summary	1
▪ Pre-Development Condition	1
▪ Post-Development Condition	2
▪ Stormwater Best Management Practices (BMP's)	3
▪ Erosion and Sedimentation Control	3
▪ Compliance with Stormwater Management Standards	3
▪ Figure 1 (USGS Locus Map)	8
▪ Figure 2 (FEMA Flood Map)	9
▪ Figure 3 (NRCS Soils Map)	10
▪ Figure 4 (Aerial Photograph)	11
▪ Figure 5 (NHESP Map)	12
2. APPENDICES	
▪ APPENDIX A: Pre-Development Condition	
▪ APPENDIX B: Post Development Condition	
▪ APPENDIX C: Checklist for Stormwater Report	
▪ APPENDIX D: Illicit Discharge Compliance Statement Supplemental BMP Calculations	
▪ APPENDIX E: Soil Testing Data	
▪ APPENDIX F: Best Management Practices Operation & Maintenance Plans	

**Drainage Calculations and Stormwater Management Plan
Proposed Restaurant & Multi-Family Building
550-560 Washington Street, Weymouth, MA
(Assessors Map 29, Block 330, Lot 3)**

Project Summary

The project proponent, Union Realty Trust proposes to redevelop 550-560 Washington Street in Weymouth, Massachusetts consisting of one (1) parcel as shown on the Weymouth Assessor's Map 29, Block 330, Lot 3 comprising of approximately 1.66 acres. The proposed redevelopment will consist of razing of existing structures and the construction of a two-story \pm 13,890 square foot mixed use, restaurant and multi-family building along with the construction of asphalt parking/access roadway, installation of subsurface stormwater management systems, utilities, site grading and landscaping.

This report contains stormwater runoff calculations for the pre-development and post-development conditions and includes the sizing of the proposed stormwater best management practices (BMPs). The proposed and existing site conditions are illustrated on the project *site plans* entitled "Site Development Plan, (Assessor's Parcel ID 29-330-3), 550-560 Washington Street, Weymouth, Massachusetts", prepared by McKenzie Engineering Group, Inc. dated March 24, 2023.

Pre-Development Condition

The parcel is currently developed and consists of an existing restaurant building with bituminous concrete parking area, and a detached single-family dwelling with shed and equipment storage area. The site is located within the Town of Weymouth Limited Business (B-1) Zoning District, and Weymouth Commercial Corridor Overlay (CCOD) District, Washington Street Corridor. The Site is also located in the Town of Weymouth Watershed Protection District. The site has frontage on Washington Street to the southwest and is bordered by developed residential property to the east, commercial property to the south, and undeveloped woodlands to the north and northwest. A bordering vegetated wetland complex, and limit of inland bank associated with a perennial stream is located within the woodlands offsite to the north and northwest. The topography of the site ranges in elevation from approximately 94 ft. (NAVD 88) along the wetlands at the northern portion of the site to an elevation of approximately 120 ft. located at the central portion of the site. Portions of runoff emanating from the site flow in a westerly direction to the closed drainage system on Washington Street, and northerly to the existing wetlands. The limit of bordering vegetated wetland resource area on the site was delineated by Environmental Consulting & Restoration, LLC on July 7, 2021. Refer to Figure 1- USGS Locus Map for the location of the parcel.

A review of available environmental databases such as MassGIS reveals that the Site is located within a MassDEP designated Outstanding Resource Waters (ORW) area. The Site is not located within a DEP Zone II or Natural Heritage Endangered Species Area, refer to Figure 5 – Natural Heritage and Endangered Species Map. The site is located within the Zone X of the Flood Insurance Rate Map, as shown on the current FEMA Flood Insurance Rate Map Panel No. 25021C0229E with an effective date of July 17, 2012. Refer to Figure 2 – FEMA Flood Map.

The soil types as identified by the Soil Survey, Plymouth County, MA prepared by the NRCS Soil Conservation Service (NRCS) are classified as 52-Freetown Muck, 0 to 1

percent slopes, with hydrologic soil group (HSG) B/D; 602-Urban Land, 0 to 15 percent slopes, with no hydrologic soil group. Soil testing conducted by McKenzie Engineering Group, Inc. (MEG) on November 5, 2019 identified the soils to be sandy loam. Refer to Figure 3 - Soil Map for the NRCS delineation of soil types and Appendix E – Soil Testing Results for supporting data.

In the pre- and post- development stormwater analysis, the watershed area analyzed was approximately 1.65 acres consisting of the subject parcel to be developed. The watershed consists of three (3) design points. Refer to Pre-Development Watershed Delineation Plan WS-1 in Appendix A for a delineation of drainage subareas for the pre-development design condition.

The SCS Technical Release 20 (TR-20) and Technical Release 55 (TR-55) method-based program “HydroCAD” was employed to develop pre- and post-development peak flows. Drainage calculations were prepared for the pre-development condition for the 2, 10, 25 and 100-year, Type III storm events. Refer to Appendix A for computer results, soil characteristics, cover descriptions and times of concentrations for all subareas.

Post-Development Condition

The proposed development will consist of the construction of a two-story ±13,811 square foot mixed use, restaurant and multi-family building along with the construction of asphalt parking/access roadway, installation of subsurface stormwater management systems, utilities, site grading and landscaping. The project will access utility infrastructure located on Washington Street, including water, electric, telephone and cable. The stormwater management system and will be designed to fully comply with all standards of the Department of Environment Protection’s Stormwater Management Regulations.

Watershed areas were analyzed in the post-development condition to design low impact stormwater management facilities to mitigate impacts resulting from developing the property. The objective in designing the proposed drainage facilities for the project was to maintain existing drainage patterns to the extent practicable and to ensure that the post-development rates of runoff are less than pre-development rates at the design points.

Refer to the Post-Development Watershed Plan WS-2 in Appendix B for a delineation of post-development drainage subareas. The design points for the post-development design conditions correspond to those analyzed for the pre-development design condition.

The proposed system utilizes deep sump hooded catch basins, proprietary pre-treatment unitst and subsurface infiltration tank systems. The infiltration tank systems were designed to accommodate peak flows generated by all storms up to the 100-year storm event. Refer to site plans for the drainage system design. All BMPs shall be supported by a comprehensive Construction Phase Pollution Prevention and Erosion Control Plan and Post-Development BMP Operation and Maintenance Plan.

Drainage calculations were prepared by employing the SCS TR-20 Methods for the 1, 2, 10, 25 and 100-year, type III storm events. Refer to Appendix B for computer results.

A comparison of the pre-development and post-development peak rates of runoff indicate that the peak rates of runoff for the post-development condition at all Design Points will be less than the pre-development condition for all storm events.

Stormwater Best Management Practices (BMP's)

Treatment stream for the redevelopment shall consist of deep sump hooded catch basins a proprietary pre-treatment unit, and subsurface infiltration tank systems to achieve the required removal of at least 80% of the total suspended solids (TSS) and mitigate the anticipated pollutant loading.

Refer to the TSS Removal Worksheets in Appendix D for TSS removal rates.

Erosion and Sedimentation Controls

Compost filter tube (Silt sock) erosion control barriers will be placed at the limit of work prior to the commencement of any construction activity. The integrity of the silt sock will be maintained by periodic inspection and replacement as necessary. The silt sock will remain in place until the first course of pavement has been placed and all side slopes have been loamed and seeded and vegetation has been established. Refer to the Erosion Control details on the Site Development Plans and BMP Operation and Maintenance Plan for proposed erosion control measures to be employed for the project.

Compliance with Stormwater Management Standards

Standard 1 – No New Untreated Discharges

The proposed redevelopment will not introduce any new untreated discharges to a wetland area or waters of the Commonwealth of Massachusetts. All discharges from the site will be treated through proposed stormwater quality controls such as deep sump hooded catch basins, pre-treatment structures and subsurface infiltration tank systems including the establishment of proper maintenance procedures.

Standard 2 – Peak Rate Attenuation

In the pre-development and post-development stormwater analysis, the watershed area analyzed was approximately 5.4 acres consisting of the subject parcel to be developed and offsite tributary areas. Refer to Existing Watershed Delineation Plan WS-1 for a delineation of drainage subareas for the pre-development design condition and refer to Post-Development Watershed Delineation Plan WS-2 for a delineation of drainage subareas for the post-development design condition.

Drainage calculations were performed by employing SCS TR-20 methods for the 1, 2, 10, 25, and 100-year Type III storm events. Refer to Appendix A and B for computer results. All drainage structures will be designed employing the Rational Method and the Mass. DPW Design Manual to accommodate peak flows generated by a minimum of a 25-year storm event or a 100-year storm event where applicable. The stormwater management systems were designed to accommodate peak flows generated by a 100-year storm event.

The peak rates of runoff are as follows:

Pre-Development vs. Post-Development Peak Rates of Runoff

Design Point	2 Year Storm (3.31 Inches)		10 Year Storm (4.90 Inches)		25 Year Storm (6.14 Inches)		100 Year Storm (8.65 Inches)	
	Exist. (CFS)	Prop. (CFS)	Exist. (CFS)	Prop. (CFS)	Exist. (CFS)	Prop. (CFS)	Exist. (CFS)	Prop. (CFS)
Design Point 1	2.63	0.72	4.74	2.37	6.43	4.66	9.86	8.75
Design Point 2	0.49	0.25	0.83	0.39	1.09	0.50	1.61	0.73
Design Point 3	0.21	0.08	0.36	0.18	0.48	0.26	0.71	0.42

A comparison of the pre-development and post-development peak rates of runoff indicates that the peak rates of runoff for the post-development condition will be equal or less than the pre-development condition for all storm events.

Pre-Development vs. Post-Development Volumes of Runoff

Design Point	2 Year Storm (3.31 Inches)		10 Year Storm (4.90 Inches)		25 Year Storm (6.14 Inches)		100 Year Storm (8.65 Inches)	
	Exist. (AC-FT)	Prop. (AC-FT)	Exist. (AC-FT)	Prop. (AC-FT)	Exist. (AC-FT)	Prop. (AC-FT)	Exist. (AC-FT)	Prop. (AC-FT)
Design Point 1	0.191	0.090	0.346	0.235	0.473	0.360	0.740	0.629
Design Point 2	0.036	0.018	0.062	0.030	0.082	0.039	0.124	0.057
Design Point 3	0.016	0.006	0.027	0.013	0.036	0.019	0.055	0.031

Standard 3 – Groundwater Recharge

Runoff will be infiltrated by subsurface infiltration tanks, which will meet the Stormwater Guidelines for infiltration:

- Infiltration structures will be a minimum of four (4) feet above seasonal high groundwater.
- Utilize the “Static” method for sizing the storage volume.
- Hydraulic conductivity is based on soil data from the Geotechnical Report and values developed from Rawls, Brakensiek and Saxton, 1982, Estimation of Soil Water Properties, *Transactions of the American Society of Agricultural Engineers*, vol.25, no. 5.
- Refer to Appendix D for infiltration and drawdown calculations and Appendix E for soil data.

Groundwater Recharge Volume

Infiltration Tank System	Soil Type	Target Depth Factor (F) (in)	Total Impervious Area (sf)	Required Recharge Volume (cf) ¹	Provided Recharge Volume (cf) ²
	C	0.25	35,756	745	
P-1					2,651
				745 (839 ADJ.)	2,651

1. Required Recharge Volume = Target Depth Factor x Impervious Area / (d+Kt)
(Refer to supplemental calculations in Appendix D)
2. Provided Recharge Volume = Volume Provided from Bottom of System to invert of overflow pipe.

Per Standard 3, if stormwater runoff from less than 100% of the site’s impervious cover is directed to the BMP intended to infiltrate the Required Recharge Volume, then the storage capacity of the infiltration BMP needs to be increased so that the BMP can capture more of the runoff from the impervious surfaces located with the contributing drainage area. The impervious cover directed towards the infiltration system is 88.8%; therefore, a capture area adjustment was made. Refer to Appendix D for Capture Area Adjustment calculations.

The infiltration tank systems will provide both water quality treatment and recharge. Per Standard 4, Water Quality, the BMP must be sized to treat or hold the Target Volume, the larger of the Required Water Quality Volume and the Required Recharge Volume. The Required Water Quality Volume is based on one inch of runoff and the Required Recharge Volume is based on 0.25-inches (Soil Type C); therefore the Target Volume is the Required Water Quality Volume of 2,646 cubic feet. Refer to Appendix D supplemental calculations.

The proposed subsurface infiltration chambers and infiltration basin has been designed to completely drain within 72 hours. The drawdown analysis is based on the required recharge volume exfiltrating at the Rawls Rates based on the soil textural analysis conducted at the proposed exfiltration location. Refer to Appendix D for calculations.

Standard 4 – Water Quality

The Long-Term Pollution Prevention Plan has been incorporated into the Post-Development Operation and Maintenance Plan. Refer to Appendix F for BMP Operation and Maintenance Plans.

The stormwater management system design calls for the installation of 4'-deep sump catch basins with hooded outlets to collect runoff from the proposed roadways. Stormwater runoff from roadways will then be routed to proprietary treatment devices and followed by the subsurface infiltration tank. Removal rates for all paved surfaces are:

Deep Sump Catch Basins 25%

First Defense Proprietary Pretreatment Devices	70% (Per MASTEP Performance Evaluation for First Defense Units) (See Appendix D for Sizing and TSS Removal Charts)
Subsurface Infiltration System with Pretreatment	80%

The Site discharges to bordering vegetated wetlands which qualify as a MassDEP designated Outstanding Resource Water, therefore the design of the subsurface infiltration system requires water quality treatment of 1” of runoff. The stormwater management system will be designed to be in full compliance with the Standards of the DEP Stormwater Management Policy. A treatment stream consisting of deep-sump catch basins with hooded outlets and proprietary devices will ensure that the 44% TSS removal (total suspended solids) is removed prior to discharge to the infiltration facilities and to ensure that 80% TSS removal is accomplished. The proposed treatment stream will renovate the stormwater and improve the water quality by promoting the settlement of sediments and pollutants before runoff is released into the existing drainage system. Refer to Appendix D for TSS Removal Calculation Worksheets.

The Water Quality Volume (WQV) to be treated is equal to the impervious area draining to the water quality device multiplied by one inch. The table below shows the volume required and provided with the proposed development. Refer to Appendix D for further calculations.

Water Quality Treatment Volume

Basin	Required WQ Volume (cf)	Proposed WQ Volume (cf)	
P-1	2,646	2,651	Subsurface infiltration system with pre-treatment
	2,646	2,651	

Standard 5 – Land Use with Higher Potential Pollutant Loads (LUHPPL)

The proposed project does not include land uses with higher potential pollutant loads. Not Applicable.

Standard 6 – Critical Areas

The bordering vegetated wetland complex to the north is a Critical Area, the proposed site discharge treatment train includes only BMP’s that MassDEP has approved for stormwater discharges to, or near the Critical Area.

Standard 7 - Redevelopments and Other Projects Subject to the Standards only to the maximum extent practicable

The proposed project is a redevelopment project and therefore is subject to the Standards only to the maximum extent practicable.

Standard 8 – Construction Period Pollution Prevention and Erosion and Sedimentation Control

The project will require a NPDES Construction General Permit but the Stormwater Pollution Prevention Plan (SWPPP) has not been submitted. The SWPPP will be submitted prior to any proposed construction. A Construction Phase BMP Operation and Maintenance Plan will be provided as a basis for the SWPPP during final design.

Standard 9 – Operation and Maintenance Plan


The Long-Term Operation and Maintenance Plan is provided in Appendix F.

Standard 10 – Prohibition of Illicit Discharges

No illicit discharges are anticipated on site. An Illicit Discharge Compliance Statement will be submitted prior to the discharge of any stormwater to the post-construction best management practices. Measures to prevent illicit discharges will be included in the Long-Term Pollution Prevention Plan.



FIGURE - 1

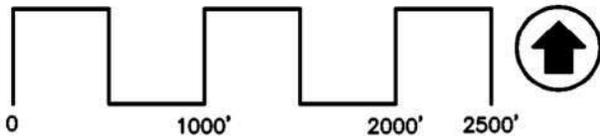

U.S. GEOLOGICAL SURVEY
7.5 X 15 MINUTE SERIES



Assinippi Office Park
150 Longwater Drive, Suite 101
Norwell, MA 02061
P: 781.792.3900
F: 781.792.0333
www.mckeng.com

USGS LOCUS MAP

550 WASHINGTON STREET
APN 330-3
WEYMOUTH, MASSACHUSETTS


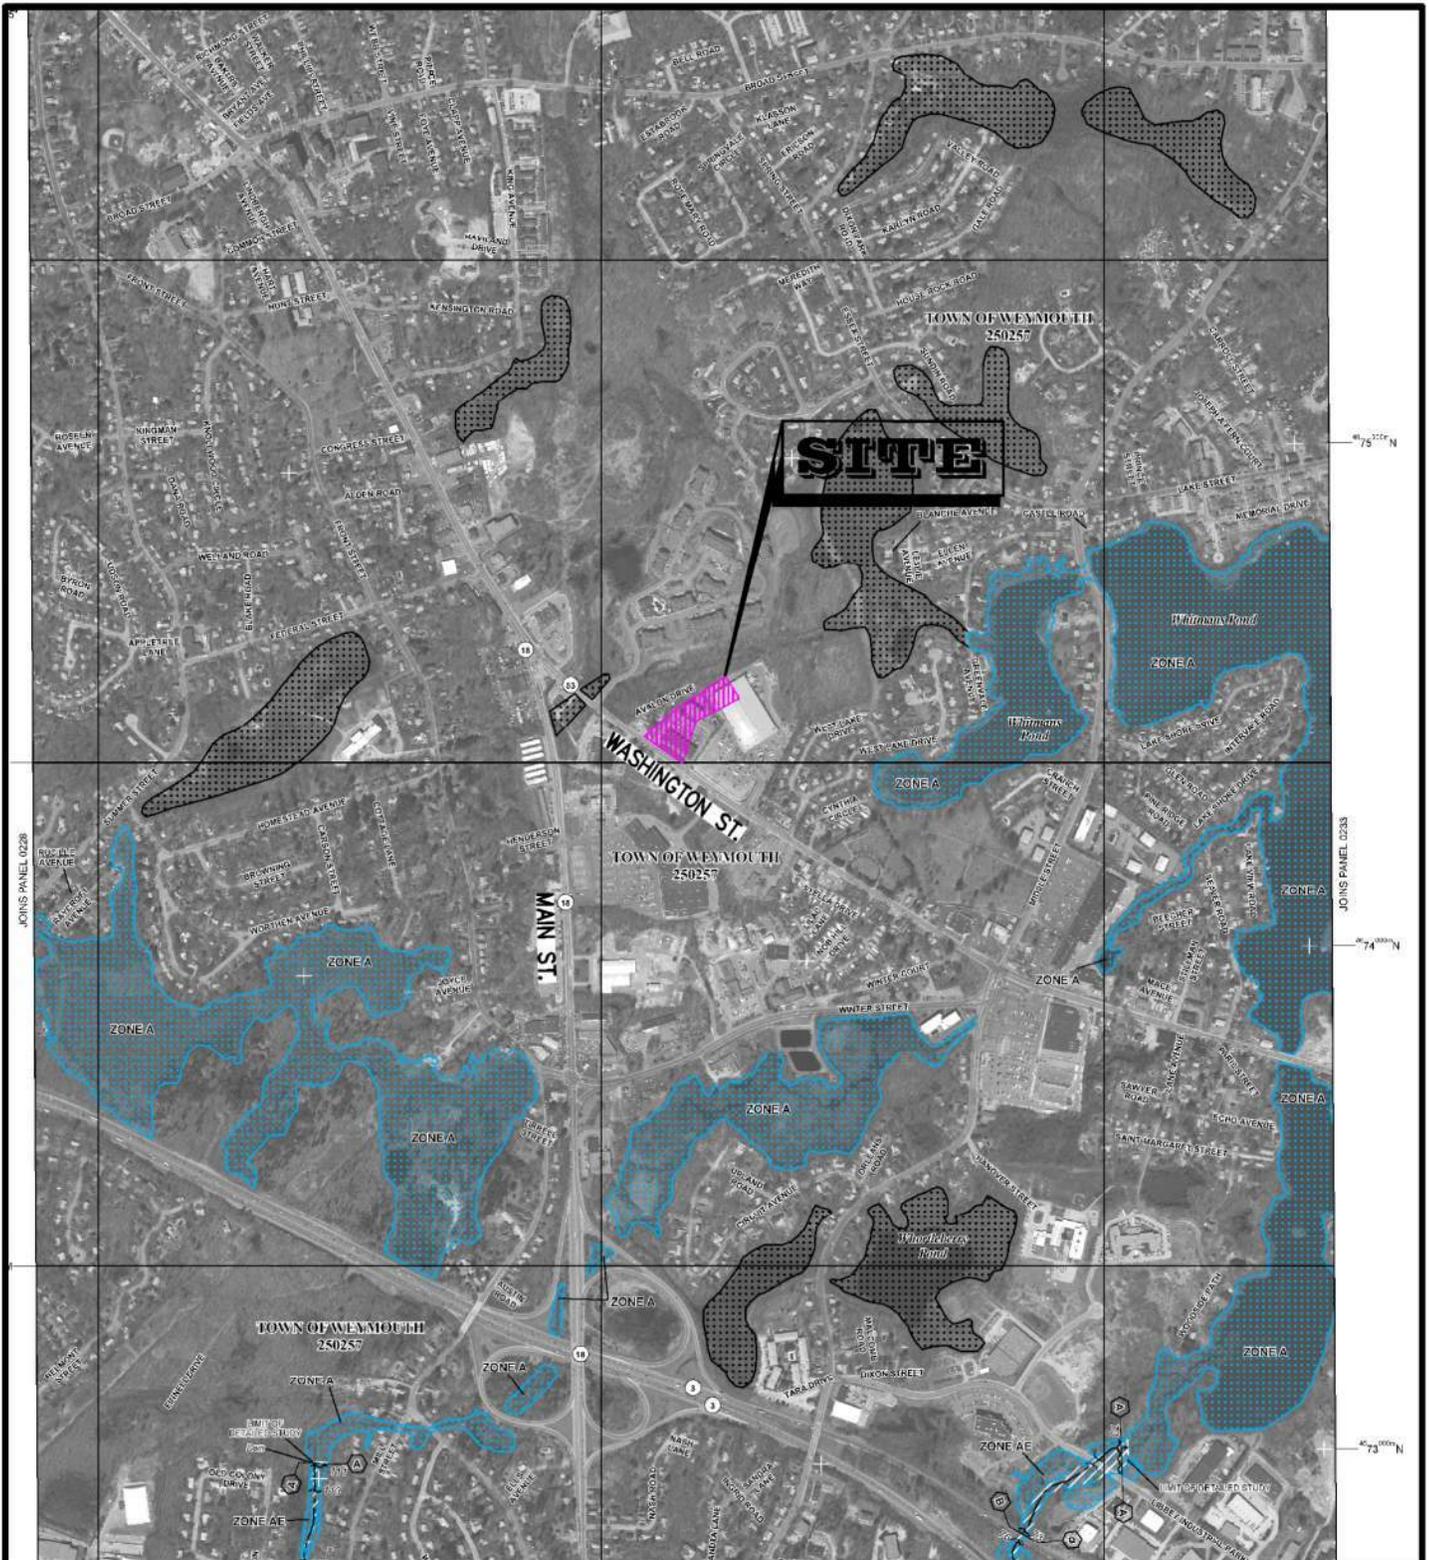


FIGURE - 2



COMMUNITY PANEL NO: 25021C0229E
EFFECTIVE DATE: JULY 17, 2012

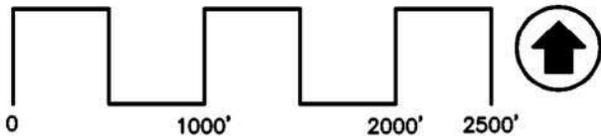

Assinippi Office Park
150 Longwater Drive, Suite 101
Norwell, MA 02061
P: 781.792.3900
F: 781.792.0333
www.mckeng.com

FEMA FLOOD MAP


550 WASHINGTON STREET
APN 330-3
WEYMOUTH, MASSACHUSETTS



SOIL KEY

SOIL CLASSIFICATION	DESCRIPTION	HYDROLOGIC SOIL GROUP
52	FREETOWN MUCK, 0 TO 1 PERCENT SLOPES	B/D
602	URBAN LAND, 0-15 PERCENT SLOPES	N/A

FIGURE - 3

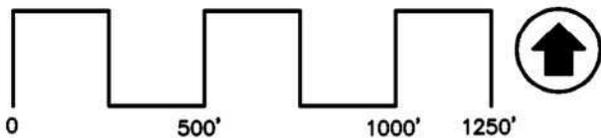

NRCS SOIL SURVEY
PLYMOUTH COUNTY



Assinippi Office Park
150 Longwater Drive, Suite 101
Norwell, MA 02061
P: 781.792.3900
F: 781.792.0333
www.mckeng.com

NRCS SOILS MAP

550 WASHINGTON STREET
APN 330-3
WEYMOUTH, MASSACHUSETTS


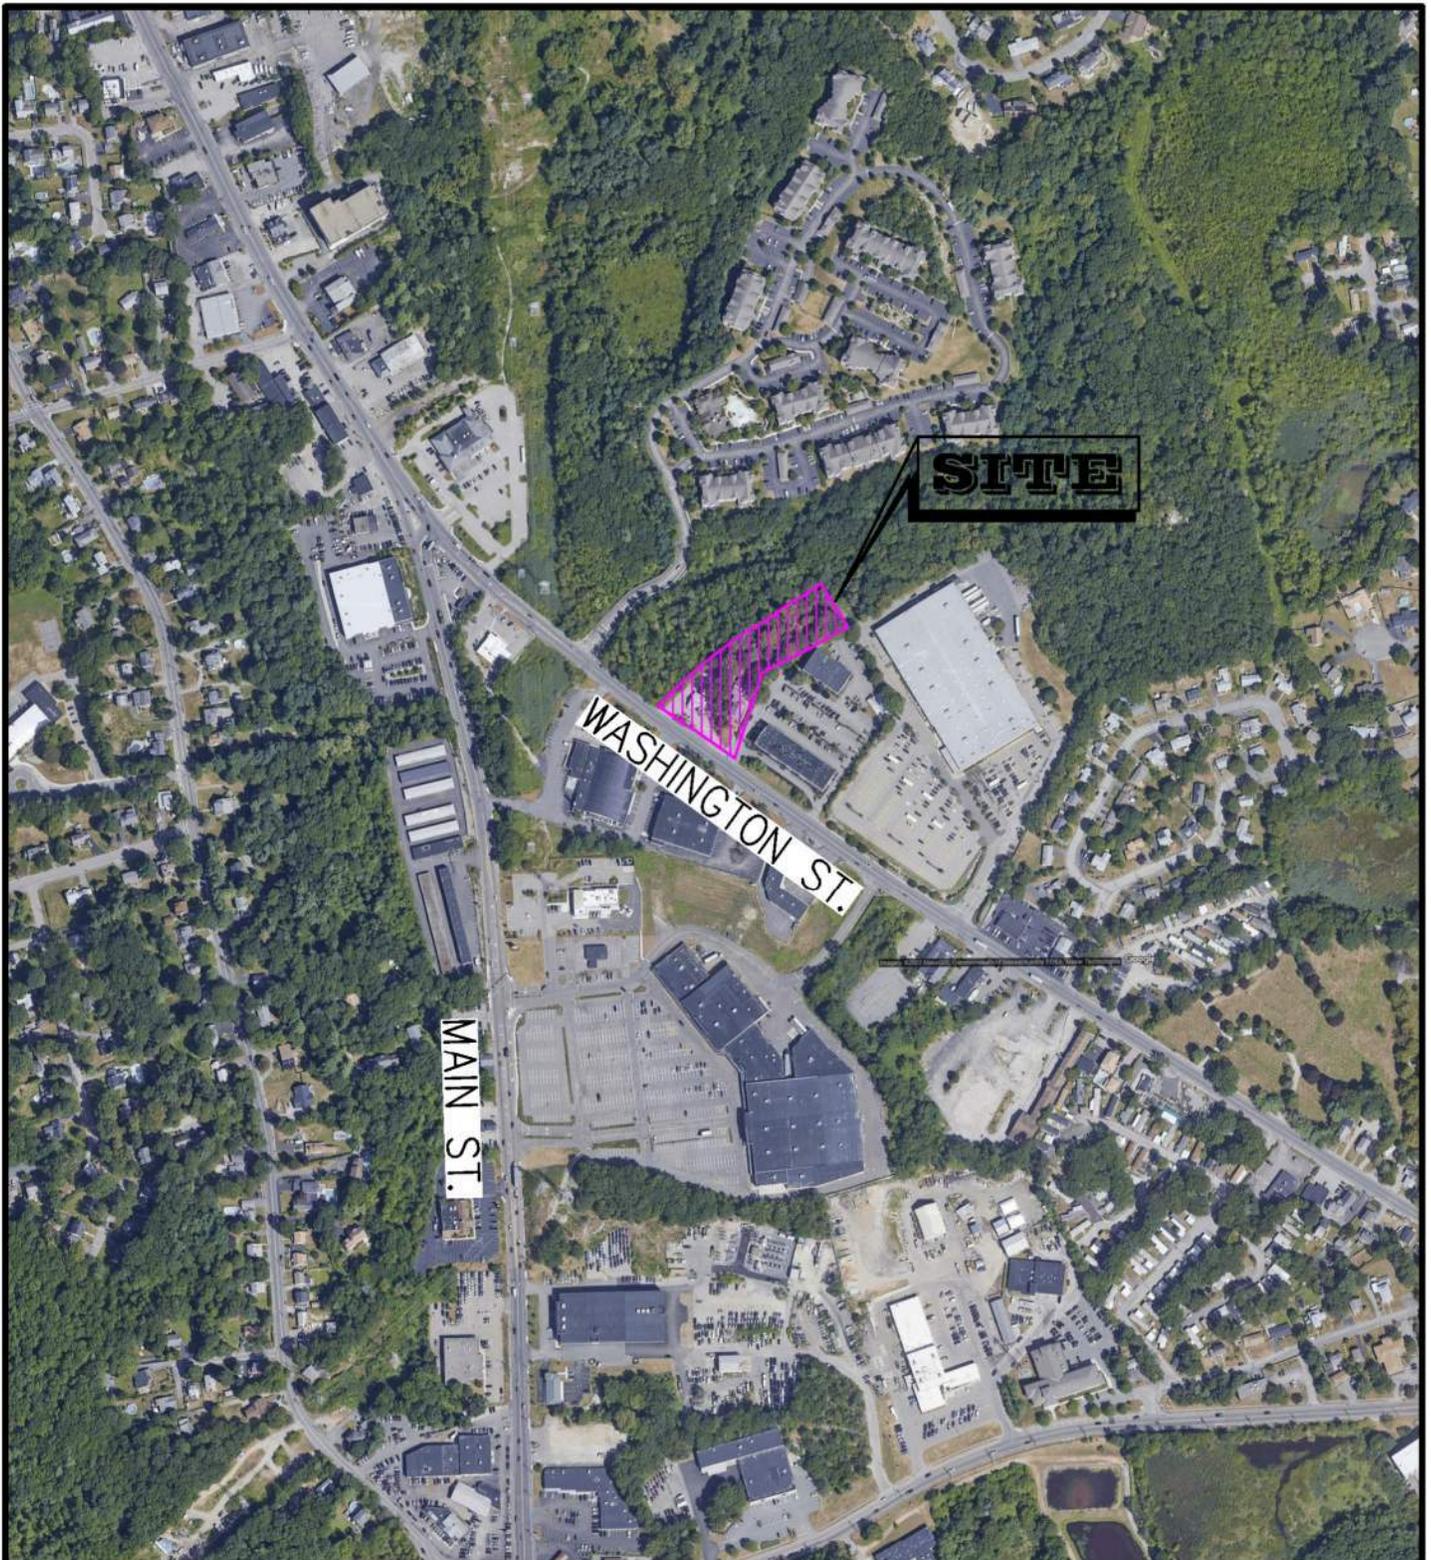


FIGURE - 4



Google Earth Imagery
Copyright 2017

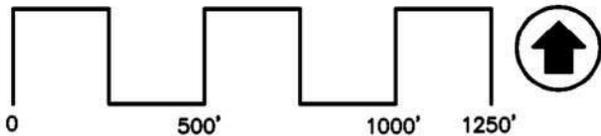

Assinippi Office Park
150 Longwater Drive, Suite 101
Norwell, MA 02061
P: 781.792.3900
F: 781.792.0333
www.mckeng.com

AERIAL PHOTOGRAPH

550 WASHINGTON STREET
APN 330-3
WEYMOUTH, MASSACHUSETTS


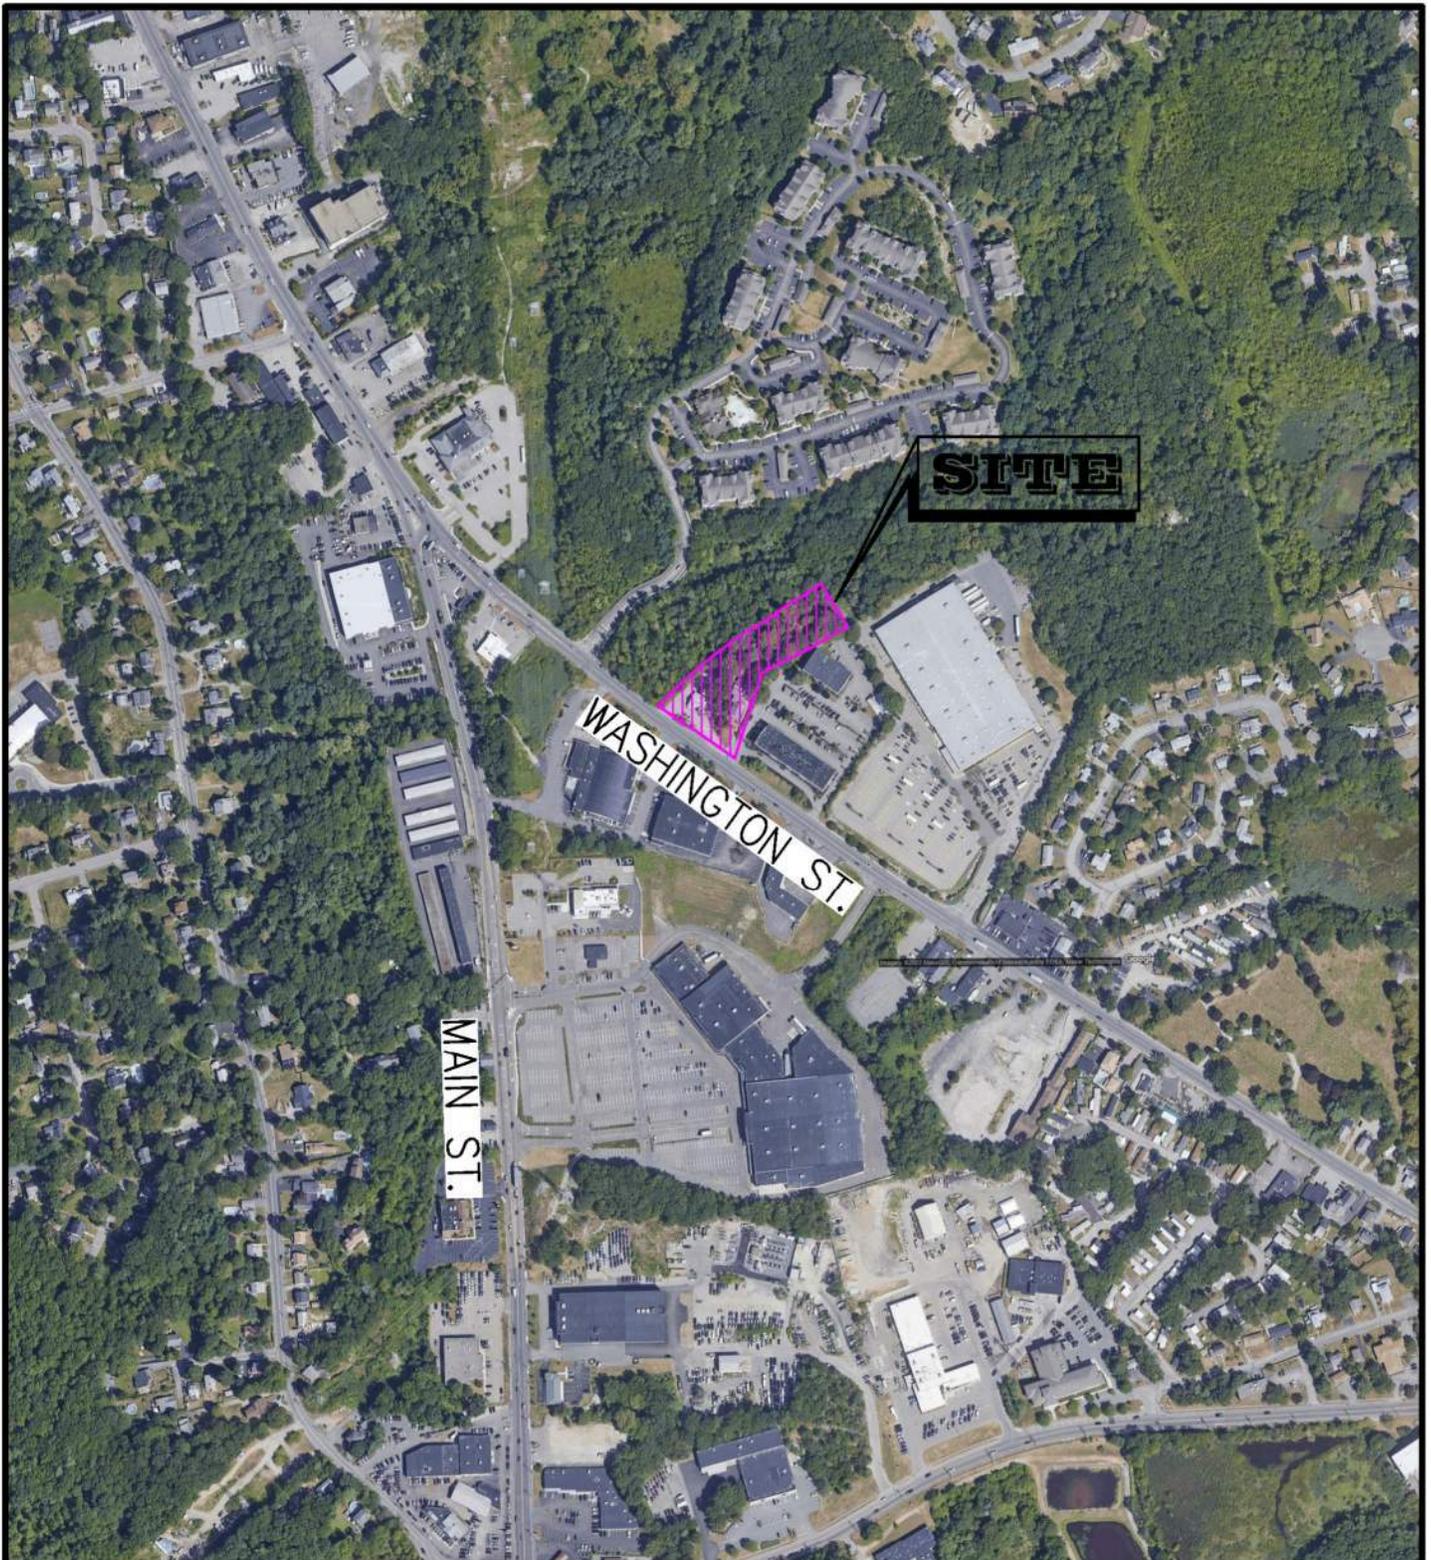


FIGURE - 5



Google Earth Imagery
Copyright 2017

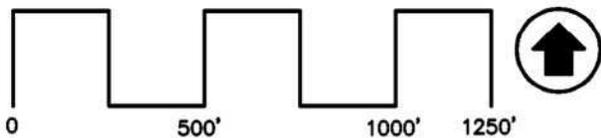


Assinippi Office Park
150 Longwater Drive, Suite 101
Norwell, MA 02061
P: 781.792.3900
F: 781.792.0333
www.mckeng.com

**NATIONAL HERITAGE AND
ENDANGERED SPECIES MAP**
550 WASHINGTON STREET
APN 330-3
WEYMOUTH, MASSACHUSETTS

APPENDIX A

Pre-Development Condition

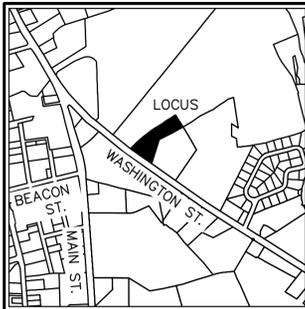

LOCUS MAP
Not to Scale

SURVEY NOTES:

- LOCUS IS SHOWN AS PARCEL NUMBER 29-330-3 ON THE TOWN OF WEYMOUTH ASSESSORS MAPS.
- DEED TO LOCUS IS RECORDED IN THE NORFOLK COUNTY REGISTRY OF DEEDS AT BOOK 37348, PAGE 337.
- THIS SURVEY WAS MADE ON THE GROUND IN SEPTEMBER OF 2019 BY CAVANARO CONSULTING, INC.
- ELEVATIONS SHOWN ARE REFERENCED TO THE NORTH AMERICAN VERTICAL DATUM (NAVD) OF 1988
- WETLAND RESOURCE AREAS WERE DELINEATED BY SOUTH RIVER ENVIRONMENTAL ON SEPTEMBER 24, 2019.
- LOCUS IS ZONED LIMITED BUSINESS (B-1)
MINIMUM SETBACK REQUIREMENTS:
FRONT YARD 30'
SIDE YARD 10'
REAR YARD 10'
- LOCUS IS SITUATED IN ZONE X AS SHOWN ON F.I.R.M. No 25021C0229E, EFFECTIVE JULY 17, 2012.
- LOCUS IS LOCATED IN A DEP ZONE 2 OR TOWN OF WEYMOUTH WATERSHED PROTECTION DISTRICT.
- UTILITY INFORMATION FROM ABOVE GROUND OBSERVED EVIDENCE IN CONJUNCTION WITH DIG SAFE MARKINGS AND RECORD PLANS. THE LAND SURVEYOR MAKES NO GUARANTEES THAT THE UNDERGROUND UTILITIES SHOWN HEREON COMPRISE ALL SUCH UTILITIES IN THE AREA, EITHER IN SERVICE OR ABANDONED. THE LAND SURVEYOR FURTHER DOES NOT WARRANT THAT THE UNDERGROUND UTILITIES SHOWN ARE IN THE EXACT LOCATION INDICATED. BEFORE CONSTRUCTION CALL DIG SAFE SYSTEMS, INC. AT 1-888-344-7233.
- PLAN REFERENCES:
PB 15088 PC 66
15393 569
37348 337
L.C. PLAN NO. 35395A
L.C. PLAN NO. 29909A
L.C. PLAN NO. 26233C

SOIL KEY

SOIL CLASSIFICATION	DESCRIPTION	HYDROLOGIC SOIL GROUP
52	FREETOWN MUCK, 0 - 1 PERCENT SLOPES	B/D
602	URBAN LAND, 0 - 15 PERCENT SLOPES	N/A

LEGEND

- LIMIT OF WATERSHED
- TIME OF CONCENTRATION FLOW PATH
- LIMIT OF NRCS SOIL MAPPING

ABBREVIATIONS

FFE	FIRST FLOOR ELEVATION
BIT CONC.	BITUMINOUS CONCRETE
PAVEMENT	
CB	CAPE COD BERM
EP	EDGE OF PAVEMENT
BC	BITUMINOUS CONCRETE CURB
(AM)	AS MEASURED
RET	WALL RETAINING WALL
CONC.	CONCRETE
RCP	REINFORCED CONCRETE PIPE
VCC	VERTICAL GRANITE CURB
ETW	EDGE OF TRAVEL WAY
MTL	METAL BERM
VCC	VERTICAL CONCRETE CURB
CMP	CORRUGATED METAL PIPE

LEGEND

SURVEY SYMBOLS

- REBAR
- ANGLE IRON
- CONCRETE BOUND WITH DRILL HOLE
- STONE BOUND
- SB/DH
- STONE BOUND

UTILITY SYMBOLS

- CHIMNEY
- ELECTRIC HAND HOLE
- GUY POLE
- GUY WIRE
- HVAC UNIT
- BUILDING LIGHT W/MAST
- BUILDING LIGHT TRANSFORMER
- WATER GATE
- EXHAUST VENT
- AIR VENT
- DRAINAGE SUMP
- EMH
- ELECTRIC MANHOLE
- SMH
- SEWER MANHOLE
- DMH
- DRAIN MANHOLE
- TMH
- TELEPHONE MANHOLE
- CBN
- DRAINAGE CATCH BASIN
- DOOR WAY THRESHOLD
- HYDRANT
- POST INDICATOR VALVE
- UTILITY POLE
- YARD LIGHT

LINE DESIGNATORS

- WATER MAIN
- HANDRAIL
- JERSEY BARRIER
- GUARD RAIL
- OVERHEAD WIRES
- GAS LINE
- WATER SERVICE
- UNDERGROUND ELECTRIC
- STORM DRAIN LINE
- SANITARY SEWER LINE
- DRAINAGE SWALE
- CHAIN LINK FENCE

BY	APP	DATE	DESCRIPTION



PRE-DEVELOPMENT WATERSHED PLAN
550-560 WASHINGTON STREET
(APN 29-330-3)
WEYMOUTH, MASSACHUSETTS

PROFESSIONAL SURVEYOR:



APPLICANT:
UNION REALTY TRUST
560 WASHINGTON STREET
WEYMOUTH, MASSACHUSETTS

DRAWN BY: ESS
DESIGNED BY: ESS
CHECKED BY: RLS
APPROVED BY: R/JH
DATE: MARCH 24, 2023
SCALE: 1" = 20'
PROJECT NO.: 222-182
DWG. TITLE:

PRE-DEV. WATERSHED PLAN

DWG. NO.: **WS-1**

NOT FOR CONSTRUCTION

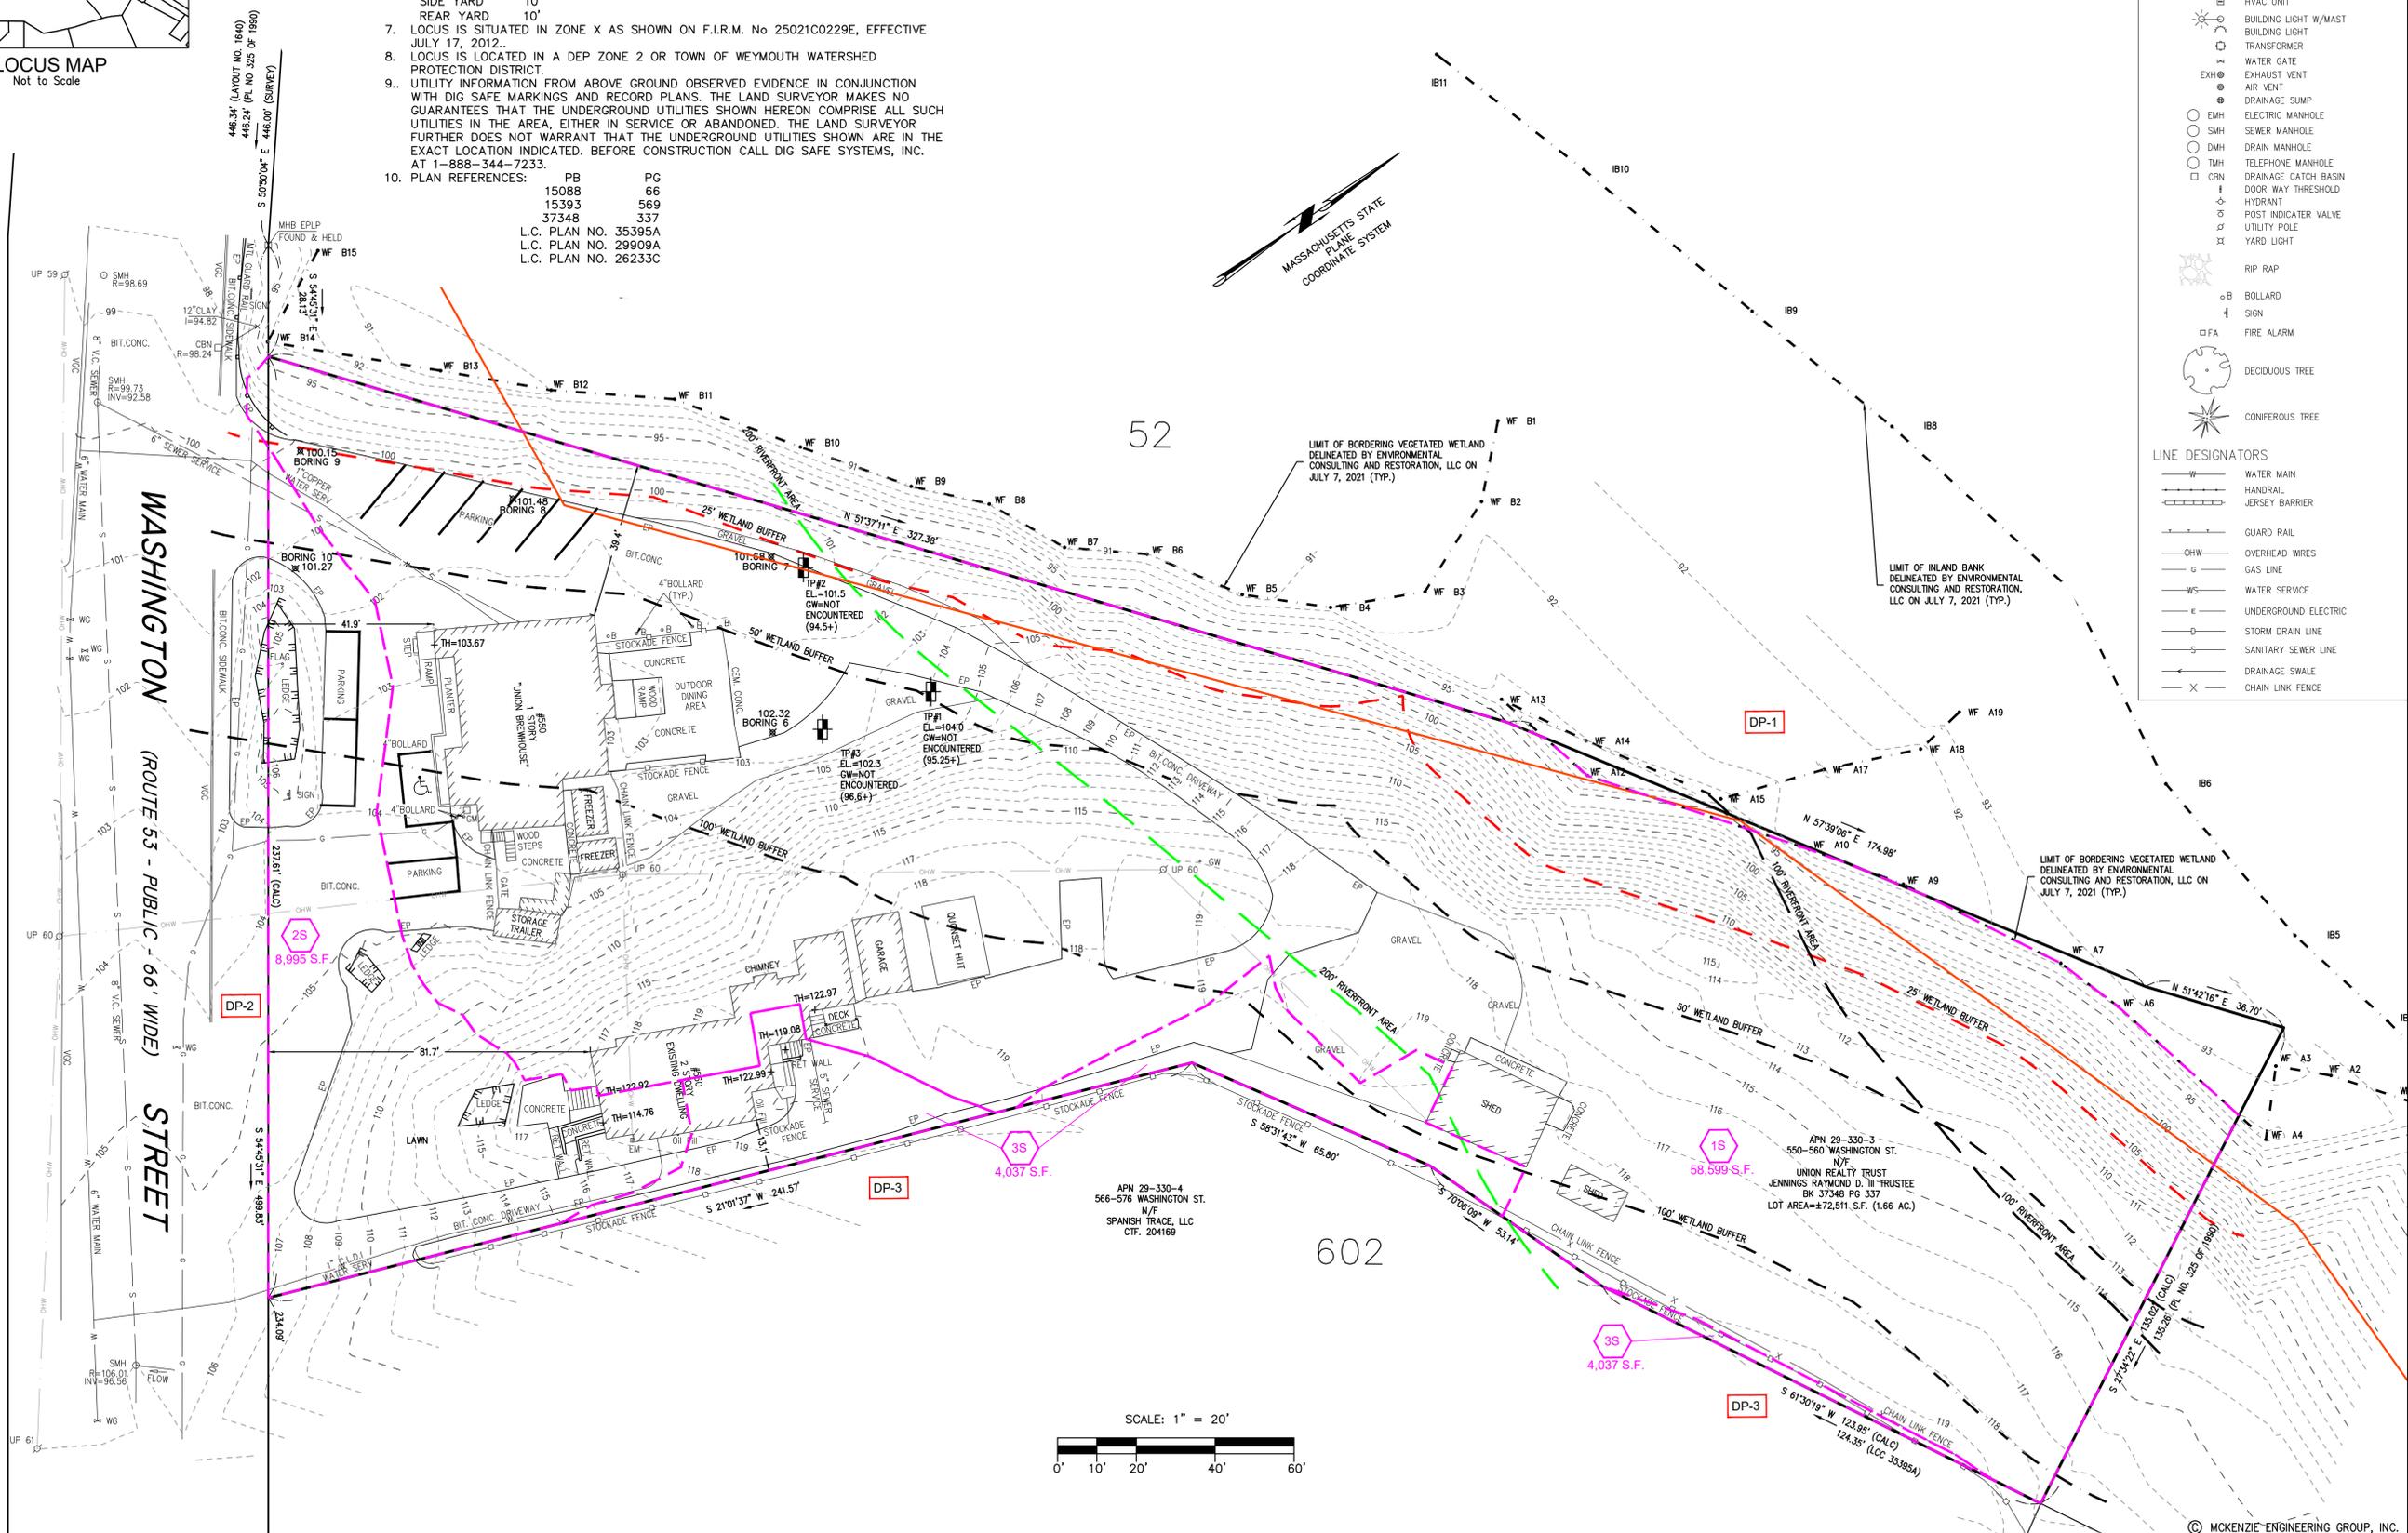



CENTRAL SITE



WETLAND



FRONT SITE





FRONT PROPERTY
LINE/WASHINGTON
ST.



SOUTH SITE



SOUTHERN
PROPERTY LINE



222-182 PRE DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Printed 3/6/2023

Page 2

Rainfall Events Listing

Event#	Event Name	Storm Type	Curve	Mode	Duration (hours)	B/B	Depth (inches)	AMC
1	2-Year	Type III 24-hr		Default	24.00	1	3.31	2
2	10-Year	Type III 24-hr		Default	24.00	1	4.90	2
3	25-Year	Type III 24-hr		Default	24.00	1	6.14	2
4	100-Year	Type III 24-hr		Default	24.00	1	8.65	2

222-182 PRE DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Printed 3/6/2023

Page 3

Area Listing (all nodes)

Area (acres)	CN	Description (subcatchment-numbers)
0.133	74	>75% Grass cover, Good, HSG C (1S, 2S, 3S)
0.254	87	Dirt roads, HSG C (1S)
0.092	96	Gravel surface, HSG C (1S, 3S)
0.426	98	Paved parking, HSG C (1S, 2S, 3S)
0.116	98	Roofs, HSG C (1S, 2S, 3S)
0.623	70	Woods, Good, HSG C (1S, 2S, 3S)
1.644	84	TOTAL AREA

222-182 PRE DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Printed 3/6/2023

Page 4

Soil Listing (all nodes)

Area (acres)	Soil Group	Subcatchment Numbers
0.000	HSG A	
0.000	HSG B	
1.644	HSG C	1S, 2S, 3S
0.000	HSG D	
0.000	Other	
1.644		TOTAL AREA

222-182 PRE DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Printed 3/6/2023

Page 5

Ground Covers (all nodes)

HSG-A (acres)	HSG-B (acres)	HSG-C (acres)	HSG-D (acres)	Other (acres)	Total (acres)	Ground Cover	Subcatchment Numbers
0.000	0.000	0.133	0.000	0.000	0.133	>75% Grass cover, Good	1S, 2S, 3S
0.000	0.000	0.254	0.000	0.000	0.254	Dirt roads	1S
0.000	0.000	0.092	0.000	0.000	0.092	Gravel surface	1S, 3S
0.000	0.000	0.426	0.000	0.000	0.426	Paved parking	1S, 2S, 3S
0.000	0.000	0.116	0.000	0.000	0.116	Roofs	1S, 2S, 3S
0.000	0.000	0.623	0.000	0.000	0.623	Woods, Good	1S, 2S, 3S
0.000	0.000	1.644	0.000	0.000	1.644	TOTAL AREA	

222-182 PRE DEVELOPMENT

Type III 24-hr 2-Year Rainfall=3.31"

Prepared by McKenzie Engineering Group, Inc.

Printed 3/6/2023

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Page 6

Time span=5.00-48.00 hrs, dt=0.05 hrs, 861 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

Subcatchment1S: CENTRAL SITE Runoff Area=58,599 sf 28.11% Impervious Runoff Depth=1.70"
Tc=6.0 min CN=83 Runoff=2.63 cfs 0.191 af

Subcatchment2S: FRONT SITE Runoff Area=8,995 sf 57.60% Impervious Runoff Depth=2.10"
Tc=6.0 min CN=88 Runoff=0.49 cfs 0.036 af

Subcatchment3S: SOUTH SITE Runoff Area=4,037 sf 47.83% Impervious Runoff Depth=2.01"
Tc=6.0 min CN=87 Runoff=0.21 cfs 0.016 af

Reach DP-1: WETLAND Inflow=2.63 cfs 0.191 af
Outflow=2.63 cfs 0.191 af

Reach DP-2: FRONT PROPERTY LINE/WASHINGTONST. Inflow=0.49 cfs 0.036 af
Outflow=0.49 cfs 0.036 af

Reach DP-3: SOUTHERN PROPERTY LINE Inflow=0.21 cfs 0.016 af
Outflow=0.21 cfs 0.016 af

Total Runoff Area = 1.644 ac Runoff Volume = 0.242 af Average Runoff Depth = 1.77"
67.08% Pervious = 1.103 ac 32.92% Impervious = 0.541 ac

222-182 PRE DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Type III 24-hr 2-Year Rainfall=3.31"

Printed 3/6/2023

Page 7

Summary for Subcatchment 1S: CENTRAL SITE

Runoff = 2.63 cfs @ 12.09 hrs, Volume= 0.191 af, Depth= 1.70"
 Routed to Reach DP-1 : WETLAND


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs
 Type III 24-hr 2-Year Rainfall=3.31"

Area (sf)	CN	Description
4,387	98	Roofs, HSG C
12,085	98	Paved parking, HSG C
3,429	96	Gravel surface, HSG C
11,084	87	Dirt roads, HSG C
2,268	74	>75% Grass cover, Good, HSG C
25,346	70	Woods, Good, HSG C
58,599	83	Weighted Average
42,127		71.89% Pervious Area
16,472		28.11% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, DIRECT ENTRY

Subcatchment 1S: CENTRAL SITE

Hydrograph

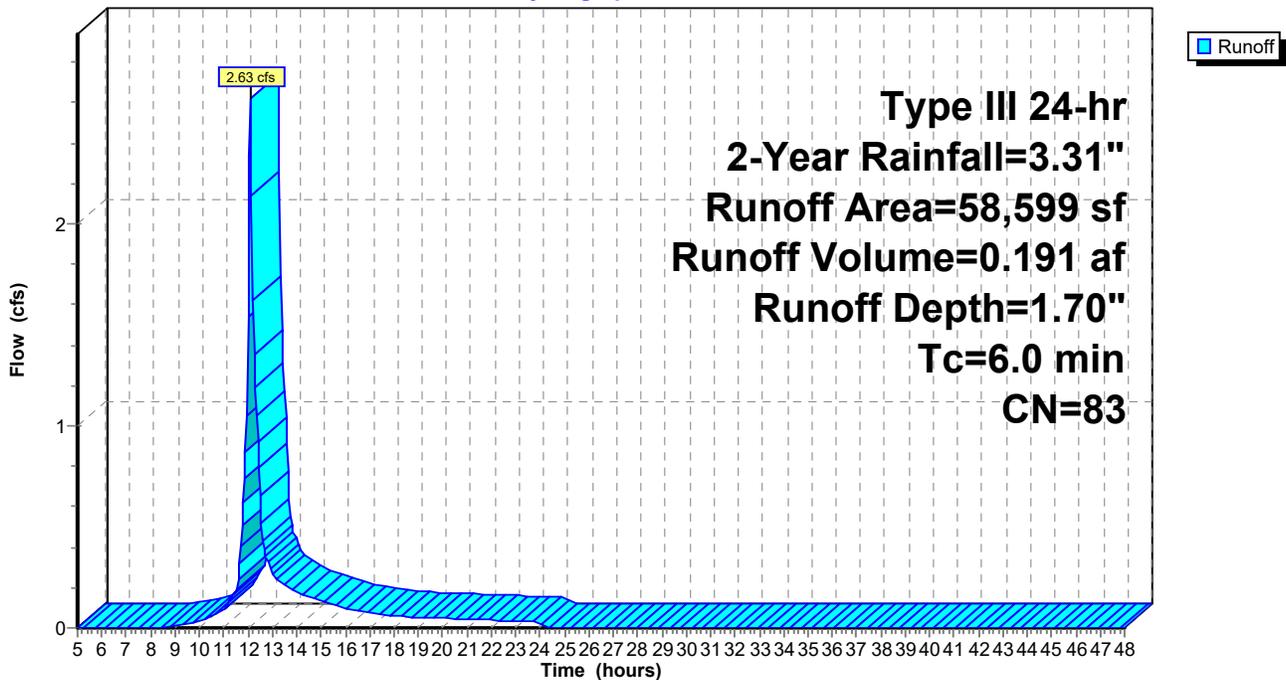

222-182 PRE DEVELOPMENT

Type III 24-hr 2-Year Rainfall=3.31"

Prepared by McKenzie Engineering Group, Inc.

Printed 3/6/2023

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Page 8

Summary for Subcatchment 2S: FRONT SITE

Runoff = 0.49 cfs @ 12.09 hrs, Volume= 0.036 af, Depth= 2.10"

Routed to Reach DP-2 : FRONT PROPERTY LINE/WASHINGTON ST.


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs
Type III 24-hr 2-Year Rainfall=3.31"

Area (sf)	CN	Description
270	98	Roofs, HSG C
4,911	98	Paved parking, HSG C
3,383	74	>75% Grass cover, Good, HSG C
431	70	Woods, Good, HSG C
8,995	88	Weighted Average
3,814		42.40% Pervious Area
5,181		57.60% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, DIRECT ENTRY

Subcatchment 2S: FRONT SITE

Hydrograph

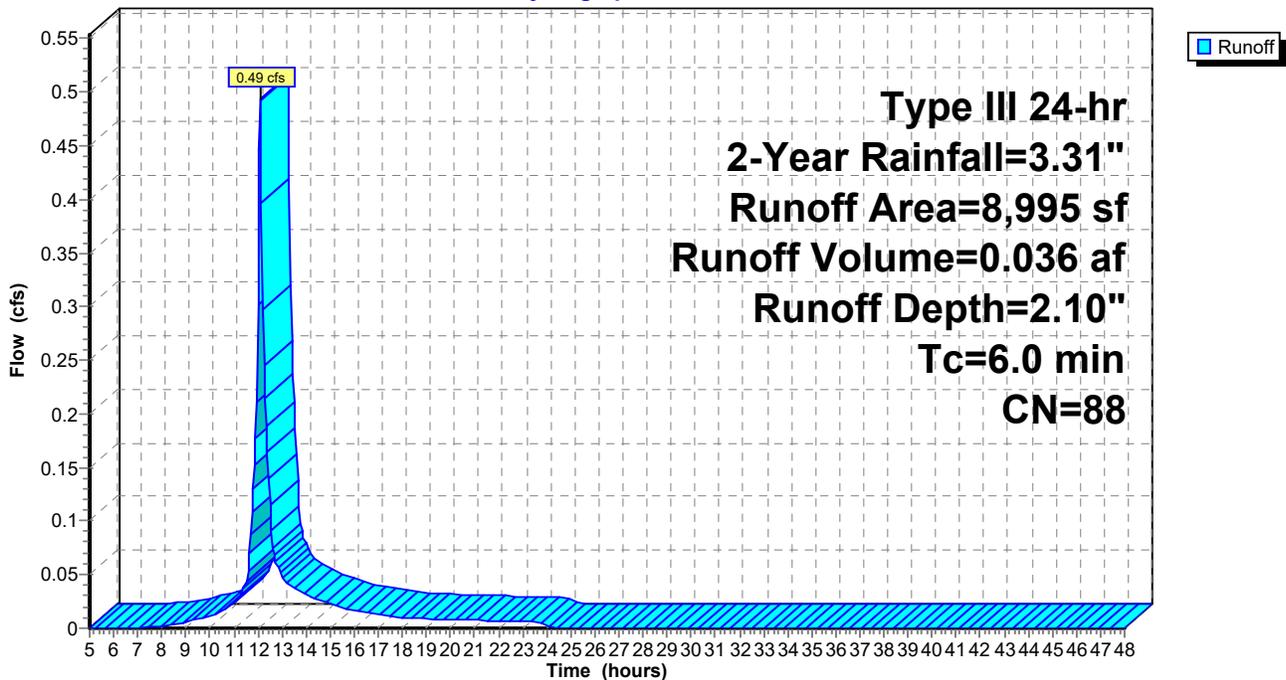

222-182 PRE DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Type III 24-hr 2-Year Rainfall=3.31"

Printed 3/6/2023

Page 9

Summary for Subcatchment 3S: SOUTH SITE

Runoff = 0.21 cfs @ 12.09 hrs, Volume= 0.016 af, Depth= 2.01"

Routed to Reach DP-3 : SOUTHERN PROPERTY LINE


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs
Type III 24-hr 2-Year Rainfall=3.31"

Area (sf)	CN	Description
387	98	Roofs, HSG C
1,544	98	Paved parking, HSG C
598	96	Gravel surface, HSG C
151	74	>75% Grass cover, Good, HSG C
1,357	70	Woods, Good, HSG C
4,037	87	Weighted Average
2,106		52.17% Pervious Area
1,931		47.83% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, DIRECT ENTRY

Subcatchment 3S: SOUTH SITE

Hydrograph

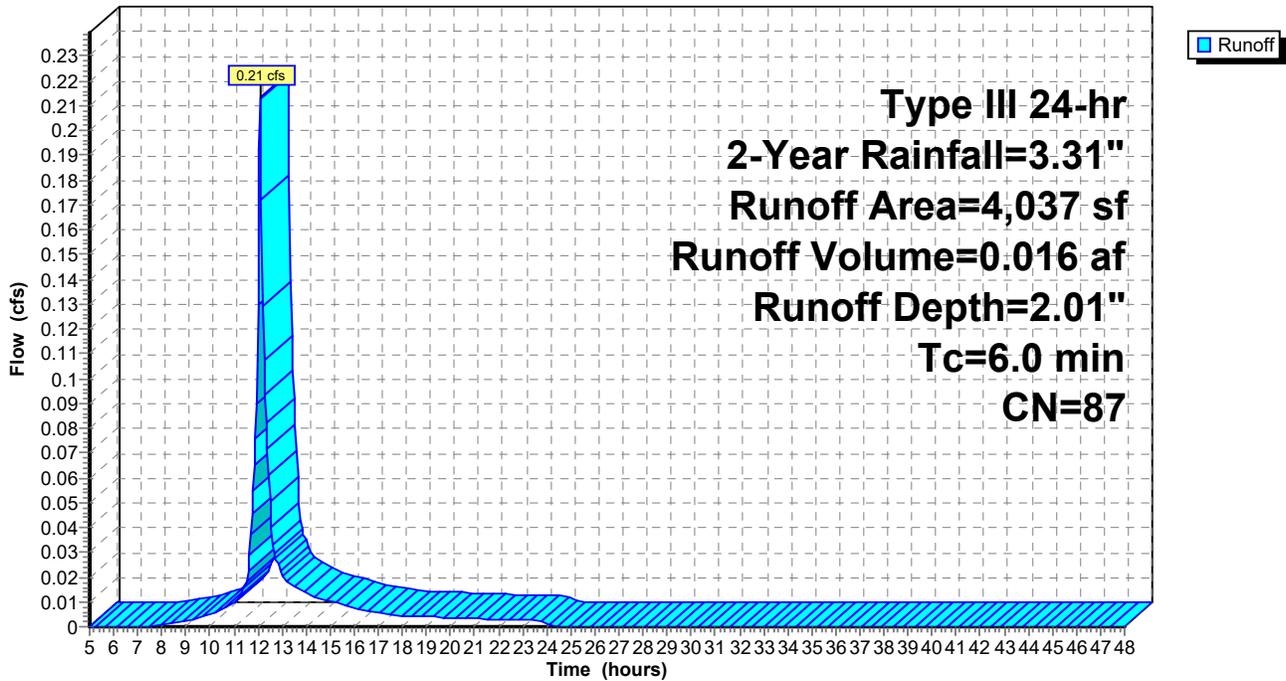

Summary for Reach DP-1: WETLAND


[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 1.345 ac, 28.11% Impervious, Inflow Depth = 1.70" for 2-Year event
Inflow = 2.63 cfs @ 12.09 hrs, Volume= 0.191 af
Outflow = 2.63 cfs @ 12.09 hrs, Volume= 0.191 af, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs

Reach DP-1: WETLAND

Hydrograph

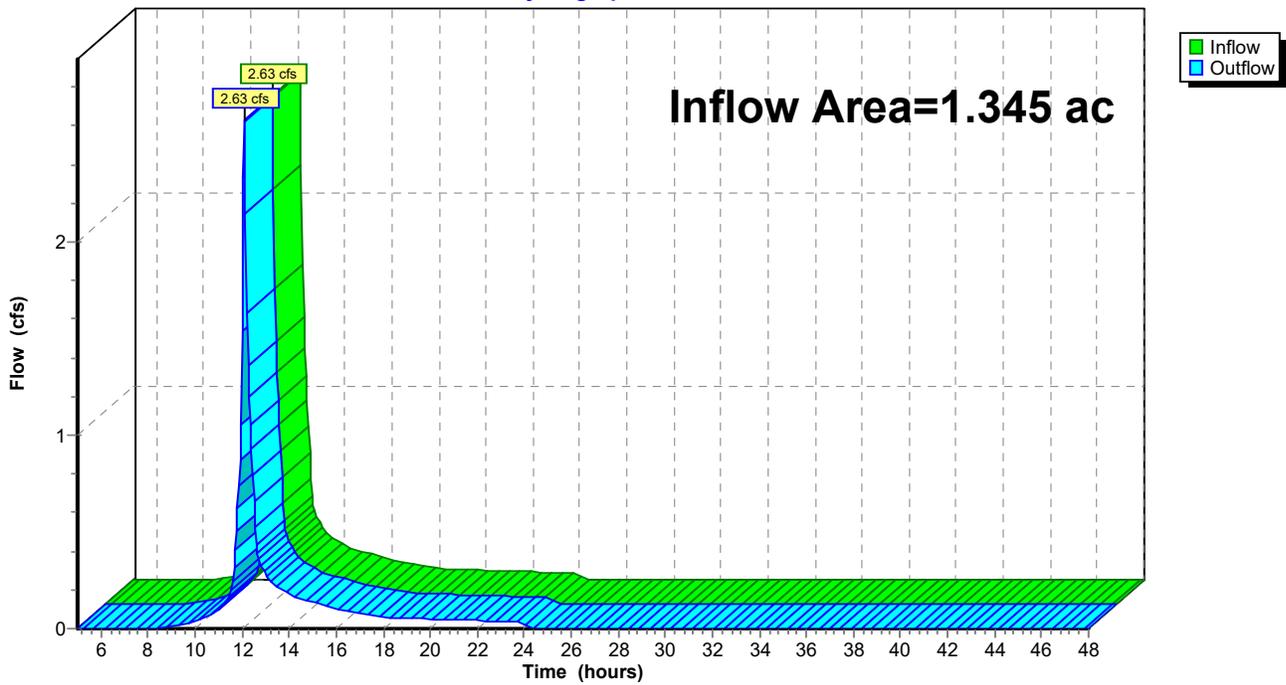

Summary for Reach DP-2: FRONT PROPERTY LINE/WASHINGTON ST.


[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 0.206 ac, 57.60% Impervious, Inflow Depth = 2.10" for 2-Year event
Inflow = 0.49 cfs @ 12.09 hrs, Volume= 0.036 af
Outflow = 0.49 cfs @ 12.09 hrs, Volume= 0.036 af, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs

Reach DP-2: FRONT PROPERTY LINE/WASHINGTON ST.

Hydrograph

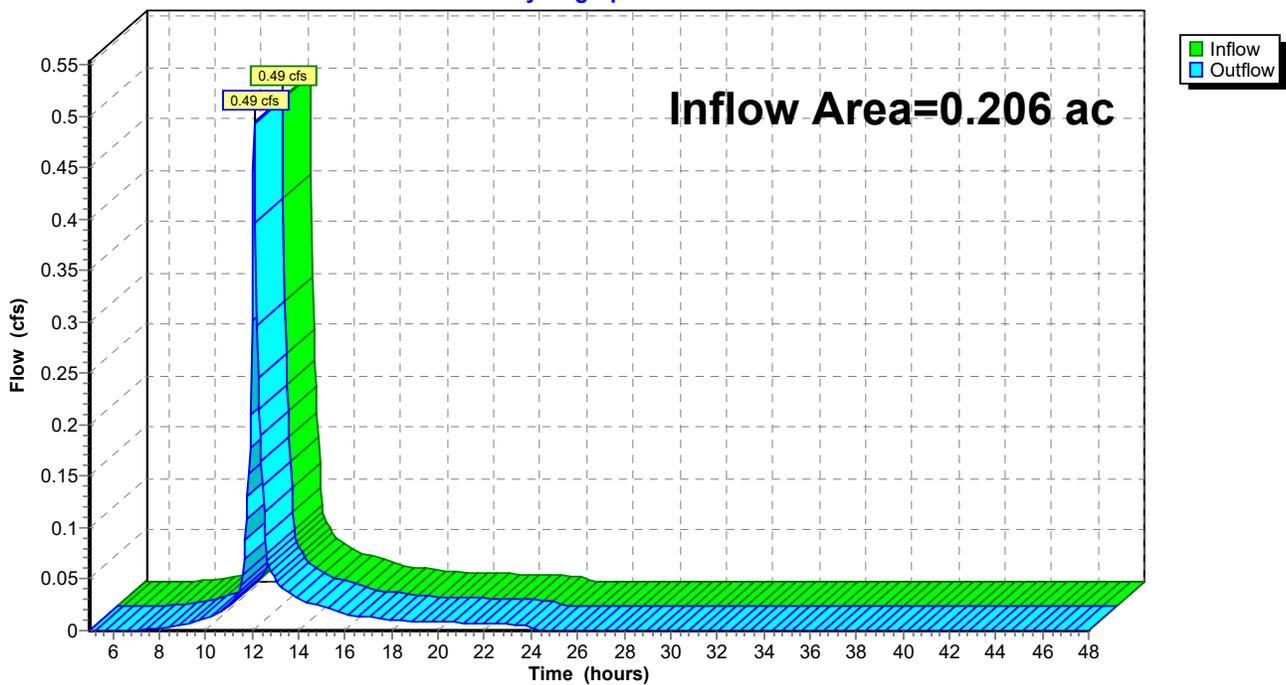

Summary for Reach DP-3: SOUTHERN PROPERTY LINE


[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 0.093 ac, 47.83% Impervious, Inflow Depth = 2.01" for 2-Year event
Inflow = 0.21 cfs @ 12.09 hrs, Volume= 0.016 af
Outflow = 0.21 cfs @ 12.09 hrs, Volume= 0.016 af, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs

Reach DP-3: SOUTHERN PROPERTY LINE

Hydrograph

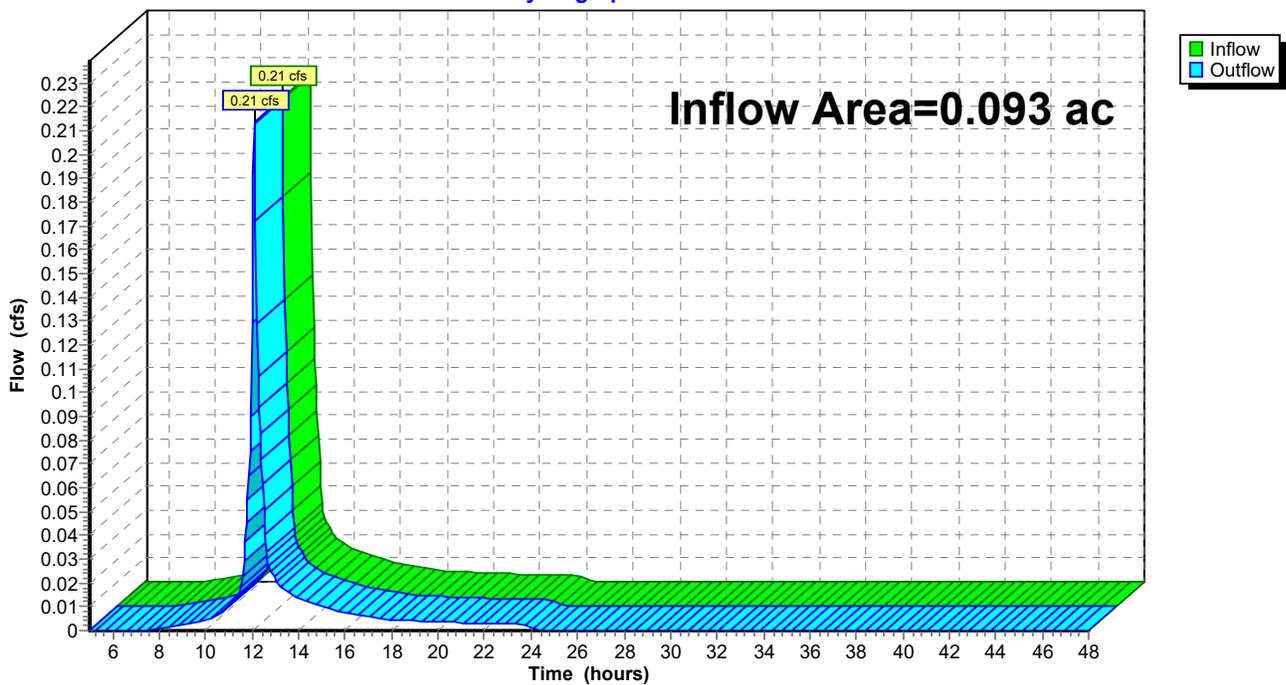

222-182 PRE DEVELOPMENT

Type III 24-hr 10-Year Rainfall=4.90"

Prepared by McKenzie Engineering Group, Inc.

Printed 3/6/2023

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Page 13

Time span=5.00-48.00 hrs, dt=0.05 hrs, 861 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

Subcatchment1S: CENTRAL SITE	Runoff Area=58,599 sf 28.11% Impervious	Runoff Depth=3.08"
	Tc=6.0 min CN=83	Runoff=4.74 cfs 0.346 af
Subcatchment2S: FRONT SITE	Runoff Area=8,995 sf 57.60% Impervious	Runoff Depth>3.57"
	Tc=6.0 min CN=88	Runoff=0.83 cfs 0.062 af
Subcatchment3S: SOUTH SITE	Runoff Area=4,037 sf 47.83% Impervious	Runoff Depth=3.47"
	Tc=6.0 min CN=87	Runoff=0.36 cfs 0.027 af
Reach DP-1: WETLAND		Inflow=4.74 cfs 0.346 af
		Outflow=4.74 cfs 0.346 af
Reach DP-2: FRONT PROPERTY LINE/WASHINGTONST.		Inflow=0.83 cfs 0.062 af
		Outflow=0.83 cfs 0.062 af
Reach DP-3: SOUTHERN PROPERTY LINE		Inflow=0.36 cfs 0.027 af
		Outflow=0.36 cfs 0.027 af

Total Runoff Area = 1.644 ac Runoff Volume = 0.434 af Average Runoff Depth = 3.17"
67.08% Pervious = 1.103 ac 32.92% Impervious = 0.541 ac

222-182 PRE DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Type III 24-hr 10-Year Rainfall=4.90"

Printed 3/6/2023

Page 14

Summary for Subcatchment 1S: CENTRAL SITE

Runoff = 4.74 cfs @ 12.09 hrs, Volume= 0.346 af, Depth= 3.08"
 Routed to Reach DP-1 : WETLAND


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs
 Type III 24-hr 10-Year Rainfall=4.90"

Area (sf)	CN	Description
4,387	98	Roofs, HSG C
12,085	98	Paved parking, HSG C
3,429	96	Gravel surface, HSG C
11,084	87	Dirt roads, HSG C
2,268	74	>75% Grass cover, Good, HSG C
25,346	70	Woods, Good, HSG C
58,599	83	Weighted Average
42,127		71.89% Pervious Area
16,472		28.11% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, DIRECT ENTRY

Subcatchment 1S: CENTRAL SITE

Hydrograph

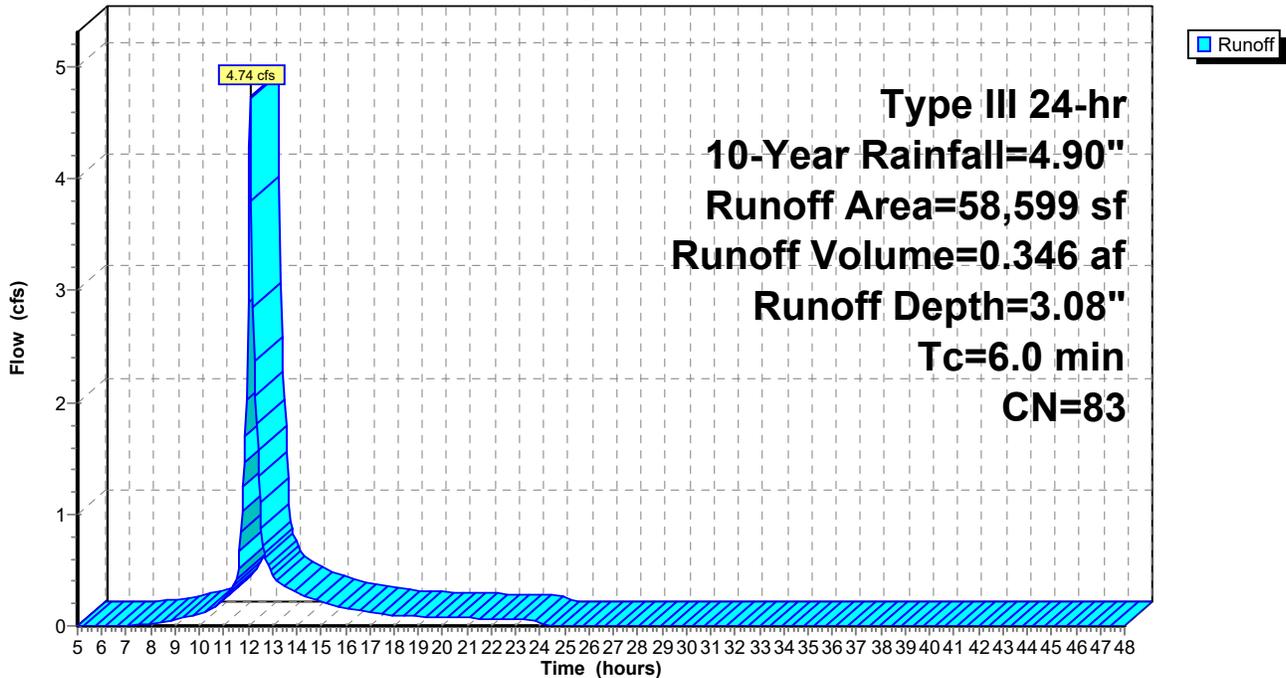

222-182 PRE DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Type III 24-hr 10-Year Rainfall=4.90"

Printed 3/6/2023

Page 15

Summary for Subcatchment 2S: FRONT SITE

Runoff = 0.83 cfs @ 12.09 hrs, Volume= 0.062 af, Depth> 3.57"

Routed to Reach DP-2 : FRONT PROPERTY LINE/WASHINGTON ST.


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs
Type III 24-hr 10-Year Rainfall=4.90"

Area (sf)	CN	Description
270	98	Roofs, HSG C
4,911	98	Paved parking, HSG C
3,383	74	>75% Grass cover, Good, HSG C
431	70	Woods, Good, HSG C
8,995	88	Weighted Average
3,814		42.40% Pervious Area
5,181		57.60% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, DIRECT ENTRY

Subcatchment 2S: FRONT SITE

Hydrograph

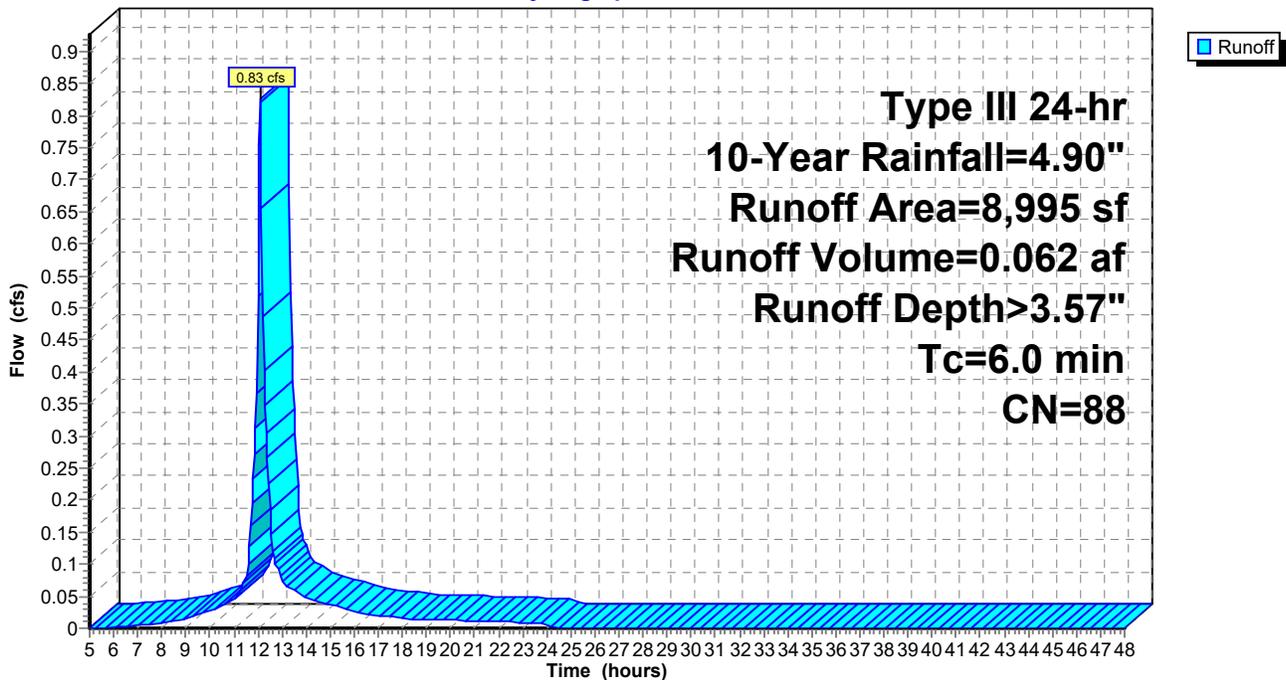

222-182 PRE DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Type III 24-hr 10-Year Rainfall=4.90"

Printed 3/6/2023

Page 16

Summary for Subcatchment 3S: SOUTH SITE

Runoff = 0.36 cfs @ 12.09 hrs, Volume= 0.027 af, Depth= 3.47"
 Routed to Reach DP-3 : SOUTHERN PROPERTY LINE


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs
 Type III 24-hr 10-Year Rainfall=4.90"

Area (sf)	CN	Description
387	98	Roofs, HSG C
1,544	98	Paved parking, HSG C
598	96	Gravel surface, HSG C
151	74	>75% Grass cover, Good, HSG C
1,357	70	Woods, Good, HSG C
4,037	87	Weighted Average
2,106		52.17% Pervious Area
1,931		47.83% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, DIRECT ENTRY

Subcatchment 3S: SOUTH SITE

Hydrograph

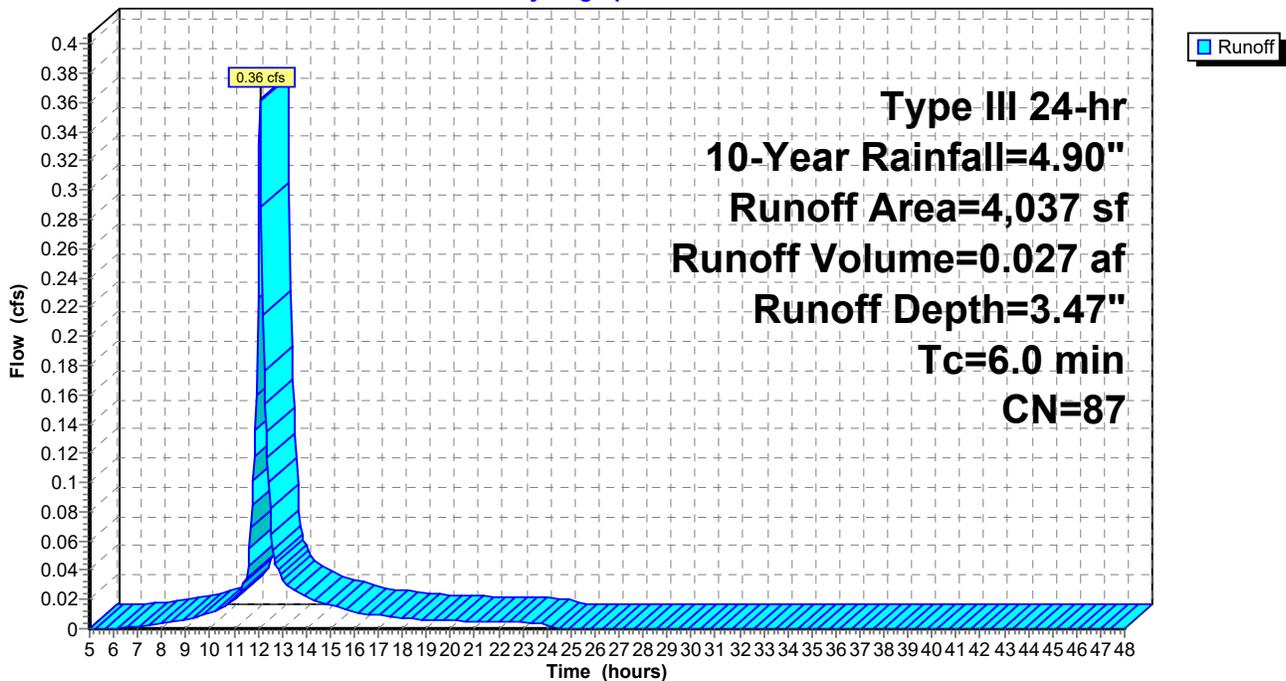

Summary for Reach DP-1: WETLAND


[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 1.345 ac, 28.11% Impervious, Inflow Depth = 3.08" for 10-Year event
Inflow = 4.74 cfs @ 12.09 hrs, Volume= 0.346 af
Outflow = 4.74 cfs @ 12.09 hrs, Volume= 0.346 af, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs

Reach DP-1: WETLAND

Hydrograph

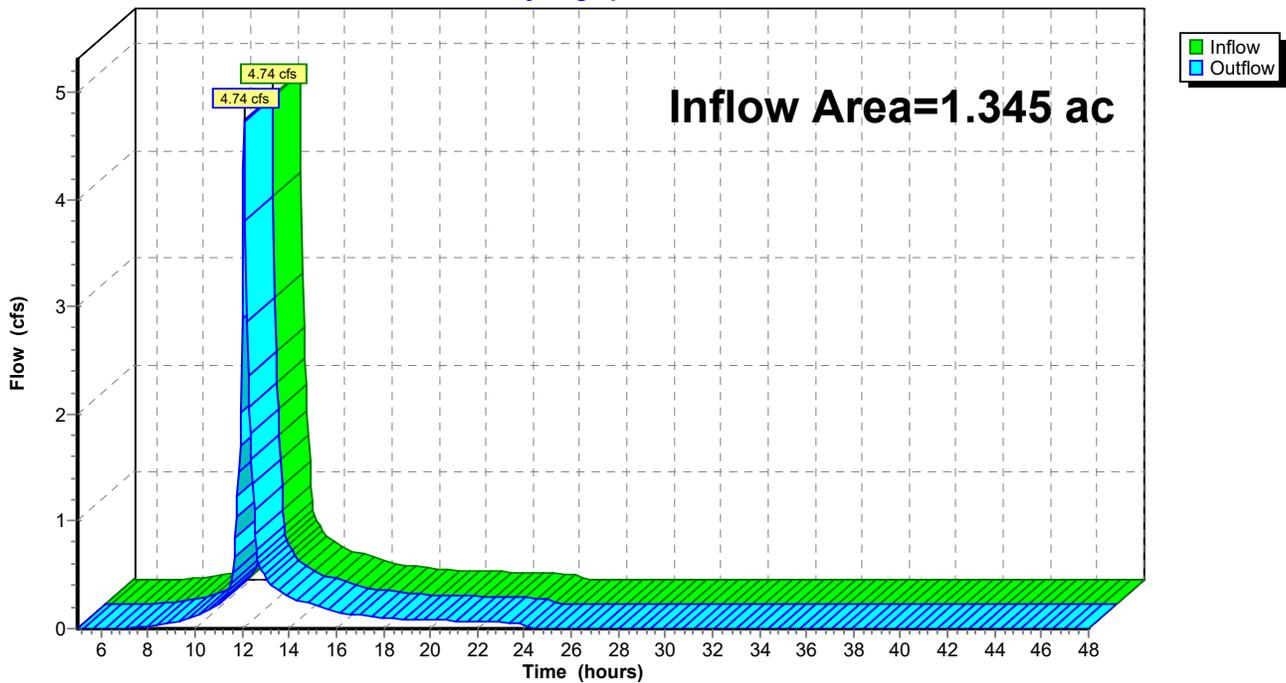

Summary for Reach DP-2: FRONT PROPERTY LINE/WASHINGTON ST.


[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 0.206 ac, 57.60% Impervious, Inflow Depth > 3.57" for 10-Year event
Inflow = 0.83 cfs @ 12.09 hrs, Volume= 0.062 af
Outflow = 0.83 cfs @ 12.09 hrs, Volume= 0.062 af, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs

Reach DP-2: FRONT PROPERTY LINE/WASHINGTON ST.

Hydrograph

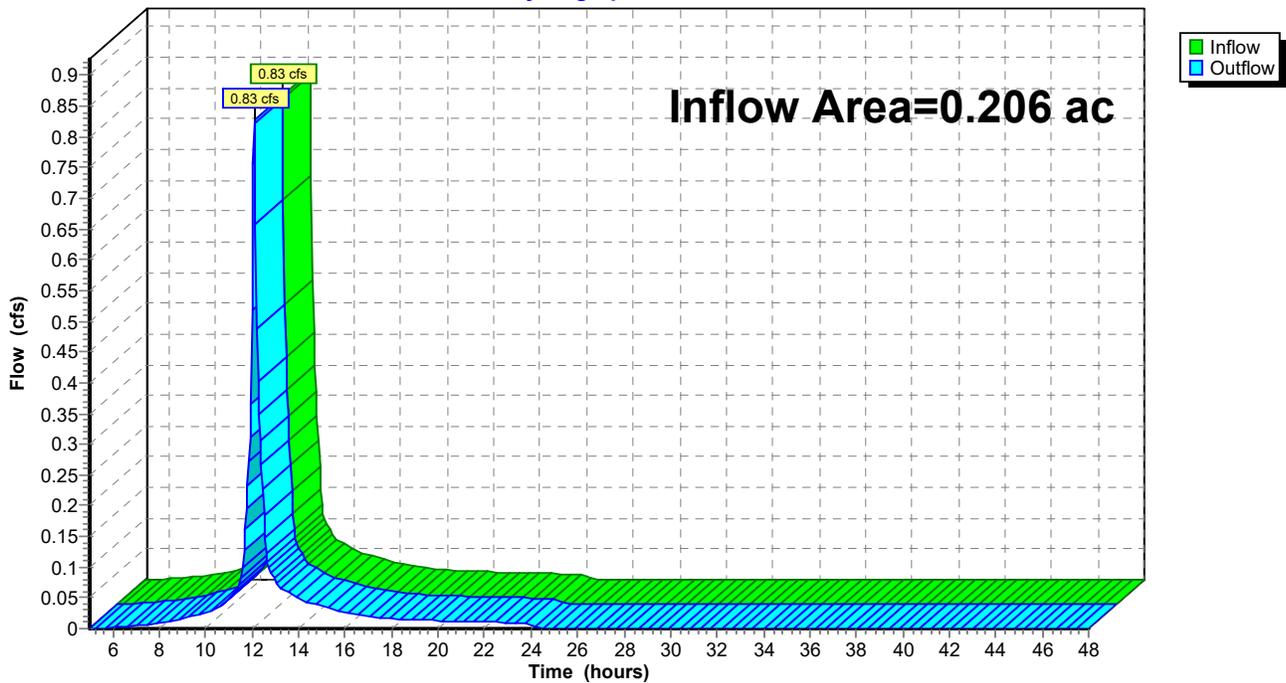

Summary for Reach DP-3: SOUTHERN PROPERTY LINE


[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 0.093 ac, 47.83% Impervious, Inflow Depth = 3.47" for 10-Year event
Inflow = 0.36 cfs @ 12.09 hrs, Volume= 0.027 af
Outflow = 0.36 cfs @ 12.09 hrs, Volume= 0.027 af, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs

Reach DP-3: SOUTHERN PROPERTY LINE

Hydrograph

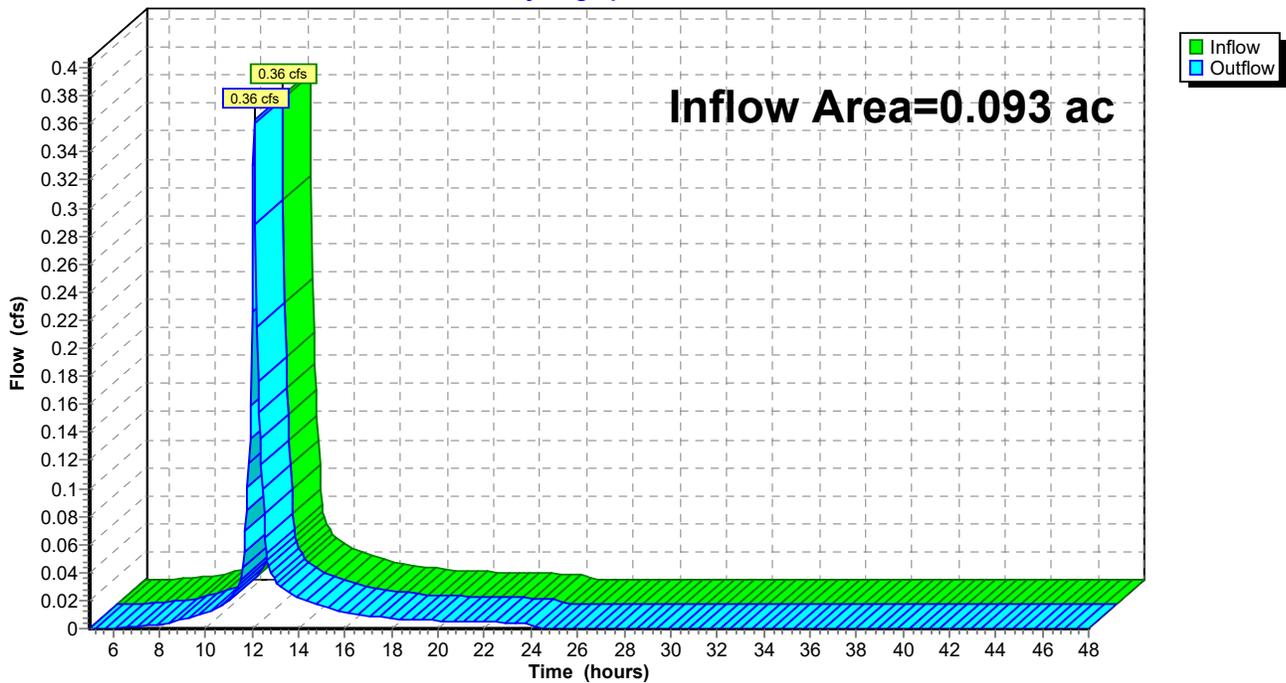

222-182 PRE DEVELOPMENT

Type III 24-hr 25-Year Rainfall=6.14"

Prepared by McKenzie Engineering Group, Inc.

Printed 3/6/2023

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Page 20

Time span=5.00-48.00 hrs, dt=0.05 hrs, 861 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

Subcatchment1S: CENTRAL SITE Runoff Area=58,599 sf 28.11% Impervious Runoff Depth=4.22"
Tc=6.0 min CN=83 Runoff=6.43 cfs 0.473 af

Subcatchment2S: FRONT SITE Runoff Area=8,995 sf 57.60% Impervious Runoff Depth>4.76"
Tc=6.0 min CN=88 Runoff=1.09 cfs 0.082 af

Subcatchment3S: SOUTH SITE Runoff Area=4,037 sf 47.83% Impervious Runoff Depth>4.65"
Tc=6.0 min CN=87 Runoff=0.48 cfs 0.036 af

Reach DP-1: WETLAND Inflow=6.43 cfs 0.473 af
Outflow=6.43 cfs 0.473 af

Reach DP-2: FRONT PROPERTY LINE/WASHINGTONST. Inflow=1.09 cfs 0.082 af
Outflow=1.09 cfs 0.082 af

Reach DP-3: SOUTHERN PROPERTY LINE Inflow=0.48 cfs 0.036 af
Outflow=0.48 cfs 0.036 af

Total Runoff Area = 1.644 ac Runoff Volume = 0.591 af Average Runoff Depth = 4.31"
67.08% Pervious = 1.103 ac 32.92% Impervious = 0.541 ac

222-182 PRE DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Type III 24-hr 25-Year Rainfall=6.14"

Printed 3/6/2023

Page 21

Summary for Subcatchment 1S: CENTRAL SITE

Runoff = 6.43 cfs @ 12.09 hrs, Volume= 0.473 af, Depth= 4.22"
 Routed to Reach DP-1 : WETLAND


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs
 Type III 24-hr 25-Year Rainfall=6.14"

Area (sf)	CN	Description
4,387	98	Roofs, HSG C
12,085	98	Paved parking, HSG C
3,429	96	Gravel surface, HSG C
11,084	87	Dirt roads, HSG C
2,268	74	>75% Grass cover, Good, HSG C
25,346	70	Woods, Good, HSG C
58,599	83	Weighted Average
42,127		71.89% Pervious Area
16,472		28.11% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, DIRECT ENTRY

Subcatchment 1S: CENTRAL SITE

Hydrograph

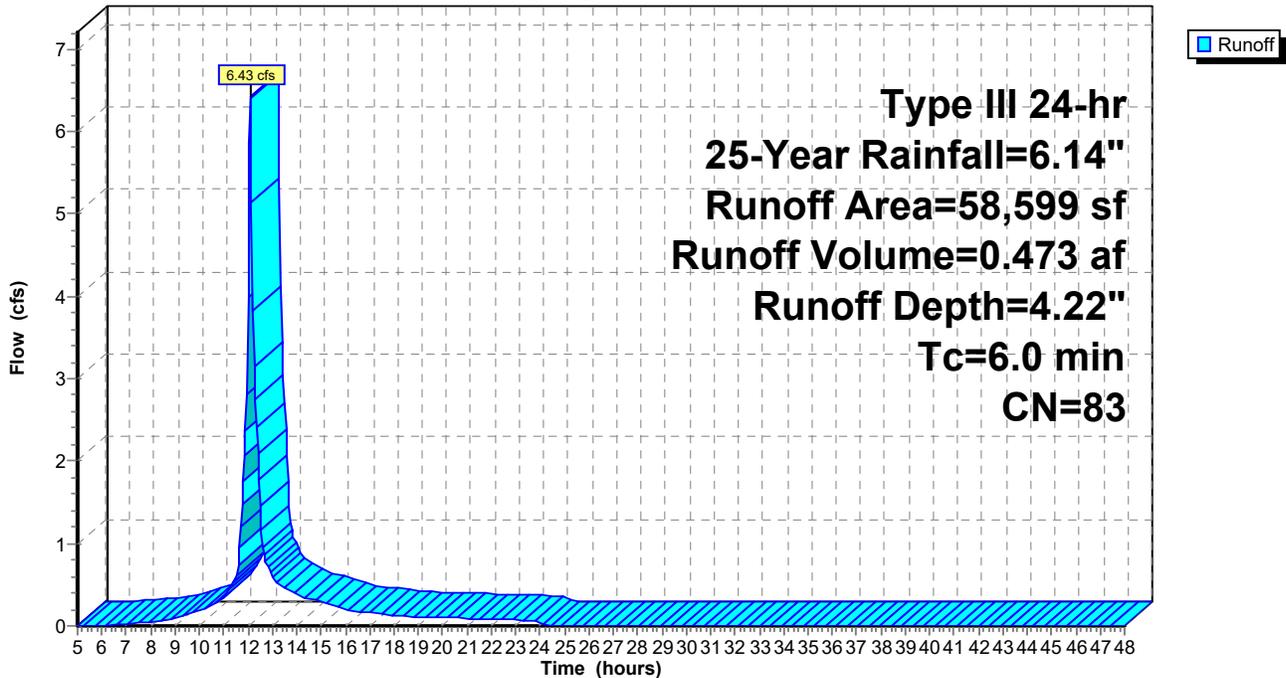

222-182 PRE DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Type III 24-hr 25-Year Rainfall=6.14"

Printed 3/6/2023

Page 22

Summary for Subcatchment 2S: FRONT SITE

Runoff = 1.09 cfs @ 12.09 hrs, Volume= 0.082 af, Depth> 4.76"

Routed to Reach DP-2 : FRONT PROPERTY LINE/WASHINGTON ST.


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs
Type III 24-hr 25-Year Rainfall=6.14"

Area (sf)	CN	Description
270	98	Roofs, HSG C
4,911	98	Paved parking, HSG C
3,383	74	>75% Grass cover, Good, HSG C
431	70	Woods, Good, HSG C
8,995	88	Weighted Average
3,814		42.40% Pervious Area
5,181		57.60% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, DIRECT ENTRY

Subcatchment 2S: FRONT SITE

Hydrograph

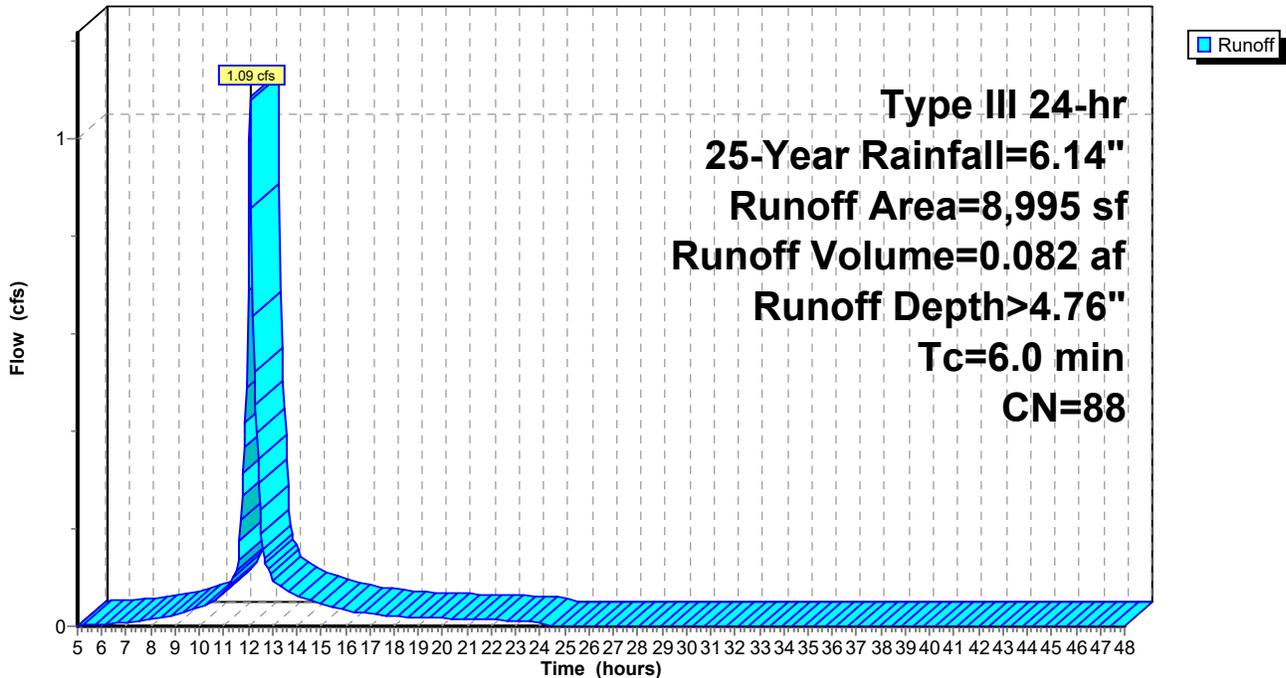

222-182 PRE DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Type III 24-hr 25-Year Rainfall=6.14"

Printed 3/6/2023

Page 23

Summary for Subcatchment 3S: SOUTH SITE

Runoff = 0.48 cfs @ 12.09 hrs, Volume= 0.036 af, Depth> 4.65"

Routed to Reach DP-3 : SOUTHERN PROPERTY LINE


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs
Type III 24-hr 25-Year Rainfall=6.14"

Area (sf)	CN	Description
387	98	Roofs, HSG C
1,544	98	Paved parking, HSG C
598	96	Gravel surface, HSG C
151	74	>75% Grass cover, Good, HSG C
1,357	70	Woods, Good, HSG C
4,037	87	Weighted Average
2,106		52.17% Pervious Area
1,931		47.83% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, DIRECT ENTRY

Subcatchment 3S: SOUTH SITE

Hydrograph

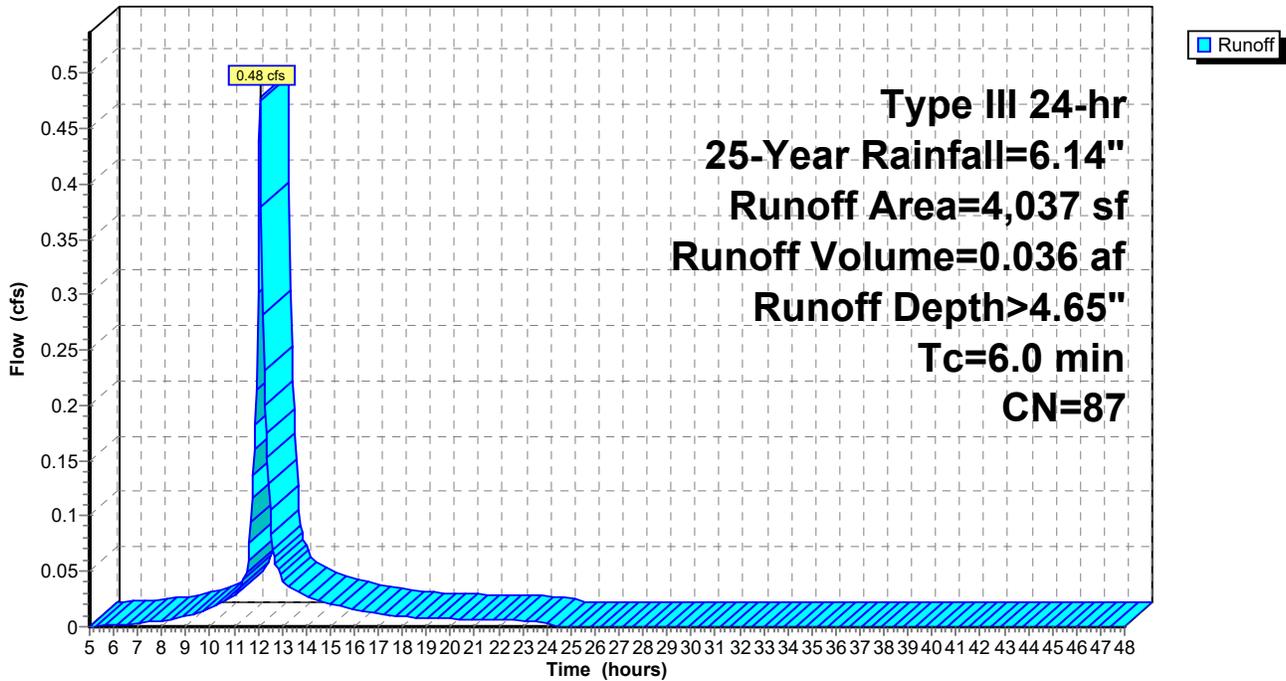

Summary for Reach DP-1: WETLAND


[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 1.345 ac, 28.11% Impervious, Inflow Depth = 4.22" for 25-Year event
Inflow = 6.43 cfs @ 12.09 hrs, Volume= 0.473 af
Outflow = 6.43 cfs @ 12.09 hrs, Volume= 0.473 af, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs

Reach DP-1: WETLAND

Hydrograph

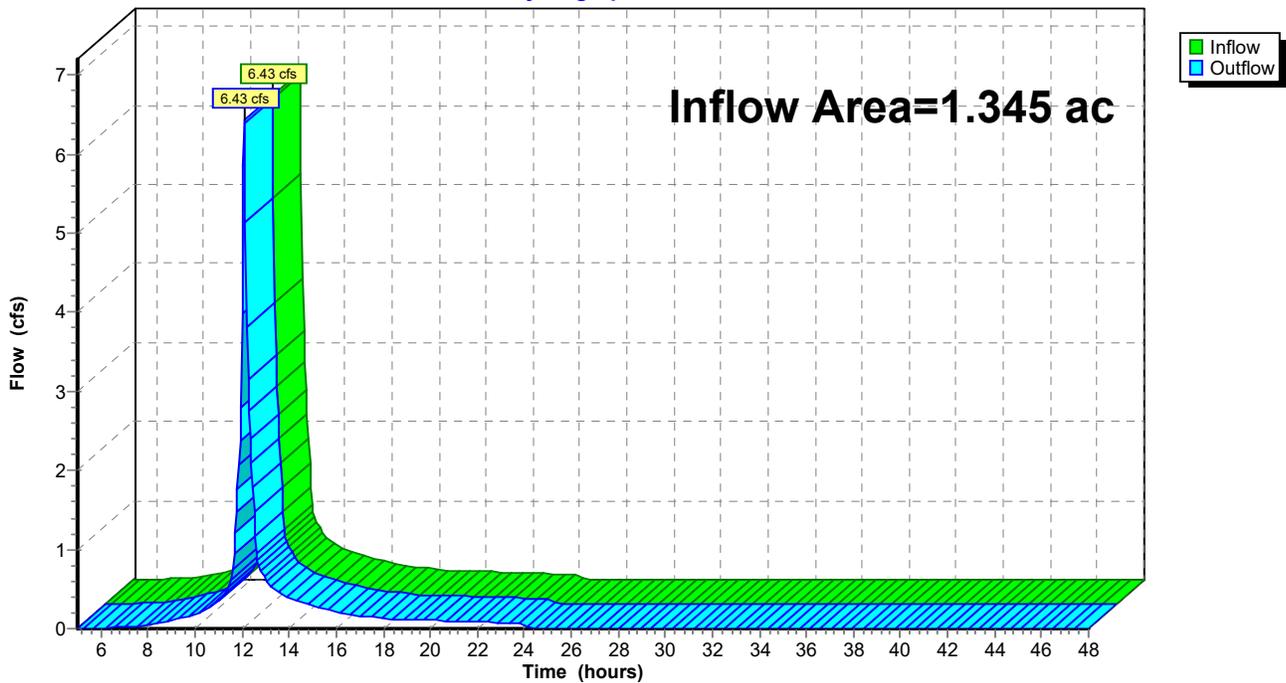

222-182 PRE DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Type III 24-hr 25-Year Rainfall=6.14"

Printed 3/6/2023

Page 25


Summary for Reach DP-2: FRONT PROPERTY LINE/WASHINGTON ST.

[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 0.206 ac, 57.60% Impervious, Inflow Depth > 4.76" for 25-Year event
Inflow = 1.09 cfs @ 12.09 hrs, Volume= 0.082 af
Outflow = 1.09 cfs @ 12.09 hrs, Volume= 0.082 af, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs

Reach DP-2: FRONT PROPERTY LINE/WASHINGTON ST.

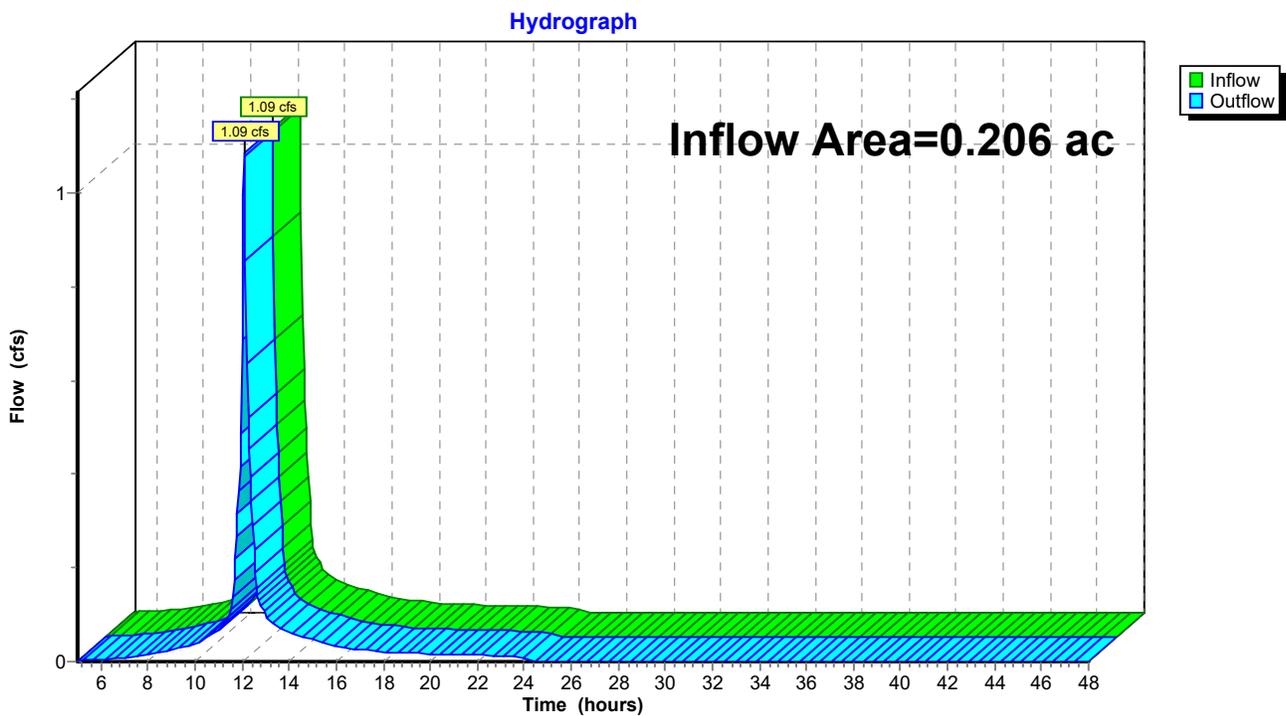

Summary for Reach DP-3: SOUTHERN PROPERTY LINE


[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 0.093 ac, 47.83% Impervious, Inflow Depth > 4.65" for 25-Year event
Inflow = 0.48 cfs @ 12.09 hrs, Volume= 0.036 af
Outflow = 0.48 cfs @ 12.09 hrs, Volume= 0.036 af, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs

Reach DP-3: SOUTHERN PROPERTY LINE

Hydrograph

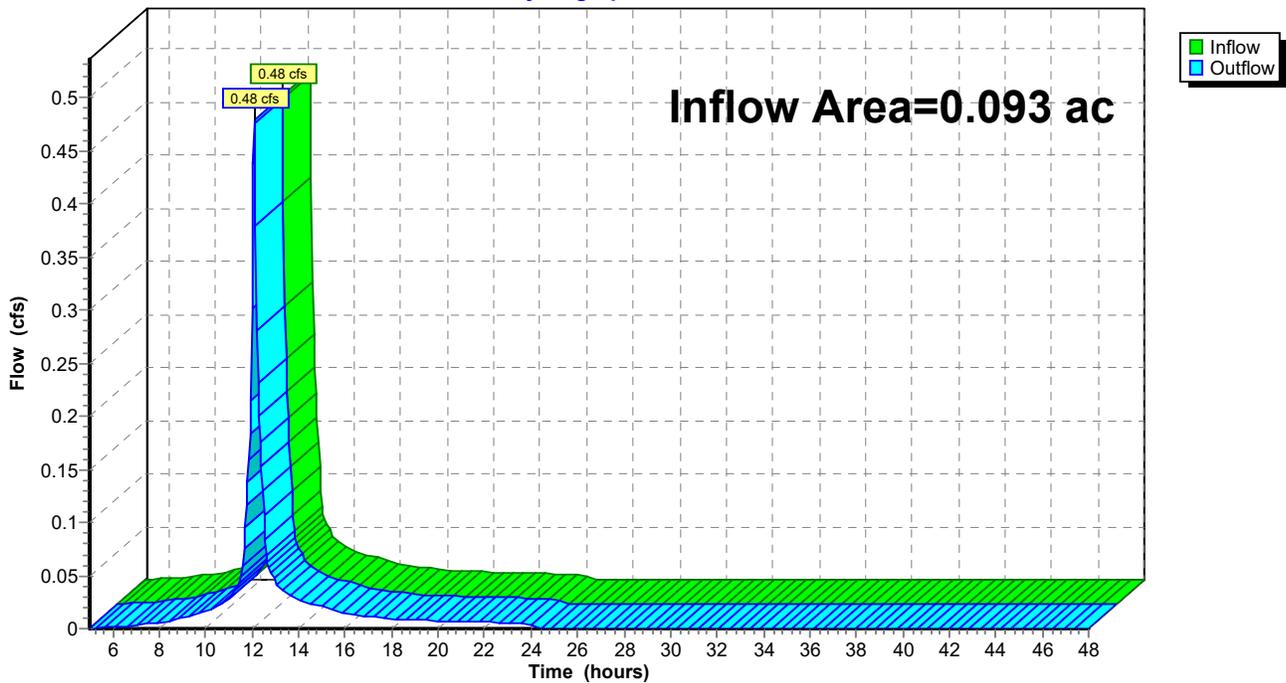

222-182 PRE DEVELOPMENT

Type III 24-hr 100-Year Rainfall=8.65"

Prepared by McKenzie Engineering Group, Inc.

Printed 3/6/2023

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Page 27

Time span=5.00-48.00 hrs, dt=0.05 hrs, 861 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

Subcatchment1S: CENTRAL SITE Runoff Area=58,599 sf 28.11% Impervious Runoff Depth>6.60"
Tc=6.0 min CN=83 Runoff=9.86 cfs 0.740 af

Subcatchment2S: FRONT SITE Runoff Area=8,995 sf 57.60% Impervious Runoff Depth>7.18"
Tc=6.0 min CN=88 Runoff=1.61 cfs 0.124 af

Subcatchment3S: SOUTH SITE Runoff Area=4,037 sf 47.83% Impervious Runoff Depth>7.06"
Tc=6.0 min CN=87 Runoff=0.71 cfs 0.055 af

Reach DP-1: WETLAND Inflow=9.86 cfs 0.740 af
Outflow=9.86 cfs 0.740 af

Reach DP-2: FRONT PROPERTY LINE/WASHINGTONST. Inflow=1.61 cfs 0.124 af
Outflow=1.61 cfs 0.124 af

Reach DP-3: SOUTHERN PROPERTY LINE Inflow=0.71 cfs 0.055 af
Outflow=0.71 cfs 0.055 af

Total Runoff Area = 1.644 ac Runoff Volume = 0.918 af Average Runoff Depth = 6.70"
67.08% Pervious = 1.103 ac 32.92% Impervious = 0.541 ac

222-182 PRE DEVELOPMENT

Type III 24-hr 100-Year Rainfall=8.65"

Prepared by McKenzie Engineering Group, Inc.

Printed 3/6/2023

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Page 28

Summary for Subcatchment 1S: CENTRAL SITE

Runoff = 9.86 cfs @ 12.09 hrs, Volume= 0.740 af, Depth> 6.60"
 Routed to Reach DP-1 : WETLAND


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs
 Type III 24-hr 100-Year Rainfall=8.65"

Area (sf)	CN	Description
4,387	98	Roofs, HSG C
12,085	98	Paved parking, HSG C
3,429	96	Gravel surface, HSG C
11,084	87	Dirt roads, HSG C
2,268	74	>75% Grass cover, Good, HSG C
25,346	70	Woods, Good, HSG C
58,599	83	Weighted Average
42,127		71.89% Pervious Area
16,472		28.11% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, DIRECT ENTRY

Subcatchment 1S: CENTRAL SITE

Hydrograph

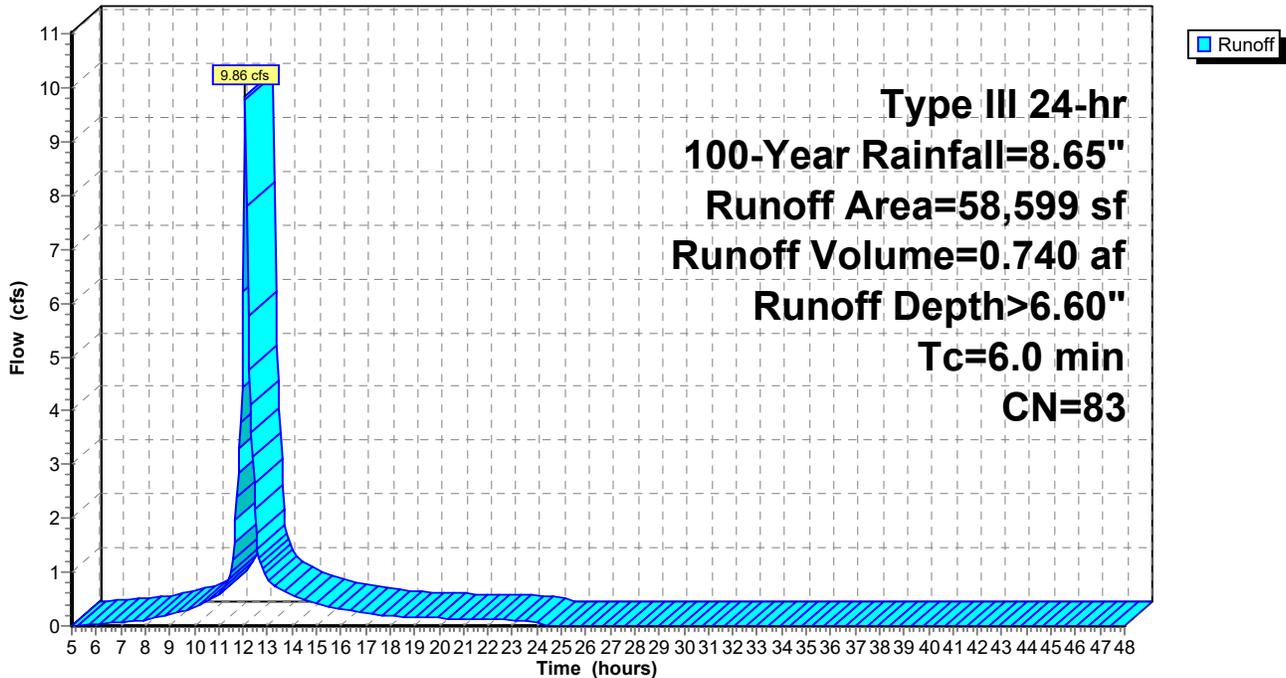

222-182 PRE DEVELOPMENT

Type III 24-hr 100-Year Rainfall=8.65"

Prepared by McKenzie Engineering Group, Inc.

Printed 3/6/2023

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Page 29

Summary for Subcatchment 2S: FRONT SITE

Runoff = 1.61 cfs @ 12.09 hrs, Volume= 0.124 af, Depth> 7.18"

Routed to Reach DP-2 : FRONT PROPERTY LINE/WASHINGTON ST.


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs
Type III 24-hr 100-Year Rainfall=8.65"

Area (sf)	CN	Description
270	98	Roofs, HSG C
4,911	98	Paved parking, HSG C
3,383	74	>75% Grass cover, Good, HSG C
431	70	Woods, Good, HSG C
8,995	88	Weighted Average
3,814		42.40% Pervious Area
5,181		57.60% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, DIRECT ENTRY

Subcatchment 2S: FRONT SITE

Hydrograph

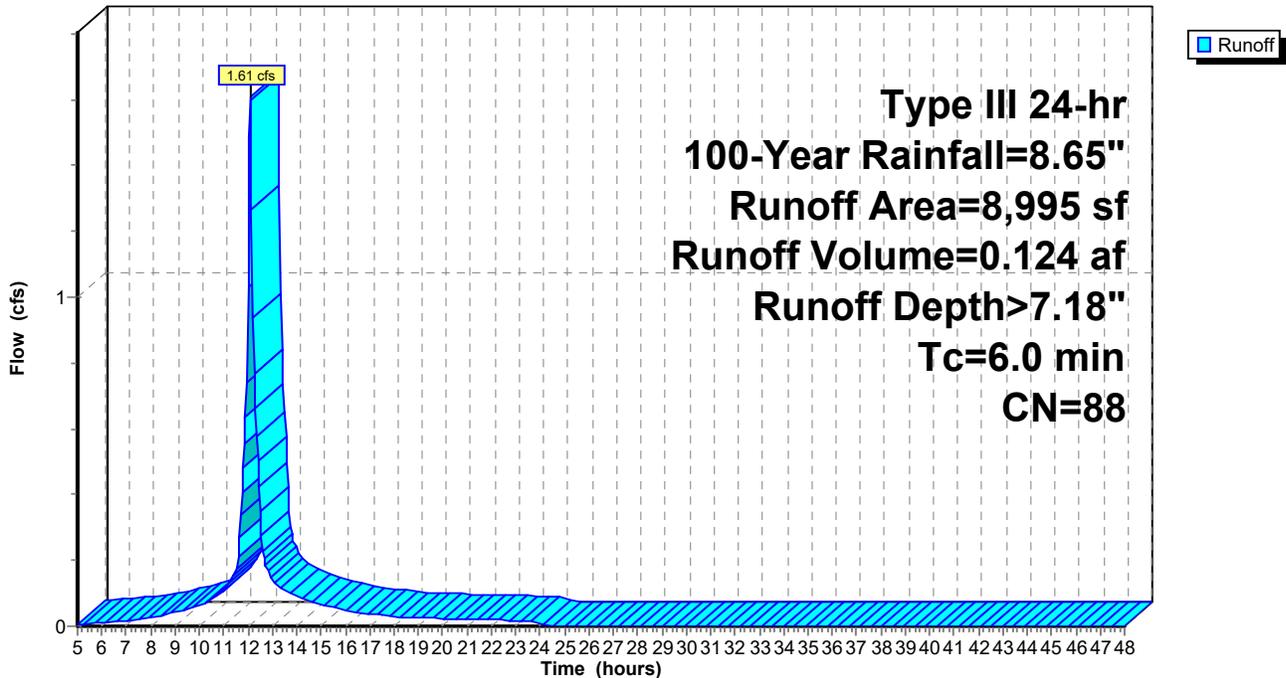

222-182 PRE DEVELOPMENT

Type III 24-hr 100-Year Rainfall=8.65"

Prepared by McKenzie Engineering Group, Inc.

Printed 3/6/2023

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Page 30

Summary for Subcatchment 3S: SOUTH SITE

Runoff = 0.71 cfs @ 12.09 hrs, Volume= 0.055 af, Depth> 7.06"
 Routed to Reach DP-3 : SOUTHERN PROPERTY LINE


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs
 Type III 24-hr 100-Year Rainfall=8.65"

Area (sf)	CN	Description
387	98	Roofs, HSG C
1,544	98	Paved parking, HSG C
598	96	Gravel surface, HSG C
151	74	>75% Grass cover, Good, HSG C
1,357	70	Woods, Good, HSG C
4,037	87	Weighted Average
2,106		52.17% Pervious Area
1,931		47.83% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, DIRECT ENTRY

Subcatchment 3S: SOUTH SITE

Hydrograph

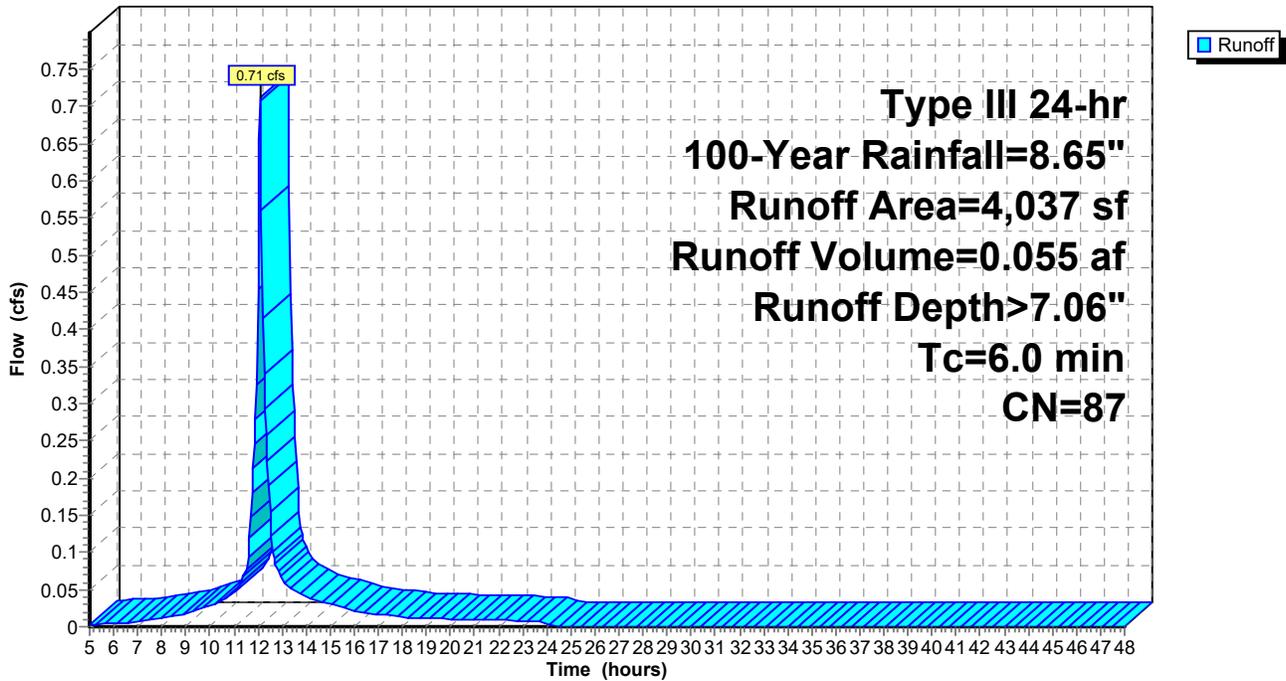

Summary for Reach DP-1: WETLAND


[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 1.345 ac, 28.11% Impervious, Inflow Depth > 6.60" for 100-Year event
Inflow = 9.86 cfs @ 12.09 hrs, Volume= 0.740 af
Outflow = 9.86 cfs @ 12.09 hrs, Volume= 0.740 af, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs

Reach DP-1: WETLAND

Hydrograph

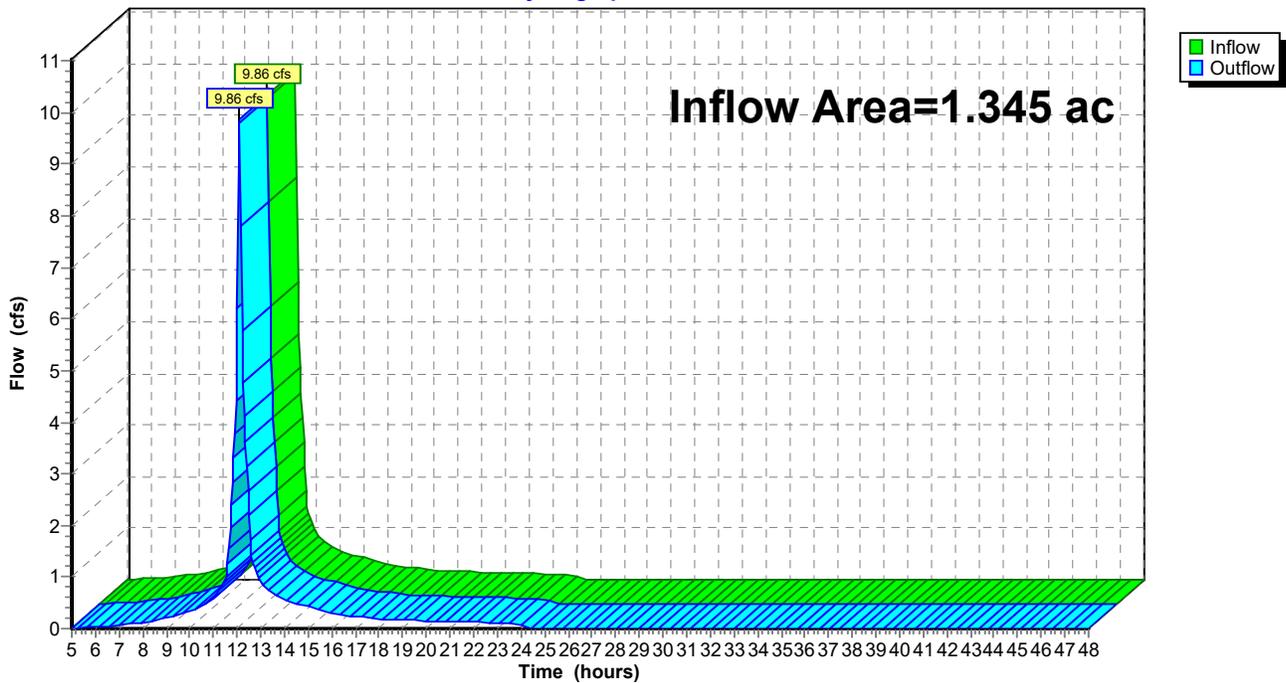

Summary for Reach DP-2: FRONT PROPERTY LINE/WASHINGTON ST.


[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 0.206 ac, 57.60% Impervious, Inflow Depth > 7.18" for 100-Year event
Inflow = 1.61 cfs @ 12.09 hrs, Volume= 0.124 af
Outflow = 1.61 cfs @ 12.09 hrs, Volume= 0.124 af, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs

Reach DP-2: FRONT PROPERTY LINE/WASHINGTON ST.

Hydrograph

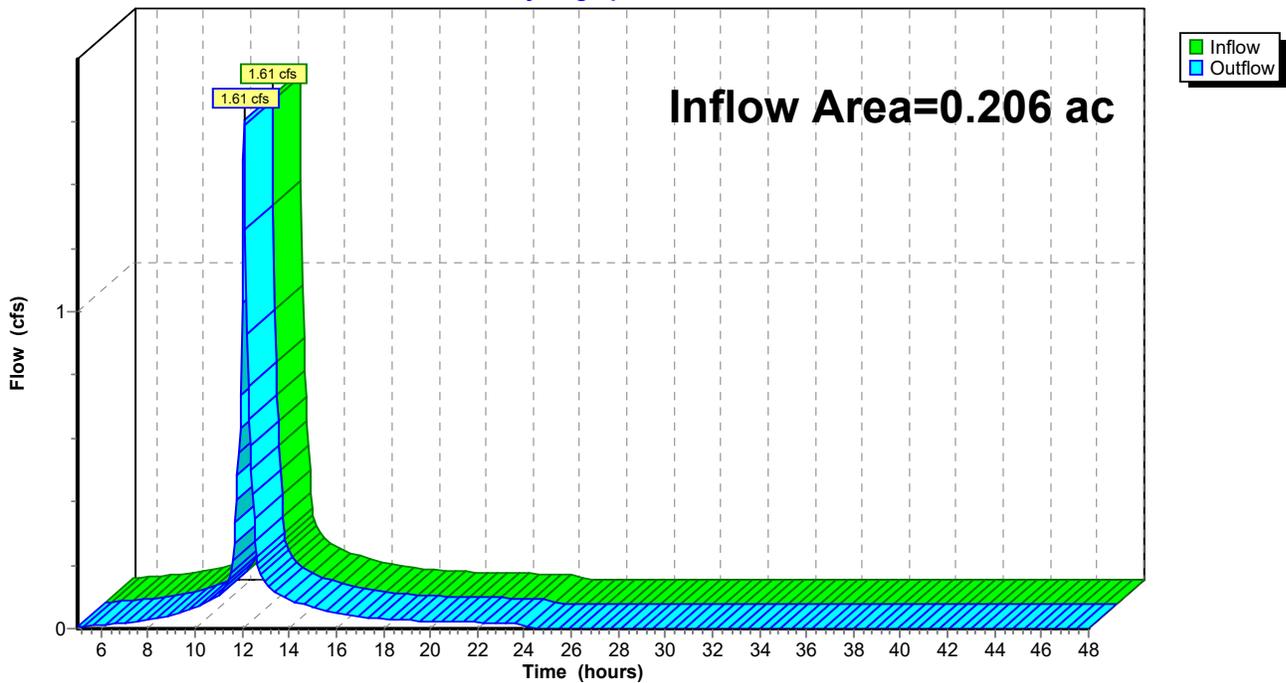

Summary for Reach DP-3: SOUTHERN PROPERTY LINE


[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 0.093 ac, 47.83% Impervious, Inflow Depth > 7.06" for 100-Year event
Inflow = 0.71 cfs @ 12.09 hrs, Volume= 0.055 af
Outflow = 0.71 cfs @ 12.09 hrs, Volume= 0.055 af, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs




Reach DP-3: SOUTHERN PROPERTY LINE

Hydrograph

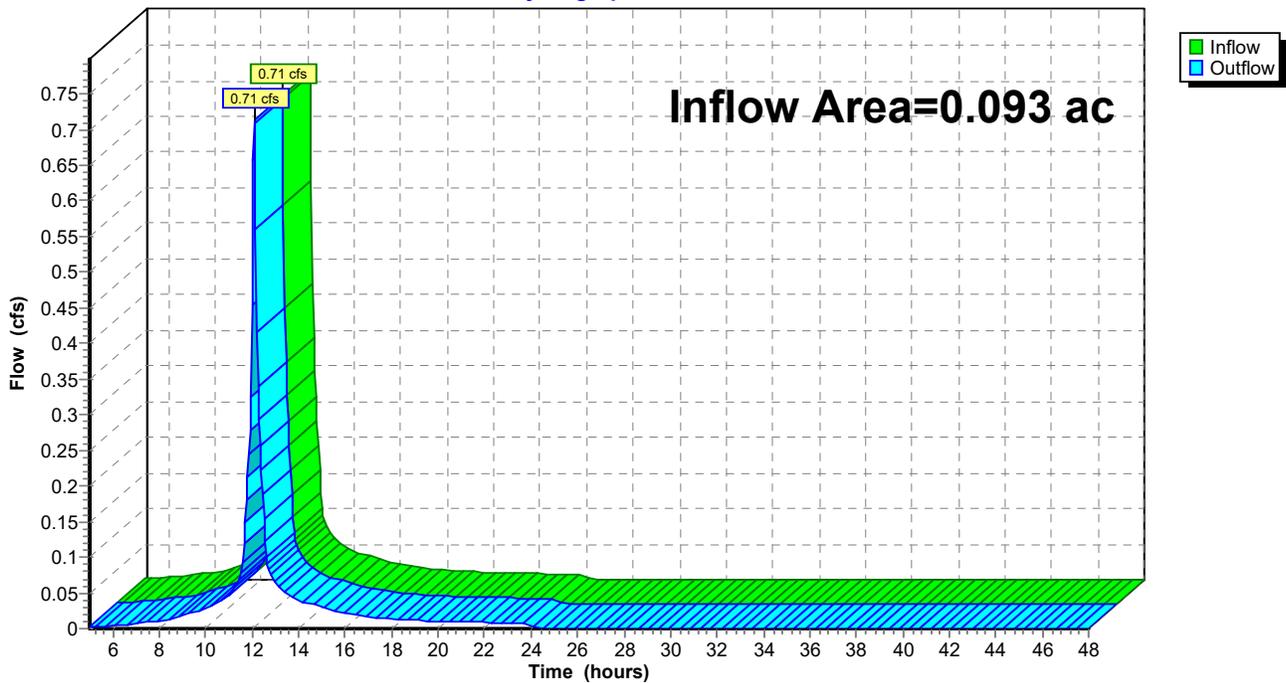

A P P E N D I X B

Post-Development Condition

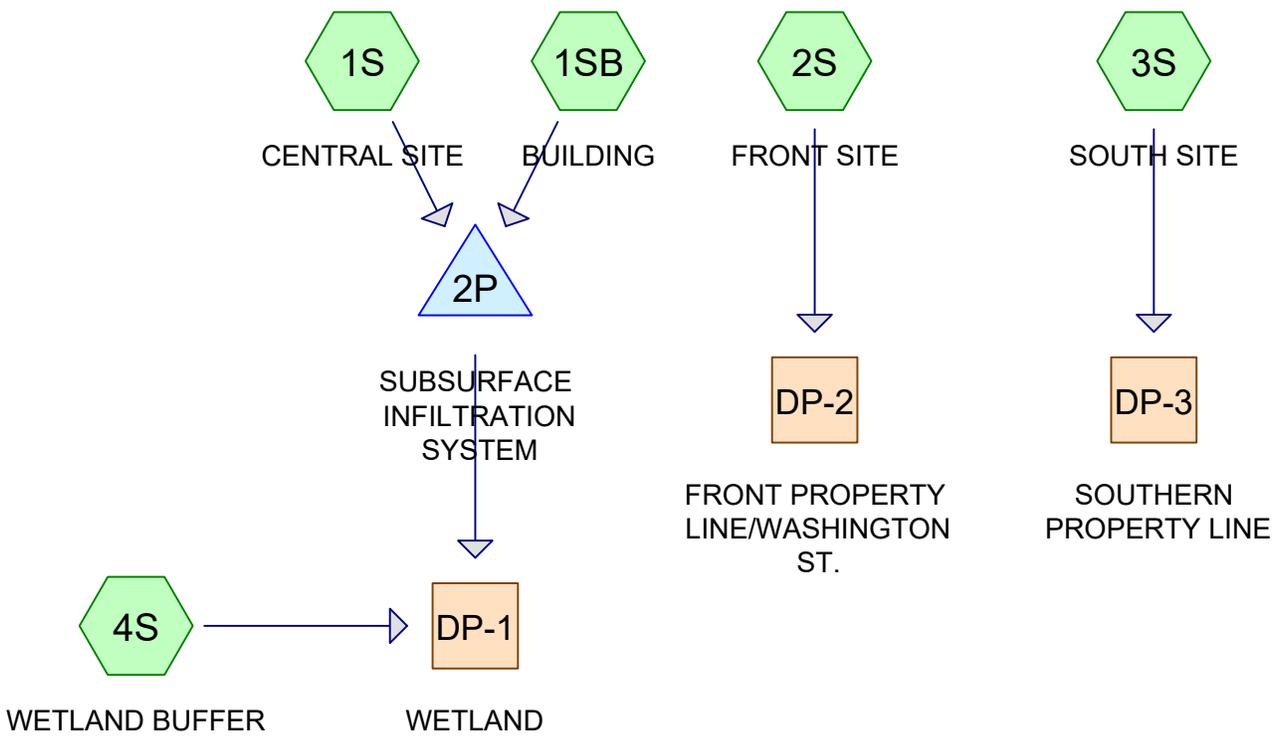

222-182 POST DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Printed 3/27/2023

Page 2

Rainfall Events Listing

Event#	Event Name	Storm Type	Curve	Mode	Duration (hours)	B/B	Depth (inches)	AMC
1	2-Year	Type III 24-hr		Default	24.00	1	3.31	2
2	10-Year	Type III 24-hr		Default	24.00	1	4.90	2
3	25-Year	Type III 24-hr		Default	24.00	1	6.14	2
4	100-Year	Type III 24-hr		Default	24.00	1	8.65	2

222-182 POST DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Printed 3/27/2023

Page 3

Area Listing (all nodes)

Area (acres)	CN	Description (subcatchment-numbers)
0.567	74	>75% Grass cover, Good, HSG C (1S, 2S, 3S, 4S)
0.475	98	Paved parking, HSG C (1S, 2S)
0.319	98	Roofs, HSG C (1SB)
0.026	98	Unconnected pavement, HSG C (1S, 4S)
0.256	70	Woods, Good, HSG C (3S, 4S)
1.644	85	TOTAL AREA

222-182 POST DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Printed 3/27/2023

Page 4

Soil Listing (all nodes)

Area (acres)	Soil Group	Subcatchment Numbers
0.000	HSG A	
0.000	HSG B	
1.644	HSG C	1S, 1SB, 2S, 3S, 4S
0.000	HSG D	
0.000	Other	
1.644		TOTAL AREA

222-182 POST DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

Printed 3/27/2023

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Page 5

Ground Covers (all nodes)

HSG-A (acres)	HSG-B (acres)	HSG-C (acres)	HSG-D (acres)	Other (acres)	Total (acres)	Ground Cover	Subcatchment Numbers
0.000	0.000	0.567	0.000	0.000	0.567	>75% Grass cover, Good	1S, 2S, 3S, 4S
0.000	0.000	0.475	0.000	0.000	0.475	Paved parking	1S, 2S
0.000	0.000	0.319	0.000	0.000	0.319	Roofs	1SB
0.000	0.000	0.026	0.000	0.000	0.026	Unconnected pavement	1S, 4S
0.000	0.000	0.256	0.000	0.000	0.256	Woods, Good	3S, 4S
0.000	0.000	1.644	0.000	0.000	1.644	TOTAL AREA	

222-182 POST DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

Printed 3/27/2023

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Page 6

Pipe Listing (all nodes)

Line#	Node Number	In-Invert (feet)	Out-Invert (feet)	Length (feet)	Slope (ft/ft)	n	Width (inches)	Diam/Height (inches)	Inside-Fill (inches)
1	2P	101.64	101.41	20.0	0.0115	0.013	0.0	15.0	0.0

222-182 POST DEVELOPMENT

Type III 24-hr 2-Year Rainfall=3.31"

Prepared by McKenzie Engineering Group, Inc.

Printed 3/27/2023

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Page 7

Time span=5.00-48.00 hrs, dt=0.05 hrs, 861 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

Subcatchment1S: CENTRAL SITE Runoff Area=23,734 sf 75.25% Impervious Runoff Depth>2.46"
Tc=6.0 min CN=92 Runoff=1.49 cfs 0.111 af

Subcatchment1SB: BUILDING Runoff Area=13,890 sf 100.00% Impervious Runoff Depth>3.02"
Tc=6.0 min CN=98 Runoff=1.00 cfs 0.080 af

Subcatchment2S: FRONT SITE Runoff Area=3,934 sf 74.17% Impervious Runoff Depth>2.46"
Tc=6.0 min CN=92 Runoff=0.25 cfs 0.018 af

Subcatchment3S: SOUTH SITE Runoff Area=2,928 sf 0.00% Impervious Runoff Depth=1.11"
Tc=6.0 min CN=74 Runoff=0.08 cfs 0.006 af

Subcatchment4S: WETLAND BUFFER Runoff Area=27,141 sf 4.01% Impervious Runoff Depth=1.05"
Tc=6.0 min CN=73 Runoff=0.72 cfs 0.055 af

Reach DP-1: WETLAND Inflow=0.72 cfs 0.090 af
Outflow=0.72 cfs 0.090 af

Reach DP-2: FRONT PROPERTY LINE/WASHINGTONST. Inflow=0.25 cfs 0.018 af
Outflow=0.25 cfs 0.018 af

Reach DP-3: SOUTHERN PROPERTY LINE Inflow=0.08 cfs 0.006 af
Outflow=0.08 cfs 0.006 af

Pond 2P: SUBSURFACE INFILTRATION Peak Elev=101.90' Storage=3,485 cf Inflow=2.50 cfs 0.192 af
Discarded=0.10 cfs 0.157 af Primary=0.30 cfs 0.035 af Outflow=0.40 cfs 0.192 af

Total Runoff Area = 1.644 ac Runoff Volume = 0.271 af Average Runoff Depth = 1.98"
50.08% Pervious = 0.823 ac 49.92% Impervious = 0.821 ac

222-182 POST DEVELOPMENT

Type III 24-hr 2-Year Rainfall=3.31"

Prepared by McKenzie Engineering Group, Inc.

Printed 3/27/2023

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Page 8

Summary for Subcatchment 1S: CENTRAL SITE

Runoff = 1.49 cfs @ 12.09 hrs, Volume= 0.111 af, Depth> 2.46"

Routed to Pond 2P : SUBSURFACE INFILTRATION SYSTEM


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs
Type III 24-hr 2-Year Rainfall=3.31"

Area (sf)	CN	Description
17,794	98	Paved parking, HSG C
5,873	74	>75% Grass cover, Good, HSG C
67	98	Unconnected pavement, HSG C
23,734	92	Weighted Average
5,873		24.75% Pervious Area
17,861		75.25% Impervious Area
67		0.38% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, DIRECT ENTRY

Subcatchment 1S: CENTRAL SITE

Hydrograph

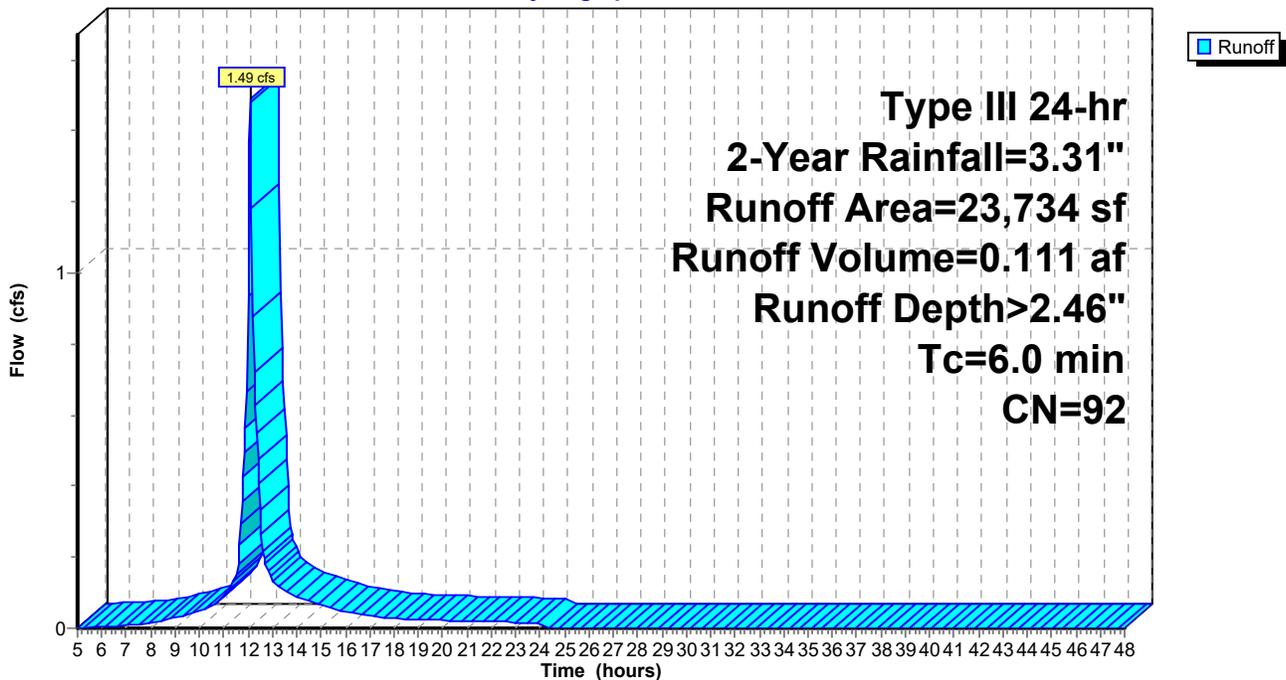

222-182 POST DEVELOPMENT

Type III 24-hr 2-Year Rainfall=3.31"

Prepared by McKenzie Engineering Group, Inc.

Printed 3/27/2023

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Page 9

Summary for Subcatchment 1SB: BUILDING

Runoff = 1.00 cfs @ 12.09 hrs, Volume= 0.080 af, Depth> 3.02"

Routed to Pond 2P : SUBSURFACE INFILTRATION SYSTEM


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs
Type III 24-hr 2-Year Rainfall=3.31"

Area (sf)	CN	Description
13,890	98	Roofs, HSG C
13,890		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, DIRECT ENTRY

Subcatchment 1SB: BUILDING

Hydrograph

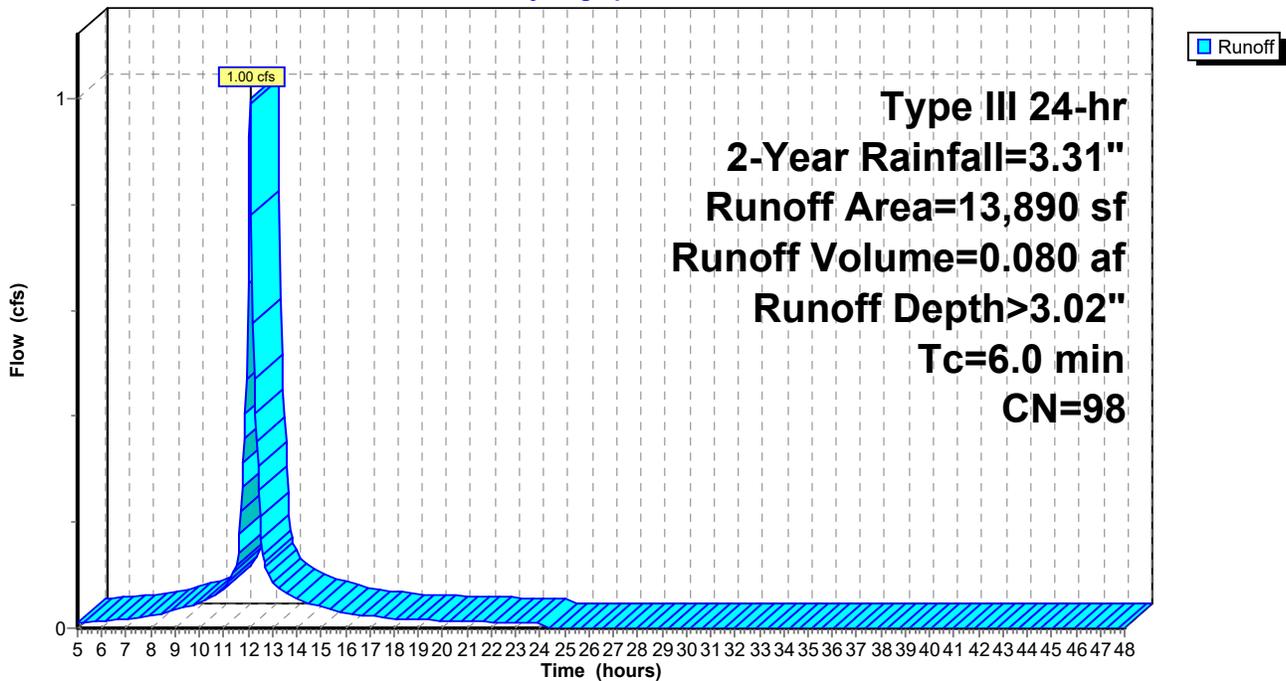

222-182 POST DEVELOPMENT

Type III 24-hr 2-Year Rainfall=3.31"

Prepared by McKenzie Engineering Group, Inc.

Printed 3/27/2023

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Page 10

Summary for Subcatchment 2S: FRONT SITE

Runoff = 0.25 cfs @ 12.09 hrs, Volume= 0.018 af, Depth> 2.46"
 Routed to Reach DP-2 : FRONT PROPERTY LINE/WASHINGTON ST.


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs
 Type III 24-hr 2-Year Rainfall=3.31"

Area (sf)	CN	Description
2,918	98	Paved parking, HSG C
1,016	74	>75% Grass cover, Good, HSG C
3,934	92	Weighted Average
1,016		25.83% Pervious Area
2,918		74.17% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, DIRECT ENTRY

Subcatchment 2S: FRONT SITE

Hydrograph

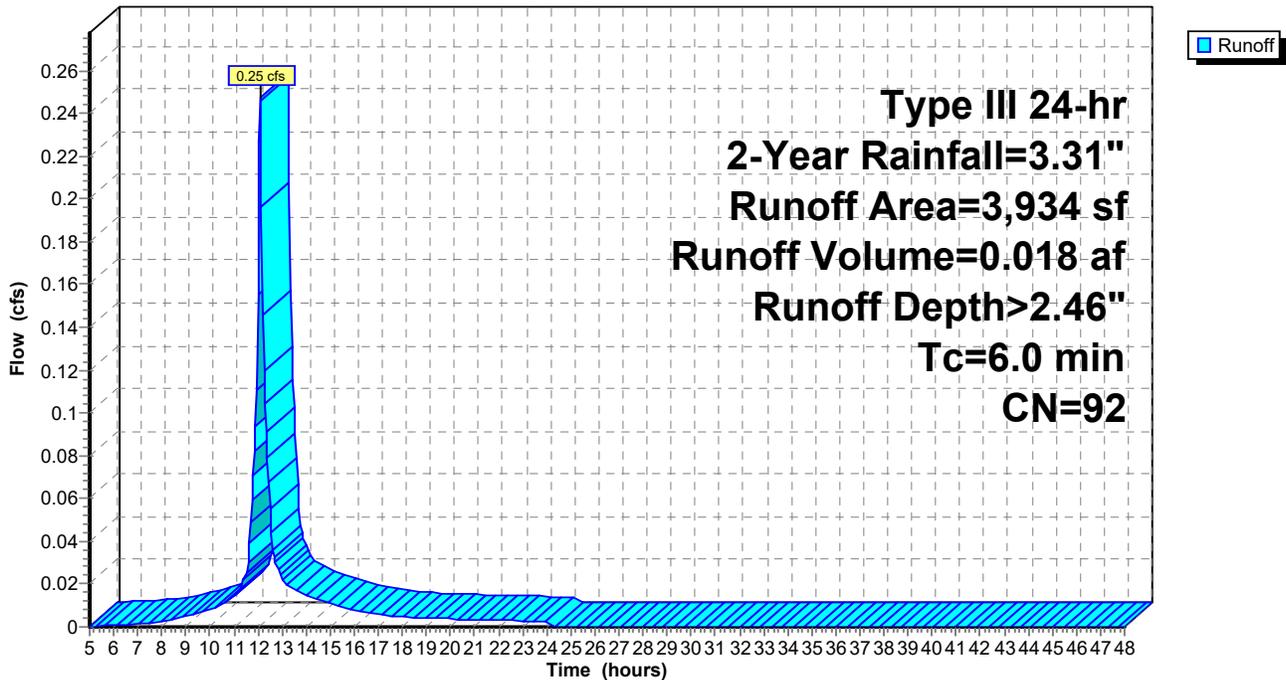

222-182 POST DEVELOPMENT

Type III 24-hr 2-Year Rainfall=3.31"

Prepared by McKenzie Engineering Group, Inc.

Printed 3/27/2023

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Page 11

Summary for Subcatchment 3S: SOUTH SITE

Runoff = 0.08 cfs @ 12.10 hrs, Volume= 0.006 af, Depth= 1.11"

Routed to Reach DP-3 : SOUTHERN PROPERTY LINE


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs
Type III 24-hr 2-Year Rainfall=3.31"

Area (sf)	CN	Description
215	70	Woods, Good, HSG C
2,713	74	>75% Grass cover, Good, HSG C
2,928	74	Weighted Average
2,928		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, DIRECT ENTRY

Subcatchment 3S: SOUTH SITE

Hydrograph

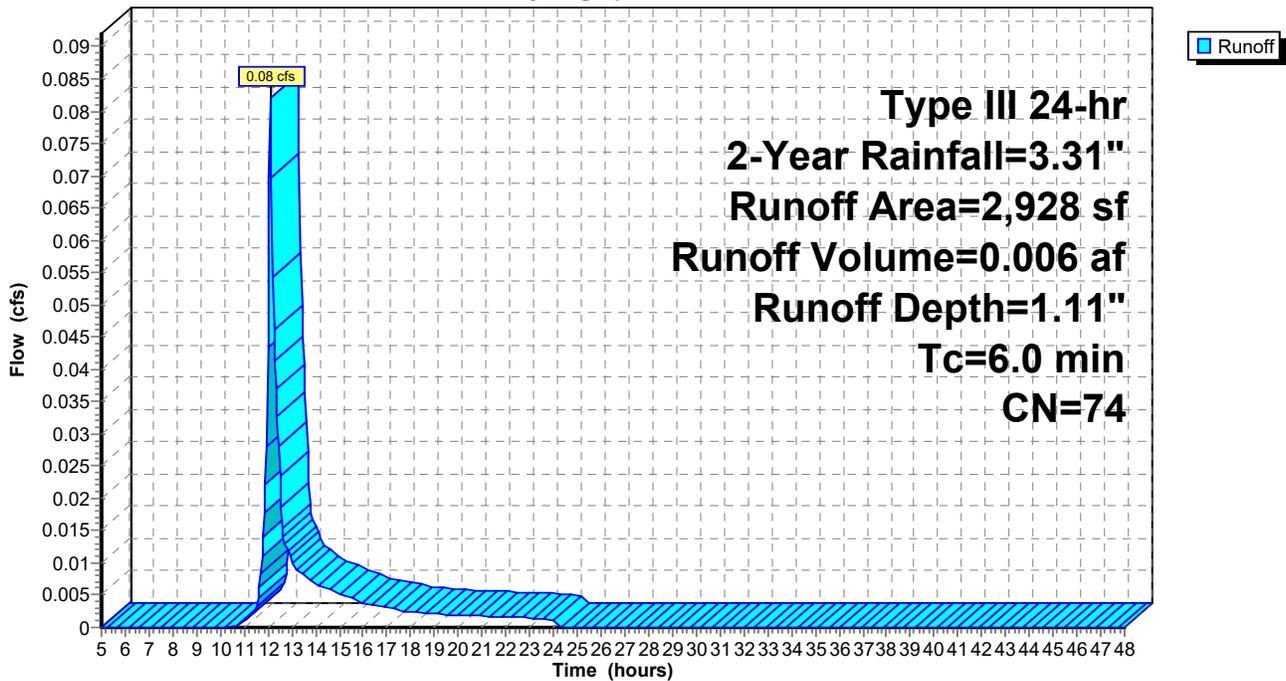

222-182 POST DEVELOPMENT

Type III 24-hr 2-Year Rainfall=3.31"

Prepared by McKenzie Engineering Group, Inc.

Printed 3/27/2023

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Page 12

Summary for Subcatchment 4S: WETLAND BUFFER

Runoff = 0.72 cfs @ 12.10 hrs, Volume= 0.055 af, Depth= 1.05"
 Routed to Reach DP-1 : WETLAND


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs
 Type III 24-hr 2-Year Rainfall=3.31"

Area (sf)	CN	Description
15,103	74	>75% Grass cover, Good, HSG C
10,951	70	Woods, Good, HSG C
1,087	98	Unconnected pavement, HSG C
27,141	73	Weighted Average
26,054		95.99% Pervious Area
1,087		4.01% Impervious Area
1,087		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, DIRECT ENTRY

Subcatchment 4S: WETLAND BUFFER

Hydrograph

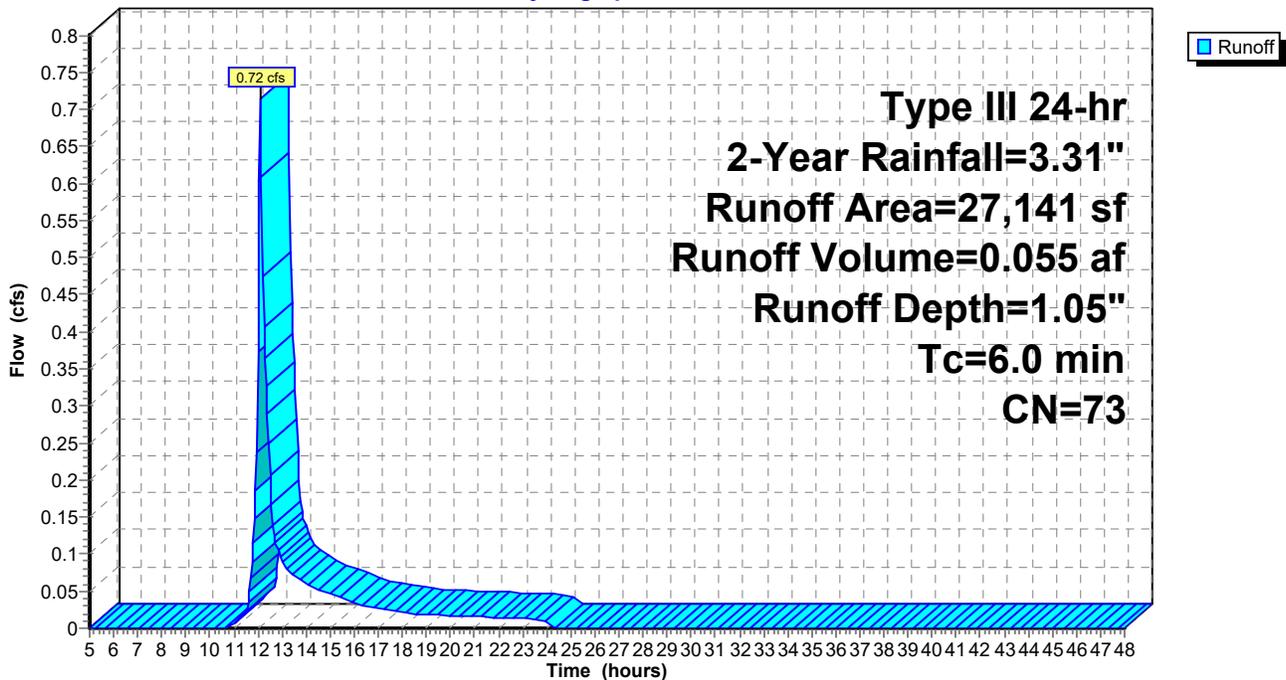

222-182 POST DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Type III 24-hr 2-Year Rainfall=3.31"

Printed 3/27/2023

Page 13

Summary for Reach DP-1: WETLAND


[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 1.487 ac, 50.70% Impervious, Inflow Depth = 0.73" for 2-Year event
Inflow = 0.72 cfs @ 12.10 hrs, Volume= 0.090 af
Outflow = 0.72 cfs @ 12.10 hrs, Volume= 0.090 af, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs

Reach DP-1: WETLAND

Hydrograph

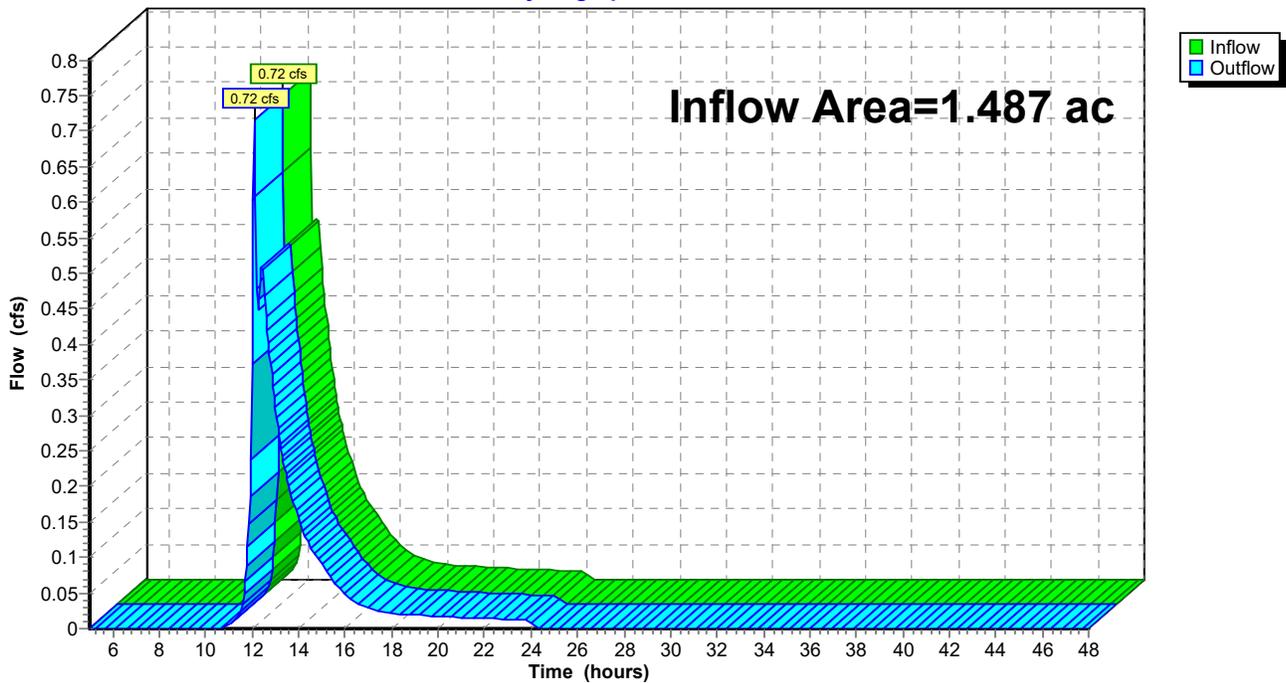

222-182 POST DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Type III 24-hr 2-Year Rainfall=3.31"

Printed 3/27/2023

Page 14

Summary for Reach DP-2: FRONT PROPERTY LINE/WASHINGTON ST.


[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 0.090 ac, 74.17% Impervious, Inflow Depth > 2.46" for 2-Year event
Inflow = 0.25 cfs @ 12.09 hrs, Volume= 0.018 af
Outflow = 0.25 cfs @ 12.09 hrs, Volume= 0.018 af, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs

Reach DP-2: FRONT PROPERTY LINE/WASHINGTON ST.

Hydrograph

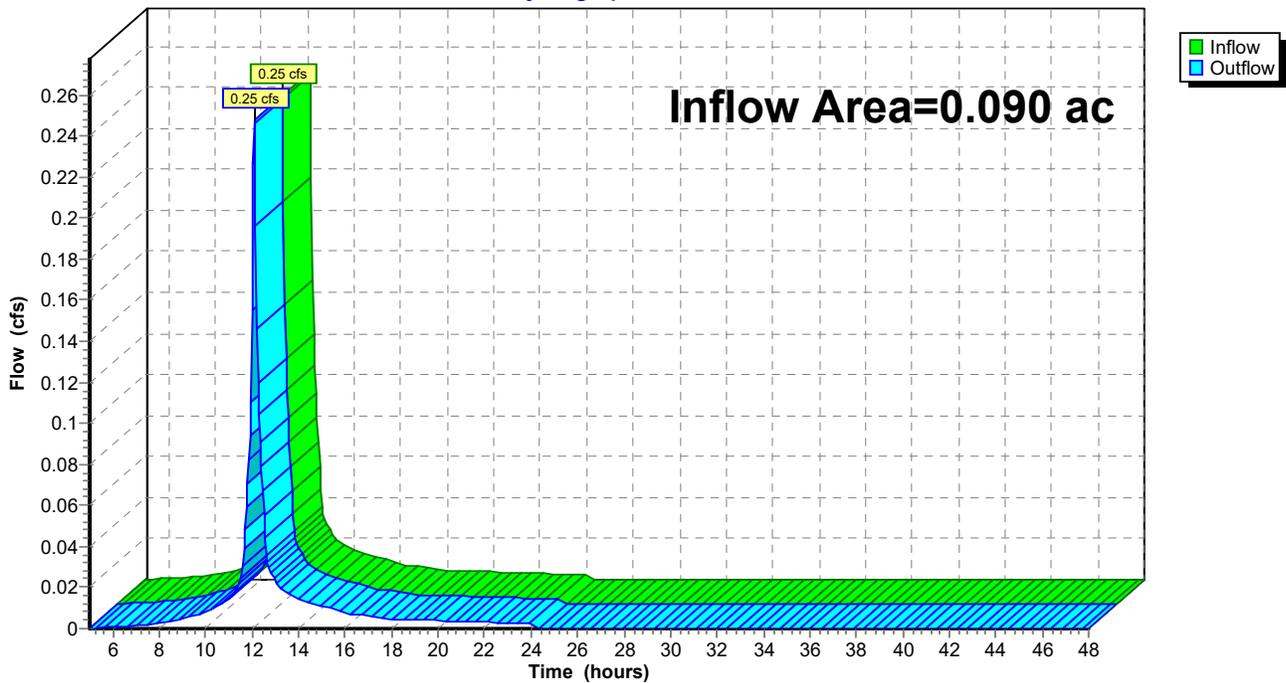

222-182 POST DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Type III 24-hr 2-Year Rainfall=3.31"

Printed 3/27/2023

Page 15

Summary for Reach DP-3: SOUTHERN PROPERTY LINE


[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 0.067 ac, 0.00% Impervious, Inflow Depth = 1.11" for 2-Year event
Inflow = 0.08 cfs @ 12.10 hrs, Volume= 0.006 af
Outflow = 0.08 cfs @ 12.10 hrs, Volume= 0.006 af, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs

Reach DP-3: SOUTHERN PROPERTY LINE

Hydrograph

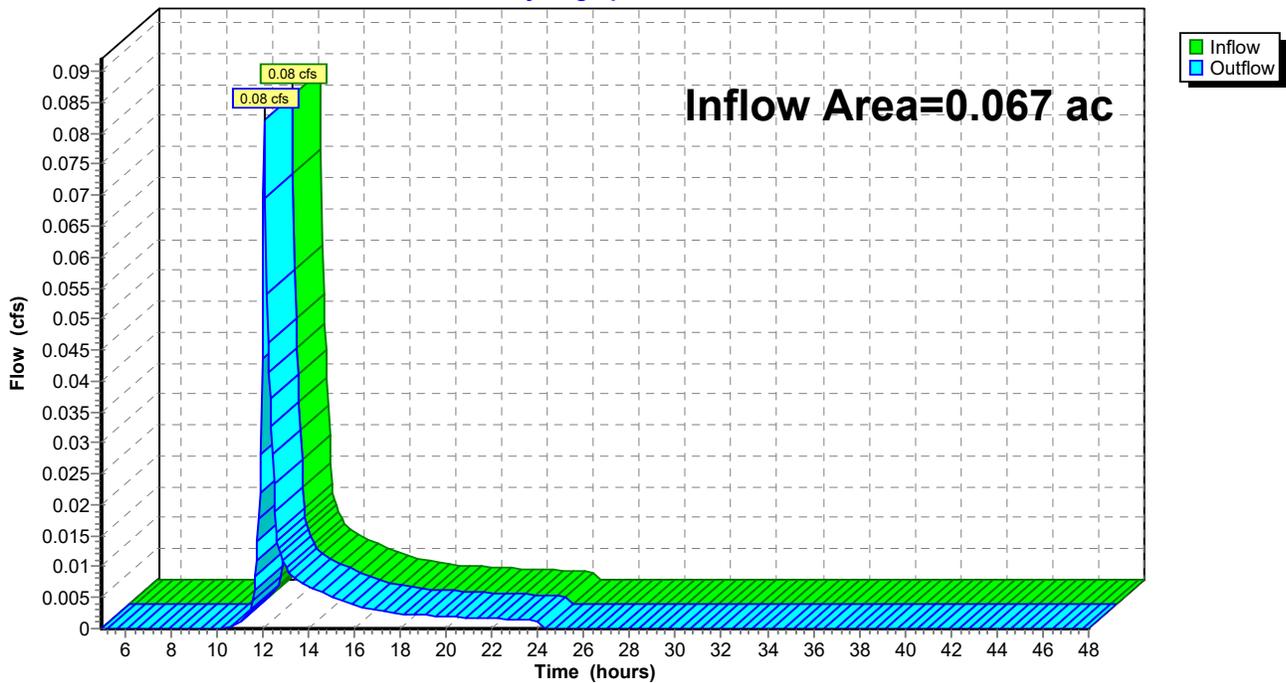

222-182 POST DEVELOPMENT

Type III 24-hr 2-Year Rainfall=3.31"

Prepared by McKenzie Engineering Group, Inc.

Printed 3/27/2023

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Page 16

Summary for Pond 2P: SUBSURFACE INFILTRATION SYSTEM

[82] Warning: Early inflow requires earlier time span

Inflow Area = 0.864 ac, 84.39% Impervious, Inflow Depth > 2.66" for 2-Year event
 Inflow = 2.50 cfs @ 12.09 hrs, Volume= 0.192 af
 Outflow = 0.40 cfs @ 12.57 hrs, Volume= 0.192 af, Atten= 84%, Lag= 29.0 min
 Discarded = 0.10 cfs @ 10.70 hrs, Volume= 0.157 af
 Primary = 0.30 cfs @ 12.57 hrs, Volume= 0.035 af
 Routed to Reach DP-1 : WETLAND

Routing by Dyn-Stor-Ind method, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs
 Peak Elev= 101.90' @ 12.57 hrs Surf.Area= 4,182 sf Storage= 3,485 cf

Plug-Flow detention time= (not calculated: outflow precedes inflow)
 Center-of-Mass det. time= 224.0 min (1,007.7 - 783.7)

Volume	Invert	Avail.Storage	Storage Description
#1A	100.60'	2,974 cf	30.75"W x 136.00'L x 2.54'H Field A 10,629 cf Overall - 3,195 cf Embedded = 7,435 cf x 40.0% Voids
#2A	101.10'	3,195 cf	Cultec R-150XLHD x 117 Inside #1 Effective Size= 29.8"W x 18.0"H => 2.65 sf x 10.25'L = 27.2 cf Overall Size= 33.0"W x 18.5"H x 11.00'L with 0.75' Overlap Row Length Adjustment= +0.75' x 2.65 sf x 9 rows
		6,169 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Discarded	100.60'	1.020 in/hr Exfiltration over Surface area
#2	Primary	101.64'	15.0" Round Culvert L= 20.0' RCP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 101.64' / 101.41' S= 0.0115 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

Discarded OutFlow Max=0.10 cfs @ 10.70 hrs HW=100.63' (Free Discharge)

↑1=Exfiltration (Exfiltration Controls 0.10 cfs)

Primary OutFlow Max=0.30 cfs @ 12.57 hrs HW=101.90' TW=0.00' (Dynamic Tailwater)

↑2=Culvert (Barrel Controls 0.30 cfs @ 2.45 fps)

222-182 POST DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Type III 24-hr 2-Year Rainfall=3.31"

Printed 3/27/2023

Page 17

Pond 2P: SUBSURFACE INFILTRATION SYSTEM - Chamber Wizard Field A

Chamber Model = Cultec R-150XLHD (Cultec Recharger® 150XLHD)

Effective Size= 29.8"W x 18.0"H => 2.65 sf x 10.25'L = 27.2 cf

Overall Size= 33.0"W x 18.5"H x 11.00'L with 0.75' Overlap

Row Length Adjustment= +0.75' x 2.65 sf x 9 rows

33.0" Wide + 6.0" Spacing = 39.0" C-C Row Spacing

13 Chambers/Row x 10.25' Long +0.75' Row Adjustment = 134.00' Row Length +12.0" End Stone x 2 = 136.00' Base Length

9 Rows x 33.0" Wide + 6.0" Spacing x 8 + 12.0" Side Stone x 2 = 30.75' Base Width

6.0" Stone Base + 18.5" Chamber Height + 6.0" Stone Cover = 2.54' Field Height

117 Chambers x 27.2 cf +0.75' Row Adjustment x 2.65 sf x 9 Rows = 3,194.7 cf Chamber Storage

10,629.3 cf Field - 3,194.7 cf Chambers = 7,434.6 cf Stone x 40.0% Voids = 2,973.8 cf Stone Storage

Chamber Storage + Stone Storage = 6,168.5 cf = 0.142 af


Overall Storage Efficiency = 58.0%

Overall System Size = 136.00' x 30.75' x 2.54'

117 Chambers

393.7 cy Field

275.4 cy Stone

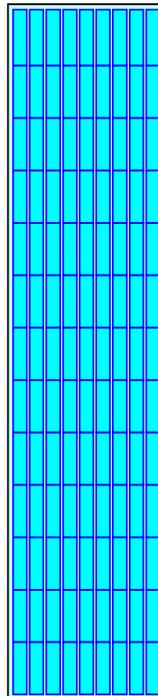

222-182 POST DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC


Type III 24-hr 2-Year Rainfall=3.31"

Printed 3/27/2023

Page 18

Pond 2P: SUBSURFACE INFILTRATION SYSTEM

Hydrograph

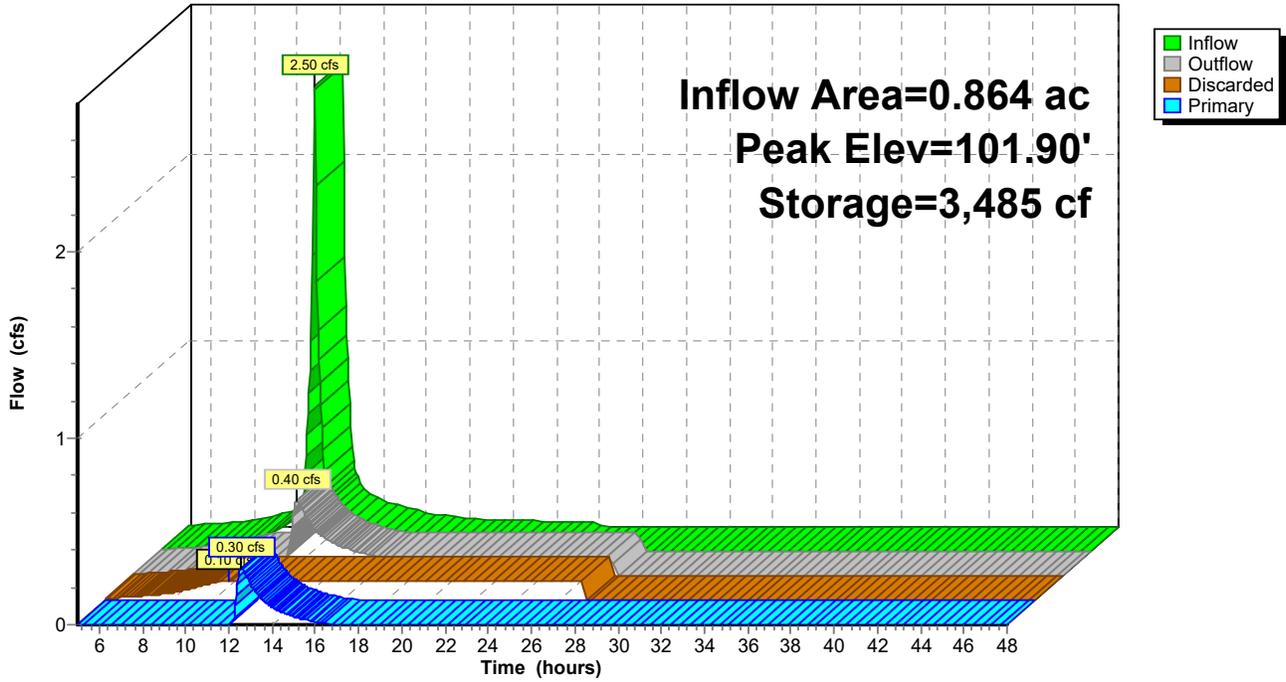

222-182 POST DEVELOPMENT

Type III 24-hr 10-Year Rainfall=4.90"

Prepared by McKenzie Engineering Group, Inc.

Printed 3/27/2023

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Page 19

Time span=5.00-48.00 hrs, dt=0.05 hrs, 861 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

Subcatchment1S: CENTRAL SITE Runoff Area=23,734 sf 75.25% Impervious Runoff Depth>3.98"
Tc=6.0 min CN=92 Runoff=2.37 cfs 0.181 af

Subcatchment1SB: BUILDING Runoff Area=13,890 sf 100.00% Impervious Runoff Depth>4.54"
Tc=6.0 min CN=98 Runoff=1.49 cfs 0.121 af

Subcatchment2S: FRONT SITE Runoff Area=3,934 sf 74.17% Impervious Runoff Depth>3.98"
Tc=6.0 min CN=92 Runoff=0.39 cfs 0.030 af

Subcatchment3S: SOUTH SITE Runoff Area=2,928 sf 0.00% Impervious Runoff Depth=2.28"
Tc=6.0 min CN=74 Runoff=0.18 cfs 0.013 af

Subcatchment4S: WETLAND BUFFER Runoff Area=27,141 sf 4.01% Impervious Runoff Depth=2.20"
Tc=6.0 min CN=73 Runoff=1.57 cfs 0.114 af

Reach DP-1: WETLAND Inflow=2.37 cfs 0.235 af
Outflow=2.37 cfs 0.235 af

Reach DP-2: FRONT PROPERTY LINE/WASHINGTONST. Inflow=0.39 cfs 0.030 af
Outflow=0.39 cfs 0.030 af

Reach DP-3: SOUTHERN PROPERTY LINE Inflow=0.18 cfs 0.013 af
Outflow=0.18 cfs 0.013 af

Pond 2P: SUBSURFACE INFILTRATION Peak Elev=102.29' Storage=4,598 cf Inflow=3.86 cfs 0.302 af
Discarded=0.10 cfs 0.181 af Primary=1.54 cfs 0.121 af Outflow=1.64 cfs 0.302 af

Total Runoff Area = 1.644 ac Runoff Volume = 0.459 af Average Runoff Depth = 3.35"
50.08% Pervious = 0.823 ac 49.92% Impervious = 0.821 ac

222-182 POST DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Type III 24-hr 10-Year Rainfall=4.90"

Printed 3/27/2023

Page 20

Summary for Subcatchment 1S: CENTRAL SITE

Runoff = 2.37 cfs @ 12.09 hrs, Volume= 0.181 af, Depth> 3.98"

Routed to Pond 2P : SUBSURFACE INFILTRATION SYSTEM


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs
Type III 24-hr 10-Year Rainfall=4.90"

Area (sf)	CN	Description
17,794	98	Paved parking, HSG C
5,873	74	>75% Grass cover, Good, HSG C
67	98	Unconnected pavement, HSG C
23,734	92	Weighted Average
5,873		24.75% Pervious Area
17,861		75.25% Impervious Area
67		0.38% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, DIRECT ENTRY

Subcatchment 1S: CENTRAL SITE

Hydrograph

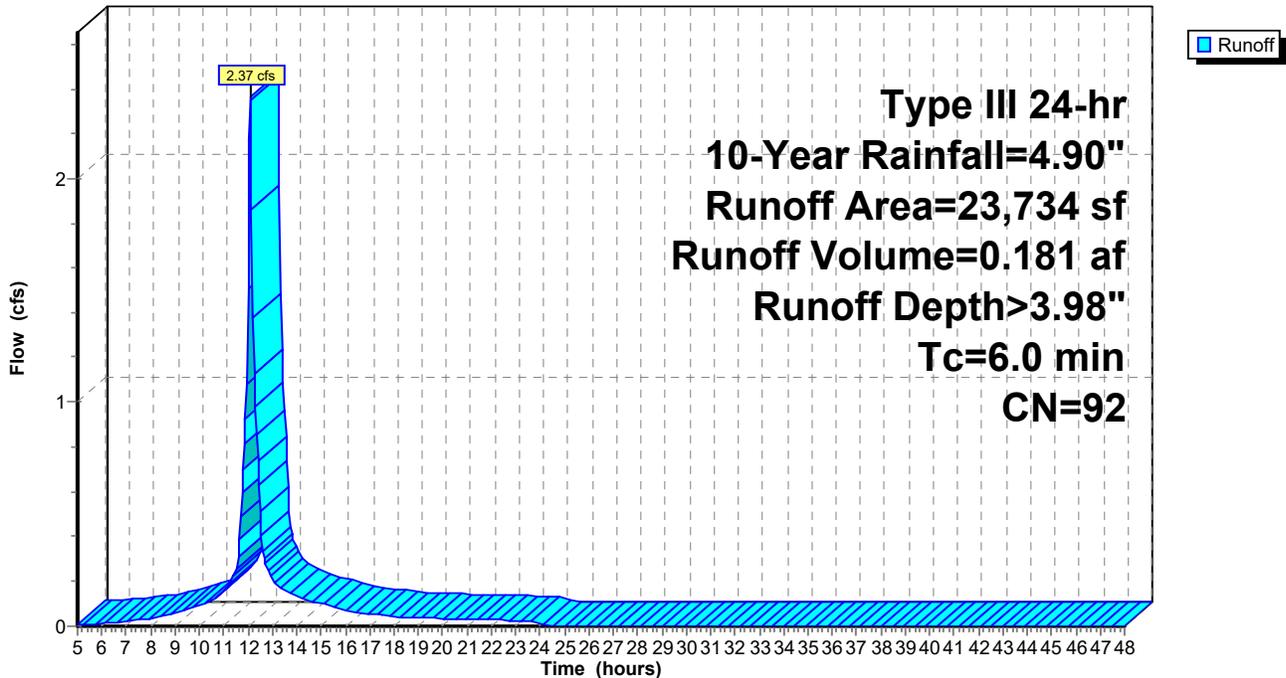

222-182 POST DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Type III 24-hr 10-Year Rainfall=4.90"

Printed 3/27/2023

Page 21

Summary for Subcatchment 1SB: BUILDING

Runoff = 1.49 cfs @ 12.09 hrs, Volume= 0.121 af, Depth> 4.54"

Routed to Pond 2P : SUBSURFACE INFILTRATION SYSTEM


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs
Type III 24-hr 10-Year Rainfall=4.90"

Area (sf)	CN	Description
13,890	98	Roofs, HSG C
13,890		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, DIRECT ENTRY

Subcatchment 1SB: BUILDING

Hydrograph

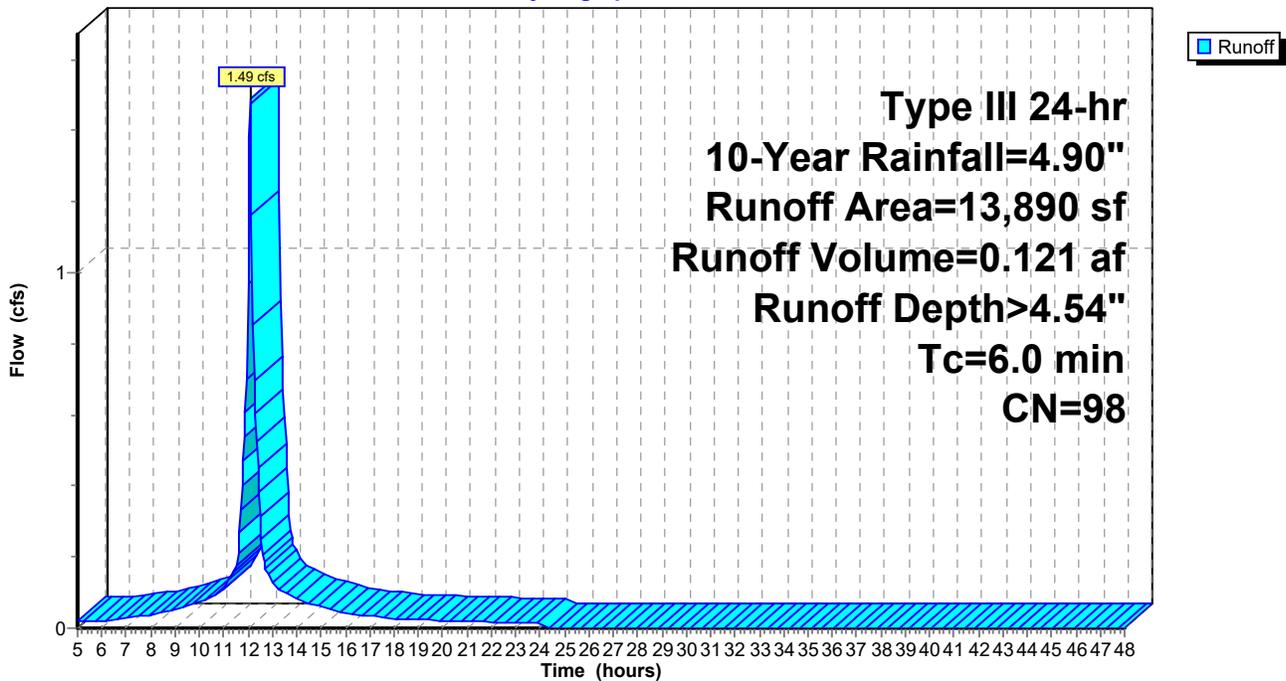

222-182 POST DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Type III 24-hr 10-Year Rainfall=4.90"

Printed 3/27/2023

Page 22

Summary for Subcatchment 2S: FRONT SITE

Runoff = 0.39 cfs @ 12.09 hrs, Volume= 0.030 af, Depth> 3.98"

Routed to Reach DP-2 : FRONT PROPERTY LINE/WASHINGTON ST.


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs
 Type III 24-hr 10-Year Rainfall=4.90"

Area (sf)	CN	Description
2,918	98	Paved parking, HSG C
1,016	74	>75% Grass cover, Good, HSG C
3,934	92	Weighted Average
1,016		25.83% Pervious Area
2,918		74.17% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, DIRECT ENTRY

Subcatchment 2S: FRONT SITE

Hydrograph

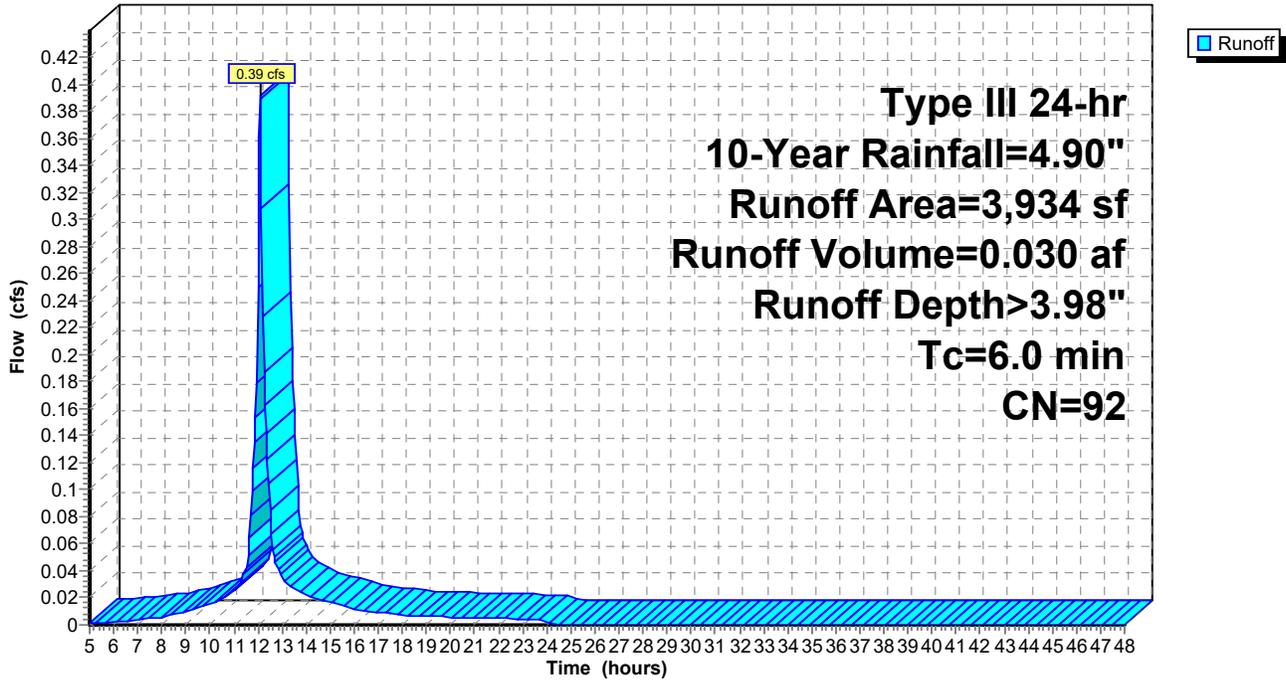

222-182 POST DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Type III 24-hr 10-Year Rainfall=4.90"

Printed 3/27/2023

Page 23

Summary for Subcatchment 3S: SOUTH SITE

Runoff = 0.18 cfs @ 12.10 hrs, Volume= 0.013 af, Depth= 2.28"

Routed to Reach DP-3 : SOUTHERN PROPERTY LINE


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs
 Type III 24-hr 10-Year Rainfall=4.90"

Area (sf)	CN	Description
215	70	Woods, Good, HSG C
2,713	74	>75% Grass cover, Good, HSG C
2,928	74	Weighted Average
2,928		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, DIRECT ENTRY

Subcatchment 3S: SOUTH SITE

Hydrograph

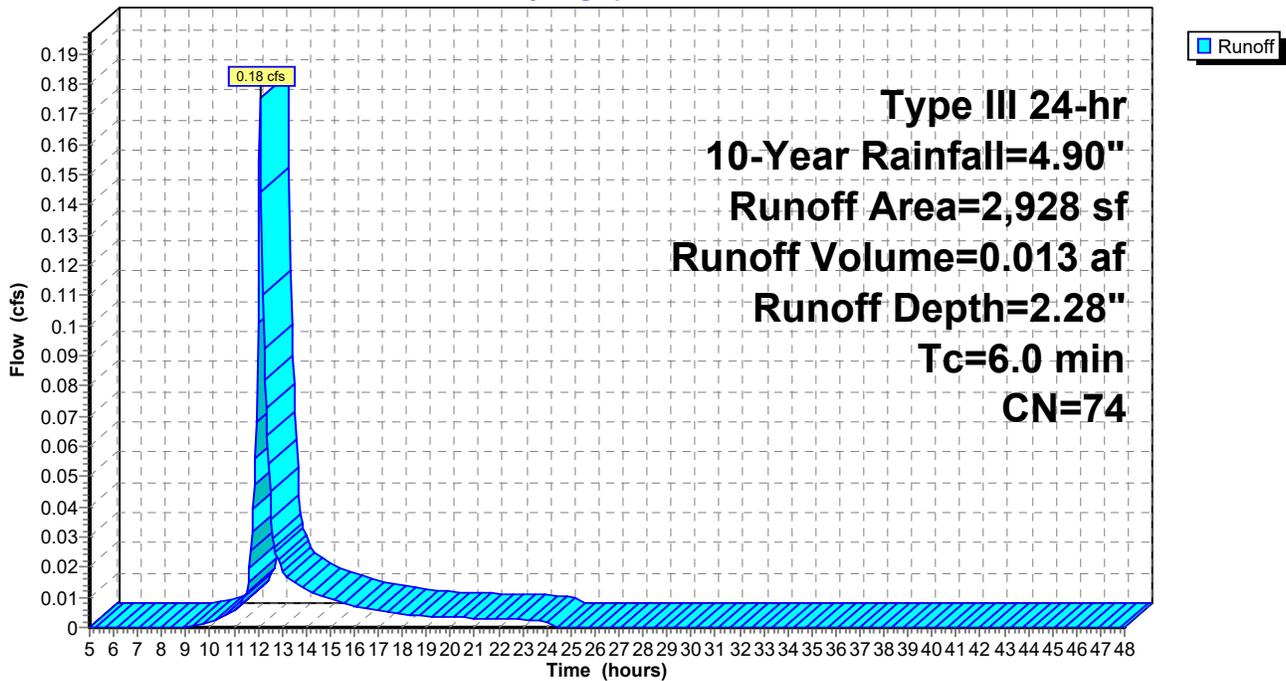

222-182 POST DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Type III 24-hr 10-Year Rainfall=4.90"

Printed 3/27/2023

Page 24

Summary for Subcatchment 4S: WETLAND BUFFER

Runoff = 1.57 cfs @ 12.10 hrs, Volume= 0.114 af, Depth= 2.20"
 Routed to Reach DP-1 : WETLAND


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs
 Type III 24-hr 10-Year Rainfall=4.90"

Area (sf)	CN	Description
15,103	74	>75% Grass cover, Good, HSG C
10,951	70	Woods, Good, HSG C
1,087	98	Unconnected pavement, HSG C
27,141	73	Weighted Average
26,054		95.99% Pervious Area
1,087		4.01% Impervious Area
1,087		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, DIRECT ENTRY

Subcatchment 4S: WETLAND BUFFER

Hydrograph

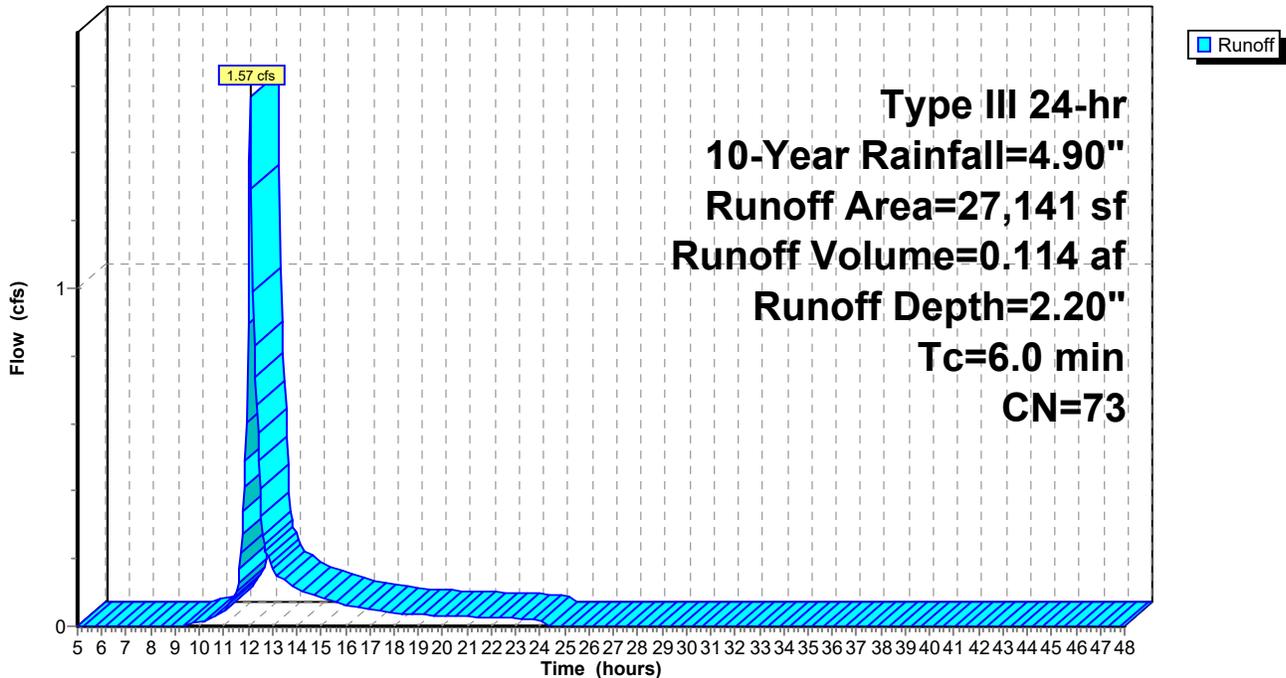

222-182 POST DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Type III 24-hr 10-Year Rainfall=4.90"

Printed 3/27/2023

Page 25

Summary for Reach DP-1: WETLAND


[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 1.487 ac, 50.70% Impervious, Inflow Depth = 1.90" for 10-Year event
Inflow = 2.37 cfs @ 12.19 hrs, Volume= 0.235 af
Outflow = 2.37 cfs @ 12.19 hrs, Volume= 0.235 af, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs

Reach DP-1: WETLAND

Hydrograph

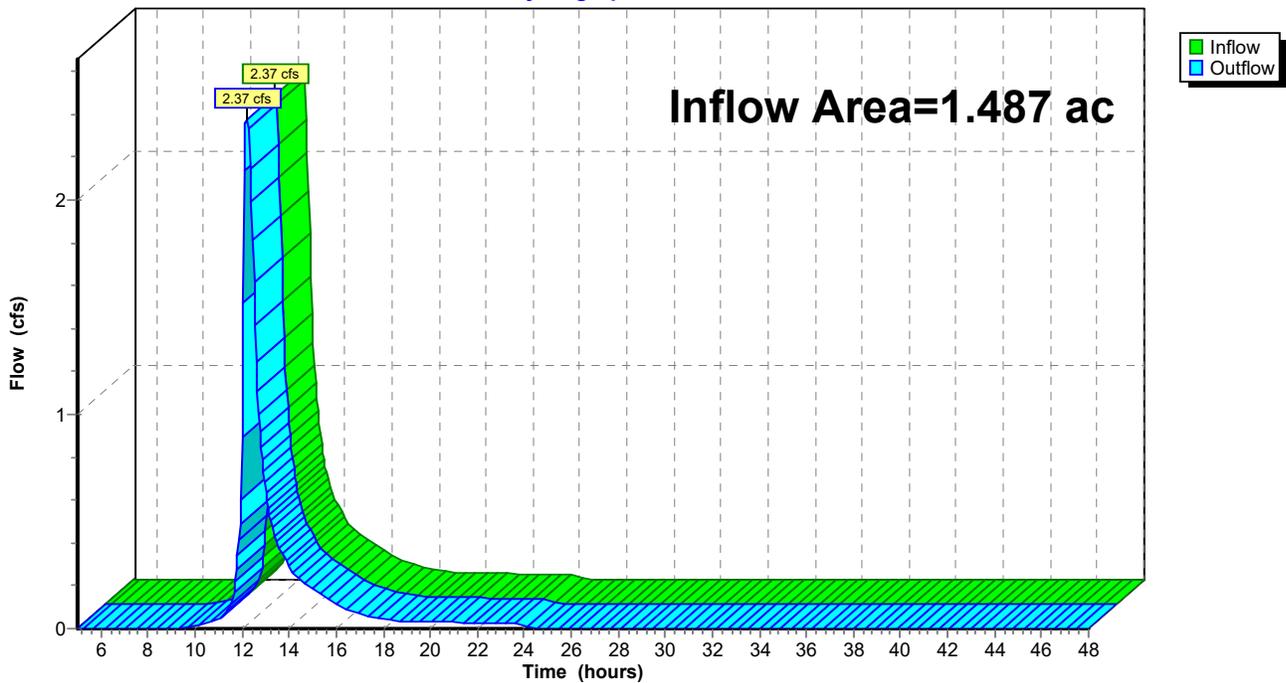

222-182 POST DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Type III 24-hr 10-Year Rainfall=4.90"

Printed 3/27/2023

Page 26

Summary for Reach DP-2: FRONT PROPERTY LINE/WASHINGTON ST.


[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 0.090 ac, 74.17% Impervious, Inflow Depth > 3.98" for 10-Year event
Inflow = 0.39 cfs @ 12.09 hrs, Volume= 0.030 af
Outflow = 0.39 cfs @ 12.09 hrs, Volume= 0.030 af, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs

Reach DP-2: FRONT PROPERTY LINE/WASHINGTON ST.

Hydrograph

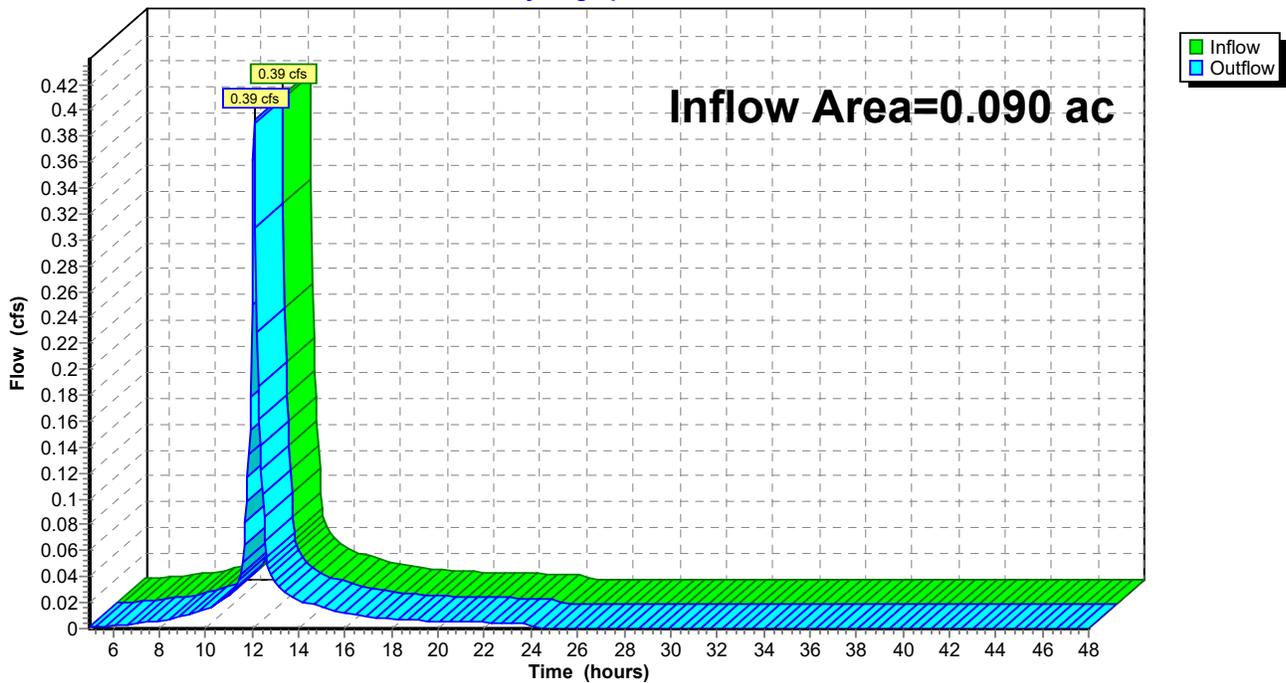

222-182 POST DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Type III 24-hr 10-Year Rainfall=4.90"

Printed 3/27/2023

Page 27

Summary for Reach DP-3: SOUTHERN PROPERTY LINE


[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 0.067 ac, 0.00% Impervious, Inflow Depth = 2.28" for 10-Year event
Inflow = 0.18 cfs @ 12.10 hrs, Volume= 0.013 af
Outflow = 0.18 cfs @ 12.10 hrs, Volume= 0.013 af, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs

Reach DP-3: SOUTHERN PROPERTY LINE

Hydrograph

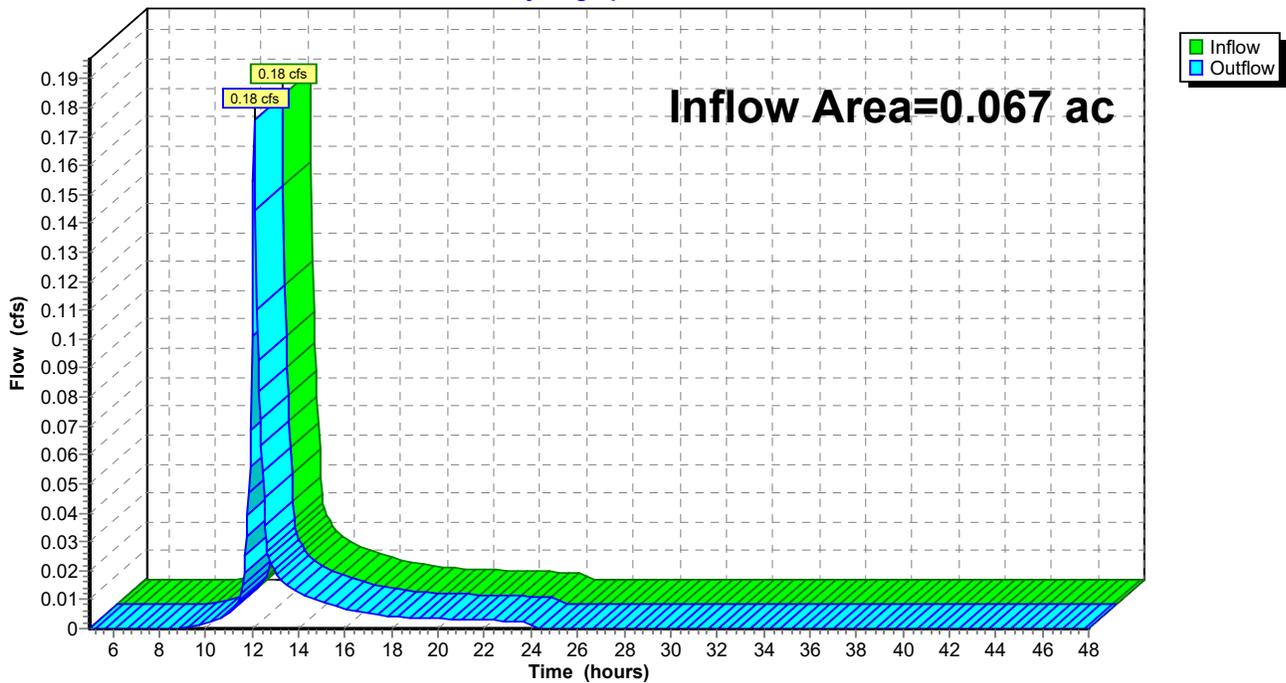

222-182 POST DEVELOPMENT

Type III 24-hr 10-Year Rainfall=4.90"

Prepared by McKenzie Engineering Group, Inc.

Printed 3/27/2023

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Page 28

Summary for Pond 2P: SUBSURFACE INFILTRATION SYSTEM

[82] Warning: Early inflow requires earlier time span

Inflow Area = 0.864 ac, 84.39% Impervious, Inflow Depth > 4.19" for 10-Year event
 Inflow = 3.86 cfs @ 12.09 hrs, Volume= 0.302 af
 Outflow = 1.64 cfs @ 12.29 hrs, Volume= 0.302 af, Atten= 58%, Lag= 12.3 min
 Discarded = 0.10 cfs @ 9.40 hrs, Volume= 0.181 af
 Primary = 1.54 cfs @ 12.29 hrs, Volume= 0.121 af
 Routed to Reach DP-1 : WETLAND

Routing by Dyn-Stor-Ind method, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs
 Peak Elev= 102.29' @ 12.29 hrs Surf.Area= 4,182 sf Storage= 4,598 cf

Plug-Flow detention time= 178.4 min calculated for 0.301 af (100% of inflow)
 Center-of-Mass det. time= 178.6 min (954.4 - 775.8)

Volume	Invert	Avail.Storage	Storage Description
#1A	100.60'	2,974 cf	30.75"W x 136.00'L x 2.54'H Field A 10,629 cf Overall - 3,195 cf Embedded = 7,435 cf x 40.0% Voids
#2A	101.10'	3,195 cf	Cultec R-150XLHD x 117 Inside #1 Effective Size= 29.8"W x 18.0"H => 2.65 sf x 10.25'L = 27.2 cf Overall Size= 33.0"W x 18.5"H x 11.00'L with 0.75' Overlap Row Length Adjustment= +0.75' x 2.65 sf x 9 rows
		6,169 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Discarded	100.60'	1.020 in/hr Exfiltration over Surface area
#2	Primary	101.64'	15.0" Round Culvert L= 20.0' RCP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 101.64' / 101.41' S= 0.0115 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

Discarded OutFlow Max=0.10 cfs @ 9.40 hrs HW=100.63' (Free Discharge)

↑1=Exfiltration (Exfiltration Controls 0.10 cfs)

Primary OutFlow Max=1.53 cfs @ 12.29 hrs HW=102.29' TW=0.00' (Dynamic Tailwater)

↑2=Culvert (Barrel Controls 1.53 cfs @ 3.48 fps)

222-182 POST DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Type III 24-hr 10-Year Rainfall=4.90"

Printed 3/27/2023

Page 29

Pond 2P: SUBSURFACE INFILTRATION SYSTEM - Chamber Wizard Field A

Chamber Model = Cultec R-150XLHD (Cultec Recharger® 150XLHD)

Effective Size= 29.8"W x 18.0"H => 2.65 sf x 10.25'L = 27.2 cf

Overall Size= 33.0"W x 18.5"H x 11.00'L with 0.75' Overlap

Row Length Adjustment= +0.75' x 2.65 sf x 9 rows

33.0" Wide + 6.0" Spacing = 39.0" C-C Row Spacing

13 Chambers/Row x 10.25' Long +0.75' Row Adjustment = 134.00' Row Length +12.0" End Stone x 2 = 136.00' Base Length

9 Rows x 33.0" Wide + 6.0" Spacing x 8 + 12.0" Side Stone x 2 = 30.75' Base Width

6.0" Stone Base + 18.5" Chamber Height + 6.0" Stone Cover = 2.54' Field Height

117 Chambers x 27.2 cf +0.75' Row Adjustment x 2.65 sf x 9 Rows = 3,194.7 cf Chamber Storage

10,629.3 cf Field - 3,194.7 cf Chambers = 7,434.6 cf Stone x 40.0% Voids = 2,973.8 cf Stone Storage

Chamber Storage + Stone Storage = 6,168.5 cf = 0.142 af


Overall Storage Efficiency = 58.0%

Overall System Size = 136.00' x 30.75' x 2.54'

117 Chambers

393.7 cy Field

275.4 cy Stone

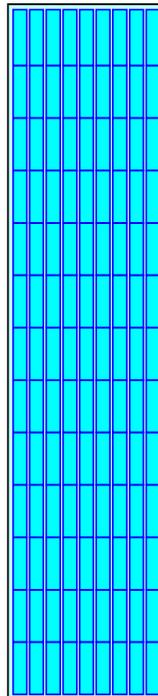

222-182 POST DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC


Type III 24-hr 10-Year Rainfall=4.90"

Printed 3/27/2023

Page 30

Pond 2P: SUBSURFACE INFILTRATION SYSTEM

Hydrograph

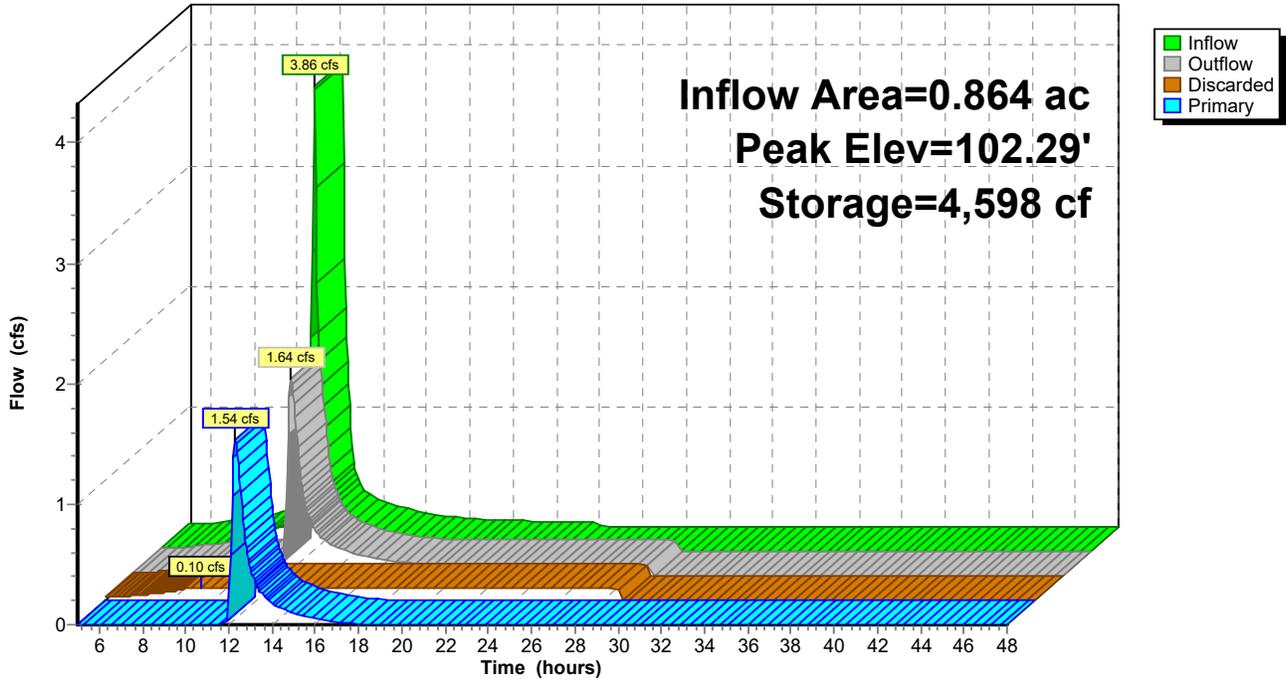

222-182 POST DEVELOPMENT

Type III 24-hr 25-Year Rainfall=6.14"

Prepared by McKenzie Engineering Group, Inc.

Printed 3/27/2023

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Page 31

Time span=5.00-48.00 hrs, dt=0.05 hrs, 861 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

Subcatchment1S: CENTRAL SITE Runoff Area=23,734 sf 75.25% Impervious Runoff Depth>5.18"
Tc=6.0 min CN=92 Runoff=3.04 cfs 0.235 af

Subcatchment1SB: BUILDING Runoff Area=13,890 sf 100.00% Impervious Runoff Depth>5.73"
Tc=6.0 min CN=98 Runoff=1.87 cfs 0.152 af

Subcatchment2S: FRONT SITE Runoff Area=3,934 sf 74.17% Impervious Runoff Depth>5.18"
Tc=6.0 min CN=92 Runoff=0.50 cfs 0.039 af

Subcatchment3S: SOUTH SITE Runoff Area=2,928 sf 0.00% Impervious Runoff Depth=3.30"
Tc=6.0 min CN=74 Runoff=0.26 cfs 0.019 af

Subcatchment4S: WETLAND BUFFER Runoff Area=27,141 sf 4.01% Impervious Runoff Depth=3.21"
Tc=6.0 min CN=73 Runoff=2.30 cfs 0.166 af

Reach DP-1: WETLAND Inflow=4.66 cfs 0.360 af
Outflow=4.66 cfs 0.360 af

Reach DP-2: FRONT PROPERTY LINE/WASHINGTONST. Inflow=0.50 cfs 0.039 af
Outflow=0.50 cfs 0.039 af

Reach DP-3: SOUTHERN PROPERTY LINE Inflow=0.26 cfs 0.019 af
Outflow=0.26 cfs 0.019 af

Pond 2P: SUBSURFACE INFILTRATION Peak Elev=102.61' Storage=5,283 cf Inflow=4.92 cfs 0.387 af
Discarded=0.10 cfs 0.194 af Primary=2.97 cfs 0.193 af Outflow=3.07 cfs 0.388 af

Total Runoff Area = 1.644 ac Runoff Volume = 0.611 af Average Runoff Depth = 4.46"
50.08% Pervious = 0.823 ac 49.92% Impervious = 0.821 ac

222-182 POST DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Type III 24-hr 25-Year Rainfall=6.14"

Printed 3/27/2023

Page 32

Summary for Subcatchment 1S: CENTRAL SITE

Runoff = 3.04 cfs @ 12.09 hrs, Volume= 0.235 af, Depth> 5.18"

Routed to Pond 2P : SUBSURFACE INFILTRATION SYSTEM


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs
Type III 24-hr 25-Year Rainfall=6.14"

Area (sf)	CN	Description
17,794	98	Paved parking, HSG C
5,873	74	>75% Grass cover, Good, HSG C
67	98	Unconnected pavement, HSG C
23,734	92	Weighted Average
5,873		24.75% Pervious Area
17,861		75.25% Impervious Area
67		0.38% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, DIRECT ENTRY

Subcatchment 1S: CENTRAL SITE

Hydrograph

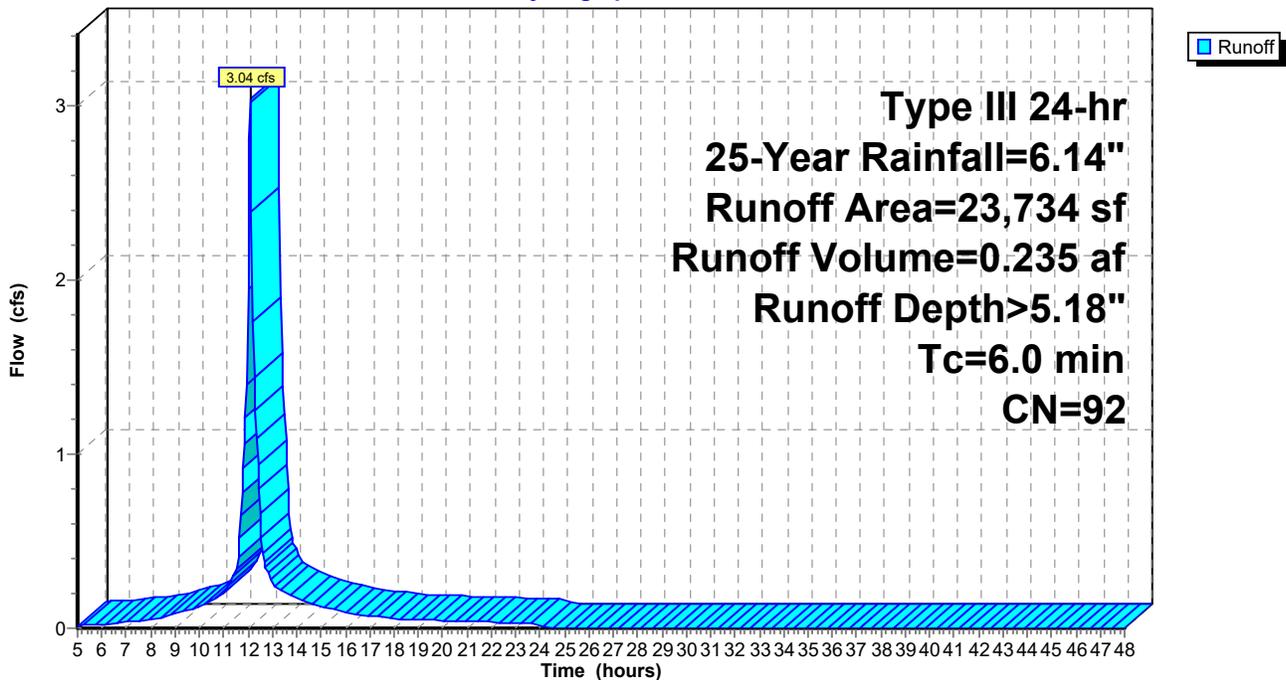

222-182 POST DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Type III 24-hr 25-Year Rainfall=6.14"

Printed 3/27/2023

Page 33

Summary for Subcatchment 1SB: BUILDING

Runoff = 1.87 cfs @ 12.09 hrs, Volume= 0.152 af, Depth> 5.73"

Routed to Pond 2P : SUBSURFACE INFILTRATION SYSTEM


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs
Type III 24-hr 25-Year Rainfall=6.14"

Area (sf)	CN	Description
13,890	98	Roofs, HSG C
13,890		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, DIRECT ENTRY

Subcatchment 1SB: BUILDING

Hydrograph

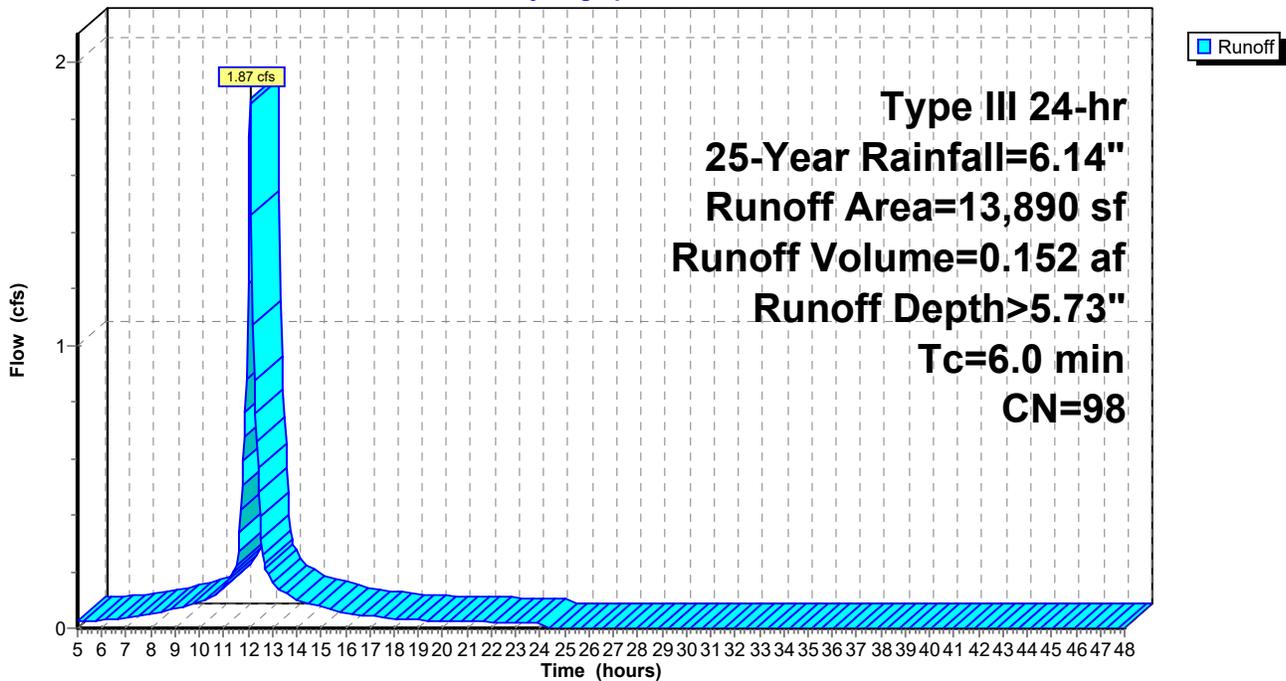

222-182 POST DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Type III 24-hr 25-Year Rainfall=6.14"

Printed 3/27/2023

Page 34

Summary for Subcatchment 2S: FRONT SITE

Runoff = 0.50 cfs @ 12.09 hrs, Volume= 0.039 af, Depth> 5.18"

Routed to Reach DP-2 : FRONT PROPERTY LINE/WASHINGTON ST.


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs
 Type III 24-hr 25-Year Rainfall=6.14"

Area (sf)	CN	Description
2,918	98	Paved parking, HSG C
1,016	74	>75% Grass cover, Good, HSG C
3,934	92	Weighted Average
1,016		25.83% Pervious Area
2,918		74.17% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, DIRECT ENTRY

Subcatchment 2S: FRONT SITE

Hydrograph

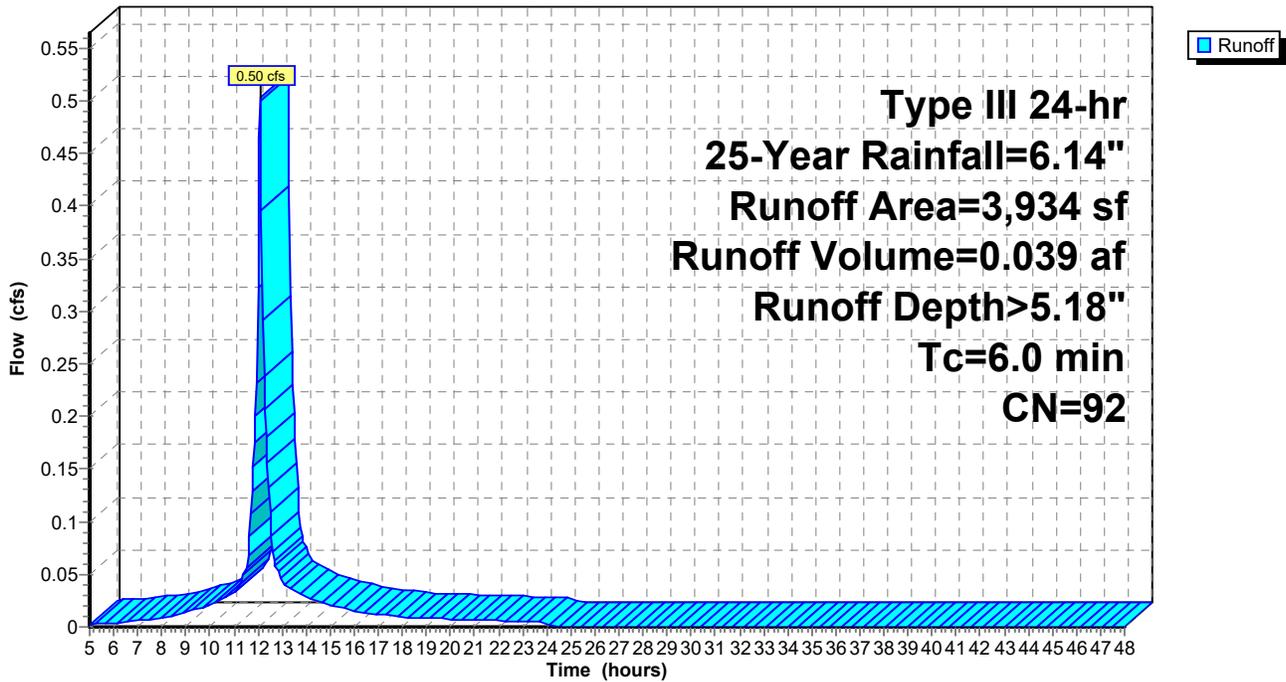

222-182 POST DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Type III 24-hr 25-Year Rainfall=6.14"

Printed 3/27/2023

Page 35

Summary for Subcatchment 3S: SOUTH SITE

Runoff = 0.26 cfs @ 12.09 hrs, Volume= 0.019 af, Depth= 3.30"

Routed to Reach DP-3 : SOUTHERN PROPERTY LINE


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs
 Type III 24-hr 25-Year Rainfall=6.14"

Area (sf)	CN	Description
215	70	Woods, Good, HSG C
2,713	74	>75% Grass cover, Good, HSG C
2,928	74	Weighted Average
2,928		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, DIRECT ENTRY

Subcatchment 3S: SOUTH SITE

Hydrograph

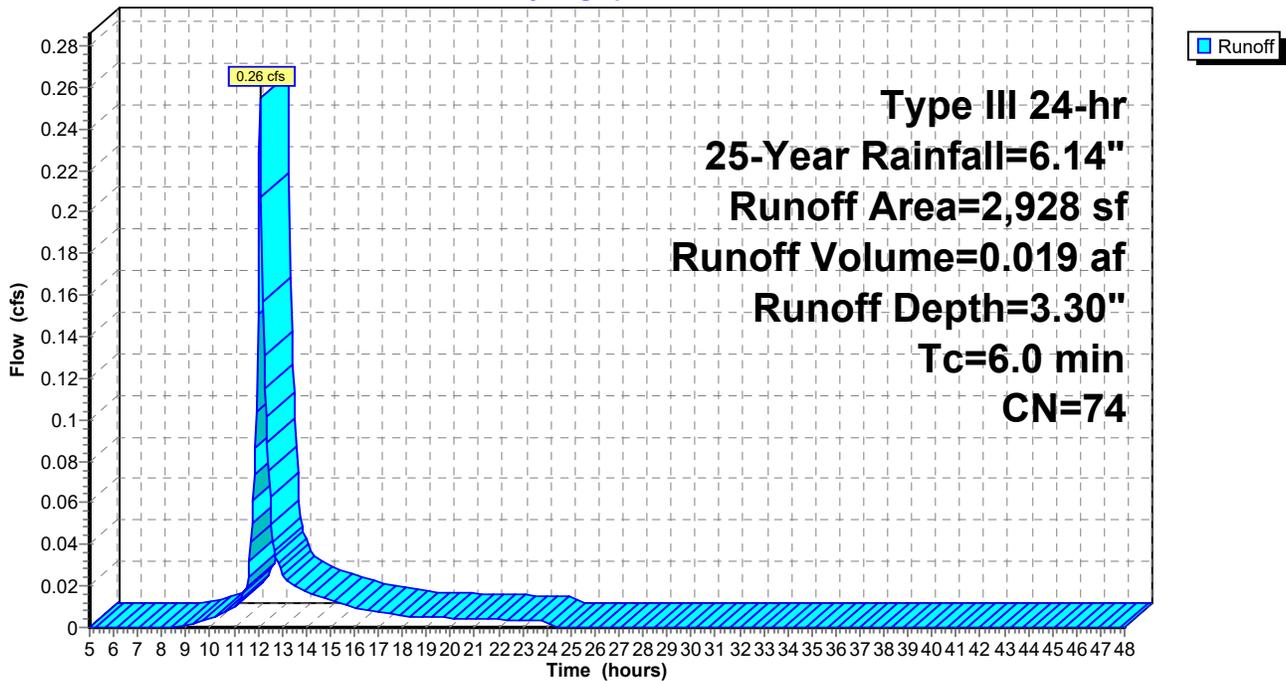

222-182 POST DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Type III 24-hr 25-Year Rainfall=6.14"

Printed 3/27/2023

Page 36

Summary for Subcatchment 4S: WETLAND BUFFER

Runoff = 2.30 cfs @ 12.09 hrs, Volume= 0.166 af, Depth= 3.21"
 Routed to Reach DP-1 : WETLAND


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs
 Type III 24-hr 25-Year Rainfall=6.14"

Area (sf)	CN	Description
15,103	74	>75% Grass cover, Good, HSG C
10,951	70	Woods, Good, HSG C
1,087	98	Unconnected pavement, HSG C
27,141	73	Weighted Average
26,054		95.99% Pervious Area
1,087		4.01% Impervious Area
1,087		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, DIRECT ENTRY

Subcatchment 4S: WETLAND BUFFER

Hydrograph

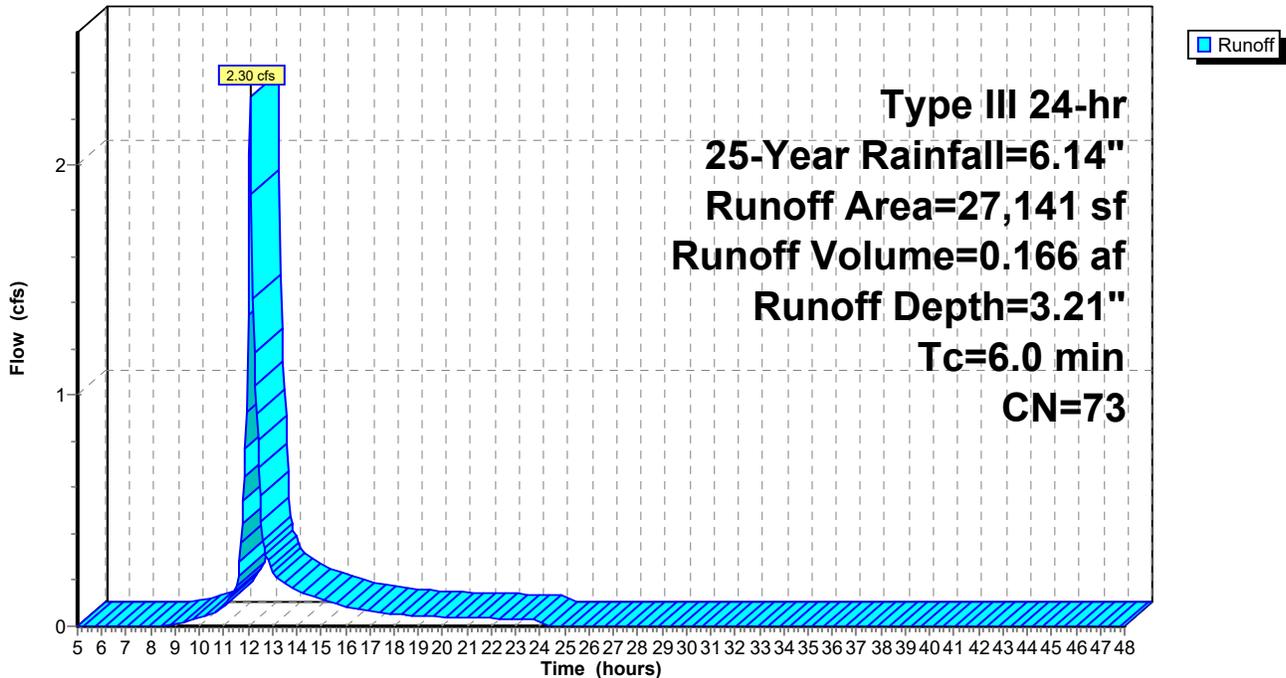

222-182 POST DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Type III 24-hr 25-Year Rainfall=6.14"

Printed 3/27/2023

Page 37

Summary for Reach DP-1: WETLAND


[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 1.487 ac, 50.70% Impervious, Inflow Depth = 2.90" for 25-Year event
Inflow = 4.66 cfs @ 12.15 hrs, Volume= 0.360 af
Outflow = 4.66 cfs @ 12.15 hrs, Volume= 0.360 af, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs

Reach DP-1: WETLAND

Hydrograph

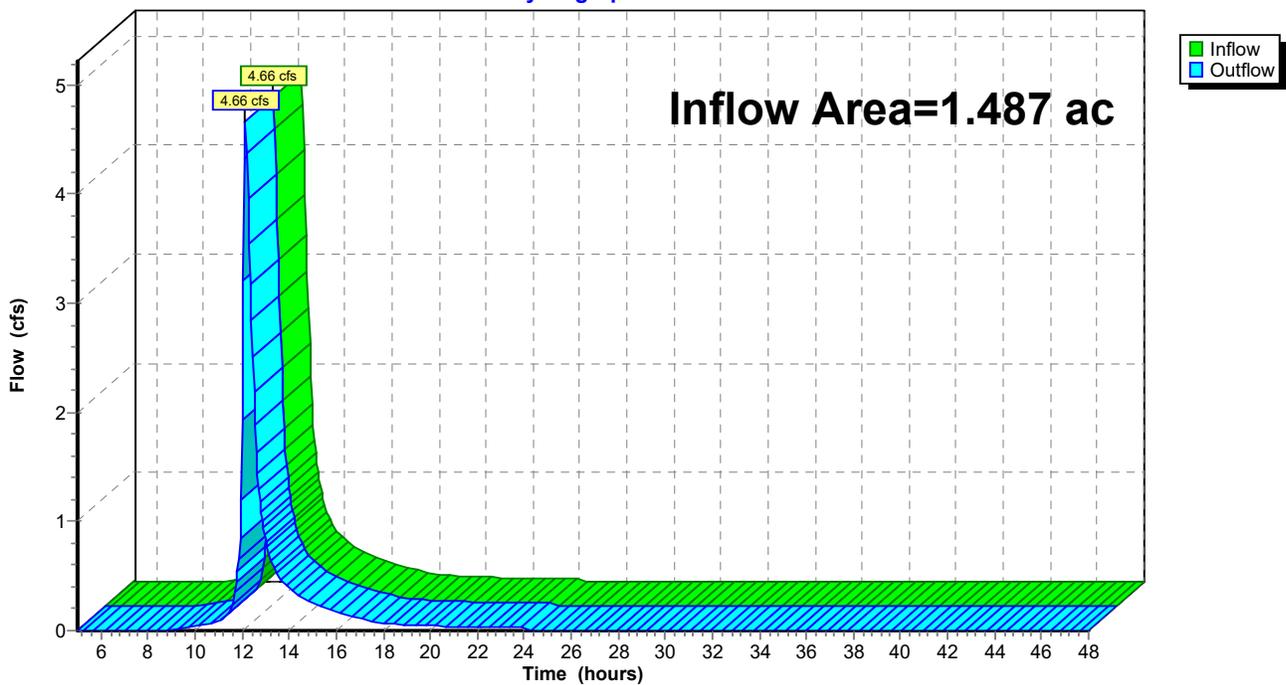

222-182 POST DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Type III 24-hr 25-Year Rainfall=6.14"

Printed 3/27/2023

Page 38

Summary for Reach DP-2: FRONT PROPERTY LINE/WASHINGTON ST.


[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 0.090 ac, 74.17% Impervious, Inflow Depth > 5.18" for 25-Year event
Inflow = 0.50 cfs @ 12.09 hrs, Volume= 0.039 af
Outflow = 0.50 cfs @ 12.09 hrs, Volume= 0.039 af, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs

Reach DP-2: FRONT PROPERTY LINE/WASHINGTON ST.

Hydrograph

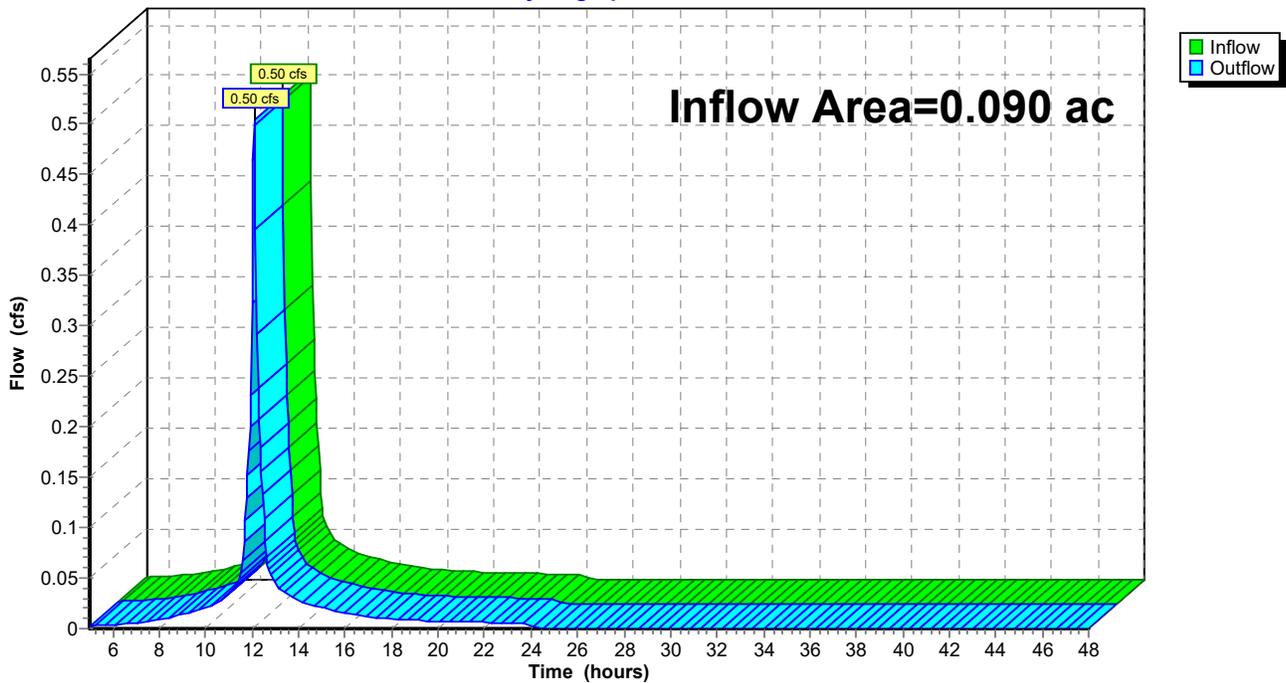

222-182 POST DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Type III 24-hr 25-Year Rainfall=6.14"

Printed 3/27/2023

Page 39

Summary for Reach DP-3: SOUTHERN PROPERTY LINE


[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 0.067 ac, 0.00% Impervious, Inflow Depth = 3.30" for 25-Year event
Inflow = 0.26 cfs @ 12.09 hrs, Volume= 0.019 af
Outflow = 0.26 cfs @ 12.09 hrs, Volume= 0.019 af, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs

Reach DP-3: SOUTHERN PROPERTY LINE

Hydrograph

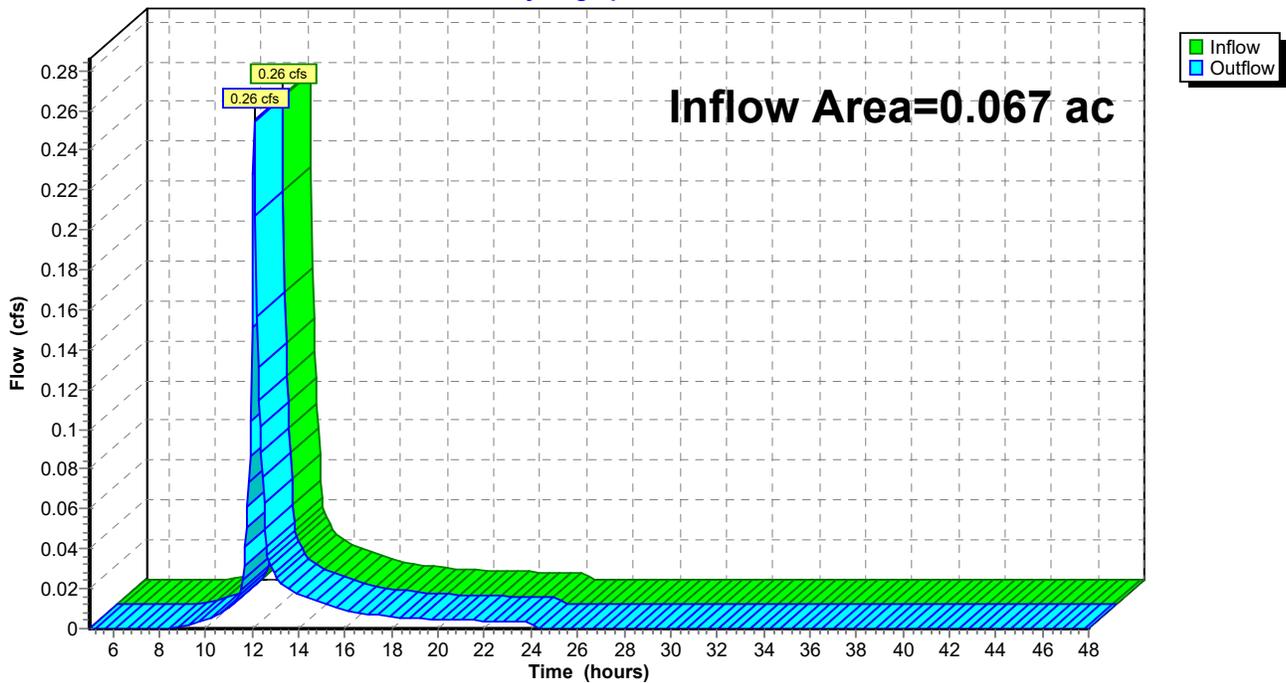

222-182 POST DEVELOPMENT

Type III 24-hr 25-Year Rainfall=6.14"

Prepared by McKenzie Engineering Group, Inc.

Printed 3/27/2023

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Page 40

Summary for Pond 2P: SUBSURFACE INFILTRATION SYSTEM

[82] Warning: Early inflow requires earlier time span

Inflow Area = 0.864 ac, 84.39% Impervious, Inflow Depth > 5.38" for 25-Year event
 Inflow = 4.92 cfs @ 12.09 hrs, Volume= 0.387 af
 Outflow = 3.07 cfs @ 12.20 hrs, Volume= 0.388 af, Atten= 38%, Lag= 6.7 min
 Discarded = 0.10 cfs @ 8.70 hrs, Volume= 0.194 af
 Primary = 2.97 cfs @ 12.20 hrs, Volume= 0.193 af
 Routed to Reach DP-1 : WETLAND

Routing by Dyn-Stor-Ind method, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs
 Peak Elev= 102.61' @ 12.20 hrs Surf.Area= 4,182 sf Storage= 5,283 cf

Plug-Flow detention time= 158.0 min calculated for 0.387 af (100% of inflow)
 Center-of-Mass det. time= 158.4 min (930.6 - 772.1)

Volume	Invert	Avail.Storage	Storage Description
#1A	100.60'	2,974 cf	30.75"W x 136.00'L x 2.54'H Field A 10,629 cf Overall - 3,195 cf Embedded = 7,435 cf x 40.0% Voids
#2A	101.10'	3,195 cf	Cultec R-150XLHD x 117 Inside #1 Effective Size= 29.8"W x 18.0"H => 2.65 sf x 10.25'L = 27.2 cf Overall Size= 33.0"W x 18.5"H x 11.00'L with 0.75' Overlap Row Length Adjustment= +0.75' x 2.65 sf x 9 rows
		6,169 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Discarded	100.60'	1.020 in/hr Exfiltration over Surface area
#2	Primary	101.64'	15.0" Round Culvert L= 20.0' RCP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 101.64' / 101.41' S= 0.0115 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

Discarded OutFlow Max=0.10 cfs @ 8.70 hrs HW=100.63' (Free Discharge)

↑1=Exfiltration (Exfiltration Controls 0.10 cfs)

Primary OutFlow Max=2.96 cfs @ 12.20 hrs HW=102.61' TW=0.00' (Dynamic Tailwater)

↑2=Culvert (Barrel Controls 2.96 cfs @ 3.99 fps)

222-182 POST DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Type III 24-hr 25-Year Rainfall=6.14"

Printed 3/27/2023

Page 41

Pond 2P: SUBSURFACE INFILTRATION SYSTEM - Chamber Wizard Field A

Chamber Model = Cultec R-150XLHD (Cultec Recharger® 150XLHD)

Effective Size= 29.8"W x 18.0"H => 2.65 sf x 10.25'L = 27.2 cf

Overall Size= 33.0"W x 18.5"H x 11.00'L with 0.75' Overlap

Row Length Adjustment= +0.75' x 2.65 sf x 9 rows

33.0" Wide + 6.0" Spacing = 39.0" C-C Row Spacing

13 Chambers/Row x 10.25' Long +0.75' Row Adjustment = 134.00' Row Length +12.0" End Stone x 2 = 136.00' Base Length

9 Rows x 33.0" Wide + 6.0" Spacing x 8 + 12.0" Side Stone x 2 = 30.75' Base Width

6.0" Stone Base + 18.5" Chamber Height + 6.0" Stone Cover = 2.54' Field Height

117 Chambers x 27.2 cf +0.75' Row Adjustment x 2.65 sf x 9 Rows = 3,194.7 cf Chamber Storage

10,629.3 cf Field - 3,194.7 cf Chambers = 7,434.6 cf Stone x 40.0% Voids = 2,973.8 cf Stone Storage

Chamber Storage + Stone Storage = 6,168.5 cf = 0.142 af


Overall Storage Efficiency = 58.0%

Overall System Size = 136.00' x 30.75' x 2.54'

117 Chambers

393.7 cy Field

275.4 cy Stone

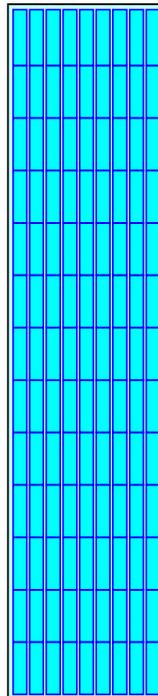

222-182 POST DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC


Type III 24-hr 25-Year Rainfall=6.14"

Printed 3/27/2023

Page 42

Pond 2P: SUBSURFACE INFILTRATION SYSTEM

Hydrograph

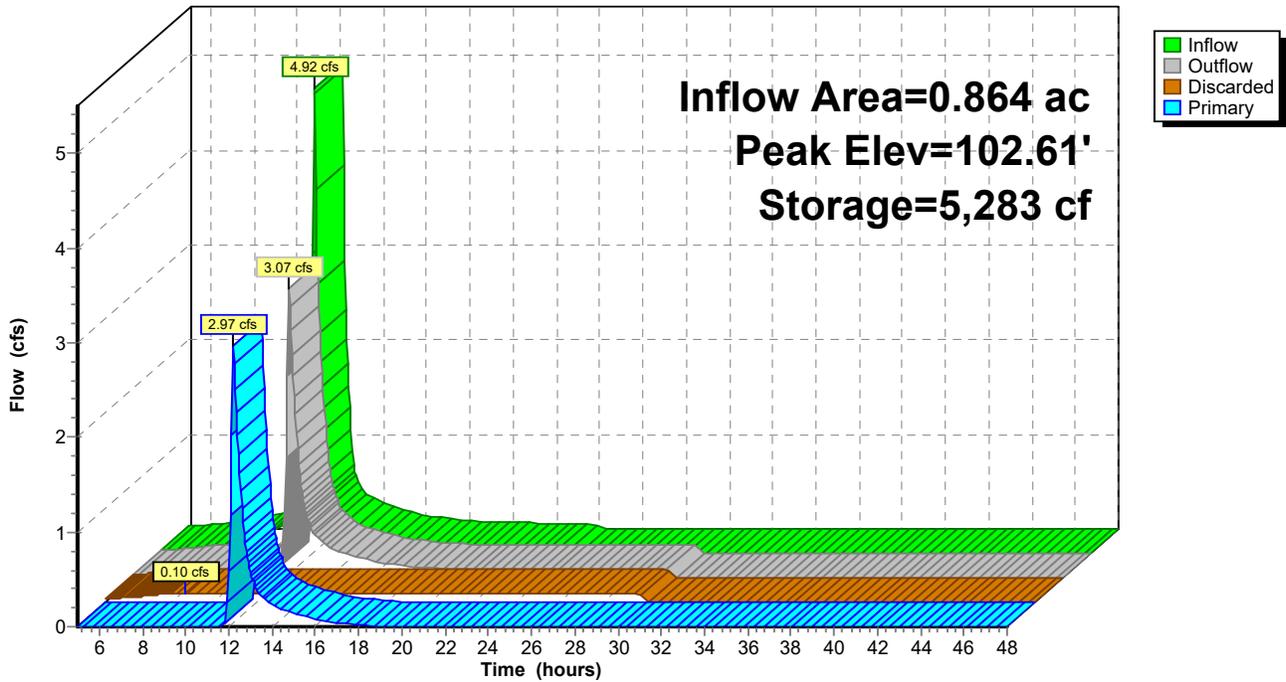

222-182 POST DEVELOPMENT

Type III 24-hr 100-Year Rainfall=8.65"

Prepared by McKenzie Engineering Group, Inc.

Printed 3/27/2023

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Page 43

Time span=5.00-48.00 hrs, dt=0.05 hrs, 861 points
 Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
 Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

Subcatchment1S: CENTRAL SITE Runoff Area=23,734 sf 75.25% Impervious Runoff Depth>7.61"
 Tc=6.0 min CN=92 Runoff=4.39 cfs 0.346 af

Subcatchment1SB: BUILDING Runoff Area=13,890 sf 100.00% Impervious Runoff Depth>8.11"
 Tc=6.0 min CN=98 Runoff=2.65 cfs 0.216 af

Subcatchment2S: FRONT SITE Runoff Area=3,934 sf 74.17% Impervious Runoff Depth>7.61"
 Tc=6.0 min CN=92 Runoff=0.73 cfs 0.057 af

Subcatchment3S: SOUTH SITE Runoff Area=2,928 sf 0.00% Impervious Runoff Depth=5.51"
 Tc=6.0 min CN=74 Runoff=0.42 cfs 0.031 af

Subcatchment4S: WETLAND BUFFER Runoff Area=27,141 sf 4.01% Impervious Runoff Depth=5.39"
 Tc=6.0 min CN=73 Runoff=3.84 cfs 0.280 af

Reach DP-1: WETLAND Inflow=8.75 cfs 0.629 af
 Outflow=8.75 cfs 0.629 af

Reach DP-2: FRONT PROPERTY LINE/WASHINGTONST. Inflow=0.73 cfs 0.057 af
 Outflow=0.73 cfs 0.057 af

Reach DP-3: SOUTHERN PROPERTY LINE Inflow=0.42 cfs 0.031 af
 Outflow=0.42 cfs 0.031 af

Pond 2P: SUBSURFACE INFILTRATION Peak Elev=103.13' Storage=6,153 cf Inflow=7.04 cfs 0.561 af
 Discarded=0.10 cfs 0.212 af Primary=5.29 cfs 0.350 af Outflow=5.39 cfs 0.561 af

Total Runoff Area = 1.644 ac Runoff Volume = 0.929 af Average Runoff Depth = 6.78"
50.08% Pervious = 0.823 ac 49.92% Impervious = 0.821 ac

222-182 POST DEVELOPMENT

Type III 24-hr 100-Year Rainfall=8.65"

Prepared by McKenzie Engineering Group, Inc.

Printed 3/27/2023

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Page 44

Summary for Subcatchment 1S: CENTRAL SITE

Runoff = 4.39 cfs @ 12.09 hrs, Volume= 0.346 af, Depth> 7.61"

Routed to Pond 2P : SUBSURFACE INFILTRATION SYSTEM


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs
Type III 24-hr 100-Year Rainfall=8.65"

Area (sf)	CN	Description
17,794	98	Paved parking, HSG C
5,873	74	>75% Grass cover, Good, HSG C
67	98	Unconnected pavement, HSG C
23,734	92	Weighted Average
5,873		24.75% Pervious Area
17,861		75.25% Impervious Area
67		0.38% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, DIRECT ENTRY

Subcatchment 1S: CENTRAL SITE

Hydrograph

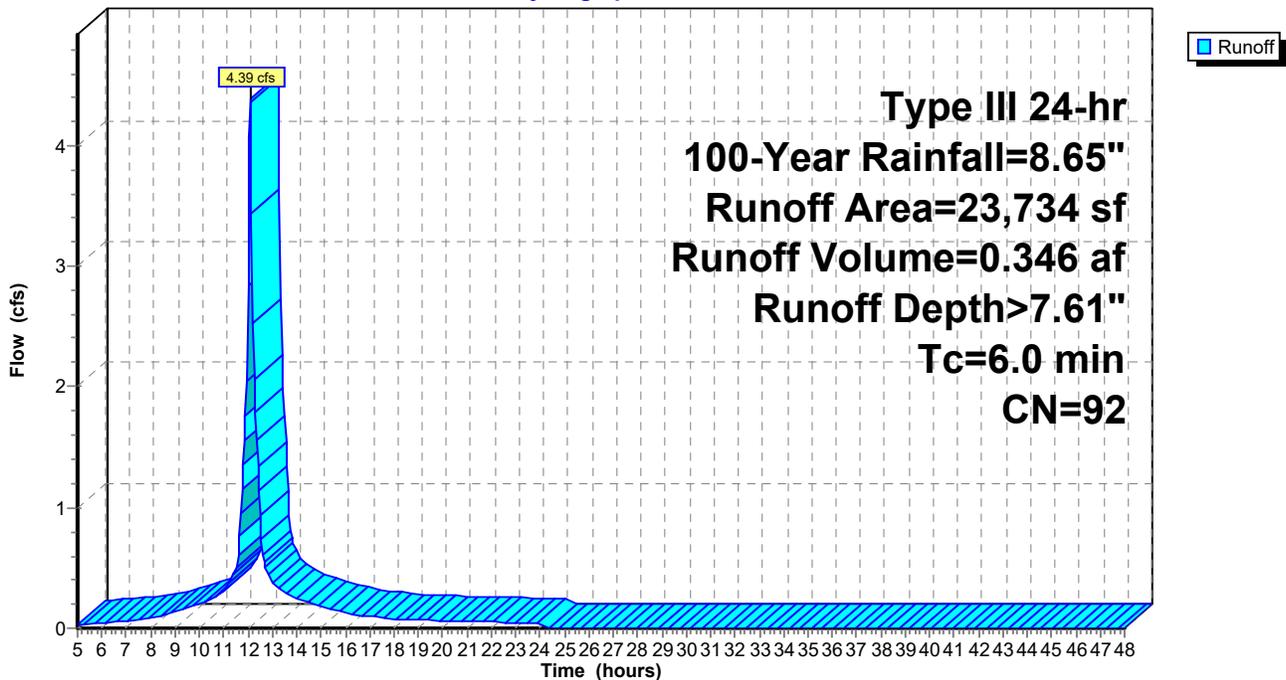

222-182 POST DEVELOPMENT

Type III 24-hr 100-Year Rainfall=8.65"

Prepared by McKenzie Engineering Group, Inc.

Printed 3/27/2023

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Page 45

Summary for Subcatchment 1SB: BUILDING

Runoff = 2.65 cfs @ 12.09 hrs, Volume= 0.216 af, Depth> 8.11"

Routed to Pond 2P : SUBSURFACE INFILTRATION SYSTEM


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs
Type III 24-hr 100-Year Rainfall=8.65"

Area (sf)	CN	Description
13,890	98	Roofs, HSG C
13,890		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, DIRECT ENTRY

Subcatchment 1SB: BUILDING

Hydrograph

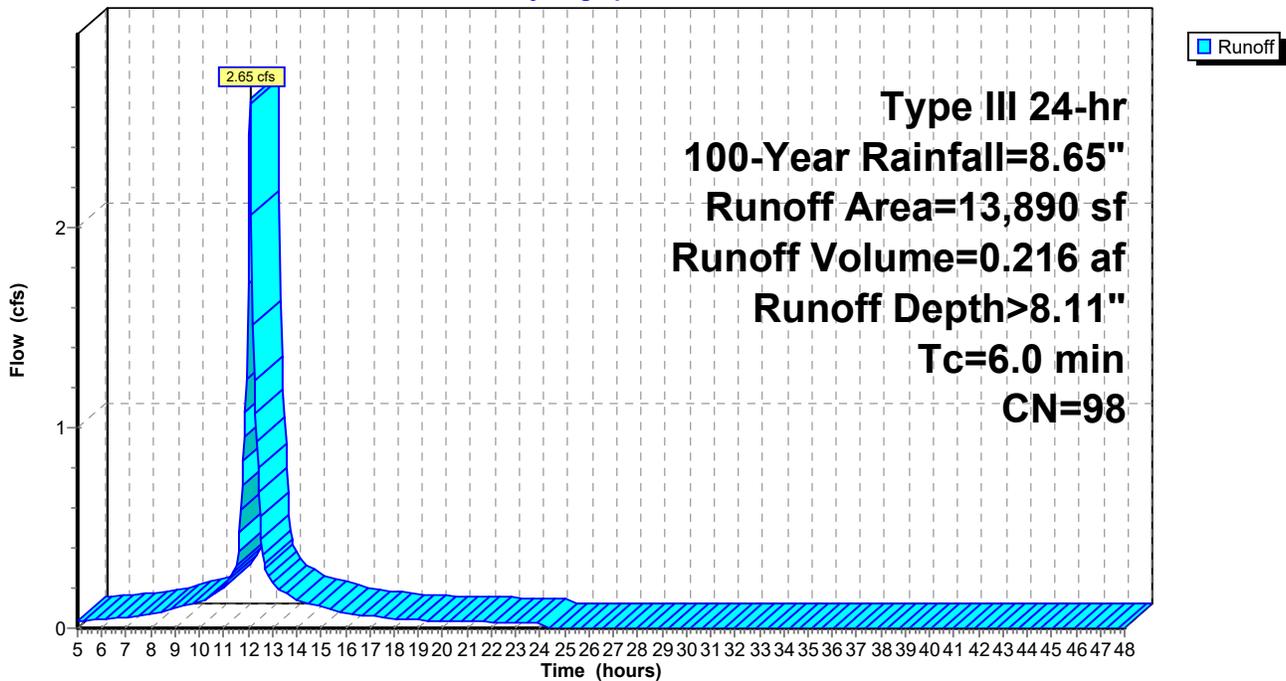

222-182 POST DEVELOPMENT

Type III 24-hr 100-Year Rainfall=8.65"

Prepared by McKenzie Engineering Group, Inc.

Printed 3/27/2023

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Page 46

Summary for Subcatchment 2S: FRONT SITE

Runoff = 0.73 cfs @ 12.09 hrs, Volume= 0.057 af, Depth> 7.61"
 Routed to Reach DP-2 : FRONT PROPERTY LINE/WASHINGTON ST.


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs
 Type III 24-hr 100-Year Rainfall=8.65"

Area (sf)	CN	Description
2,918	98	Paved parking, HSG C
1,016	74	>75% Grass cover, Good, HSG C
3,934	92	Weighted Average
1,016		25.83% Pervious Area
2,918		74.17% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, DIRECT ENTRY

Subcatchment 2S: FRONT SITE

Hydrograph

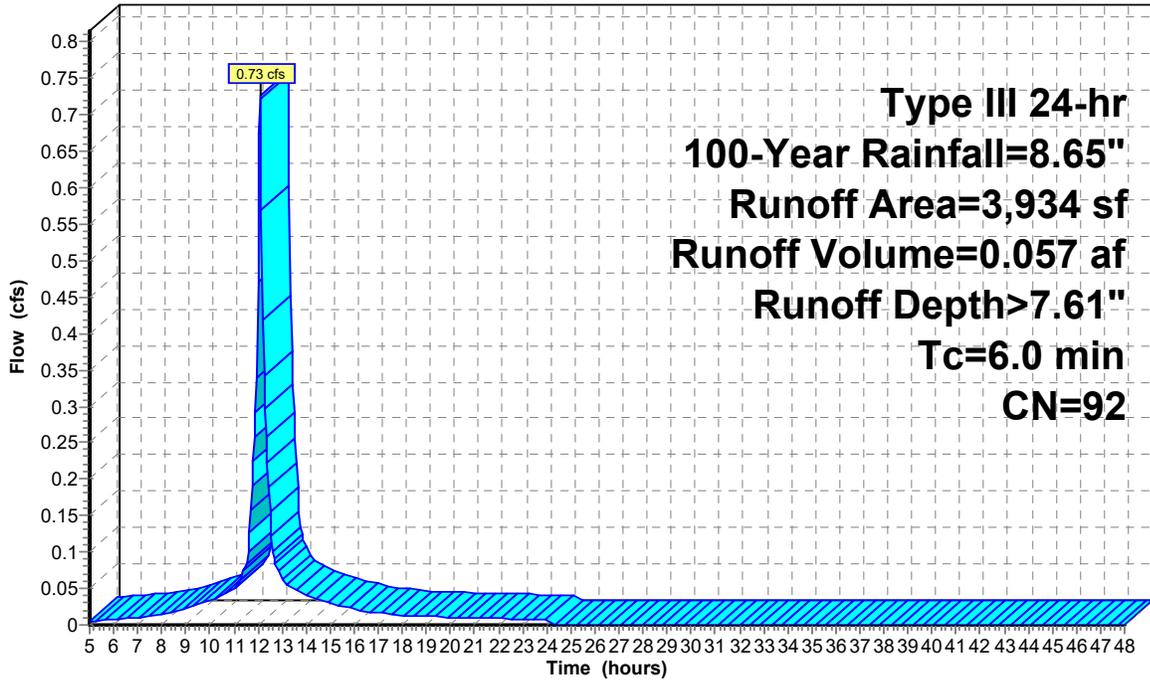

222-182 POST DEVELOPMENT

Type III 24-hr 100-Year Rainfall=8.65"

Prepared by McKenzie Engineering Group, Inc.

Printed 3/27/2023

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Page 47

Summary for Subcatchment 3S: SOUTH SITE

Runoff = 0.42 cfs @ 12.09 hrs, Volume= 0.031 af, Depth= 5.51"

Routed to Reach DP-3 : SOUTHERN PROPERTY LINE


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs
Type III 24-hr 100-Year Rainfall=8.65"

Area (sf)	CN	Description
215	70	Woods, Good, HSG C
2,713	74	>75% Grass cover, Good, HSG C
2,928	74	Weighted Average
2,928		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, DIRECT ENTRY

Subcatchment 3S: SOUTH SITE

Hydrograph

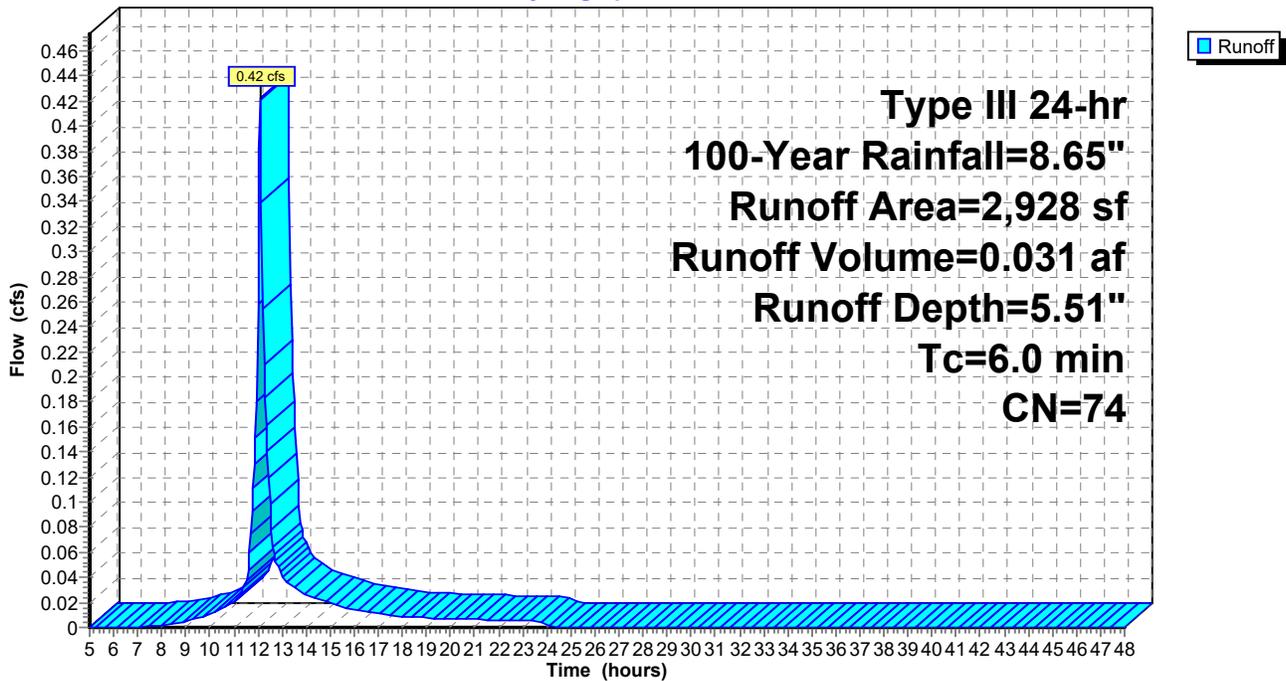

222-182 POST DEVELOPMENT

Type III 24-hr 100-Year Rainfall=8.65"

Prepared by McKenzie Engineering Group, Inc.

Printed 3/27/2023

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Page 48

Summary for Subcatchment 4S: WETLAND BUFFER

Runoff = 3.84 cfs @ 12.09 hrs, Volume= 0.280 af, Depth= 5.39"
 Routed to Reach DP-1 : WETLAND


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs
 Type III 24-hr 100-Year Rainfall=8.65"

Area (sf)	CN	Description
15,103	74	>75% Grass cover, Good, HSG C
10,951	70	Woods, Good, HSG C
1,087	98	Unconnected pavement, HSG C
27,141	73	Weighted Average
26,054		95.99% Pervious Area
1,087		4.01% Impervious Area
1,087		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, DIRECT ENTRY

Subcatchment 4S: WETLAND BUFFER

Hydrograph

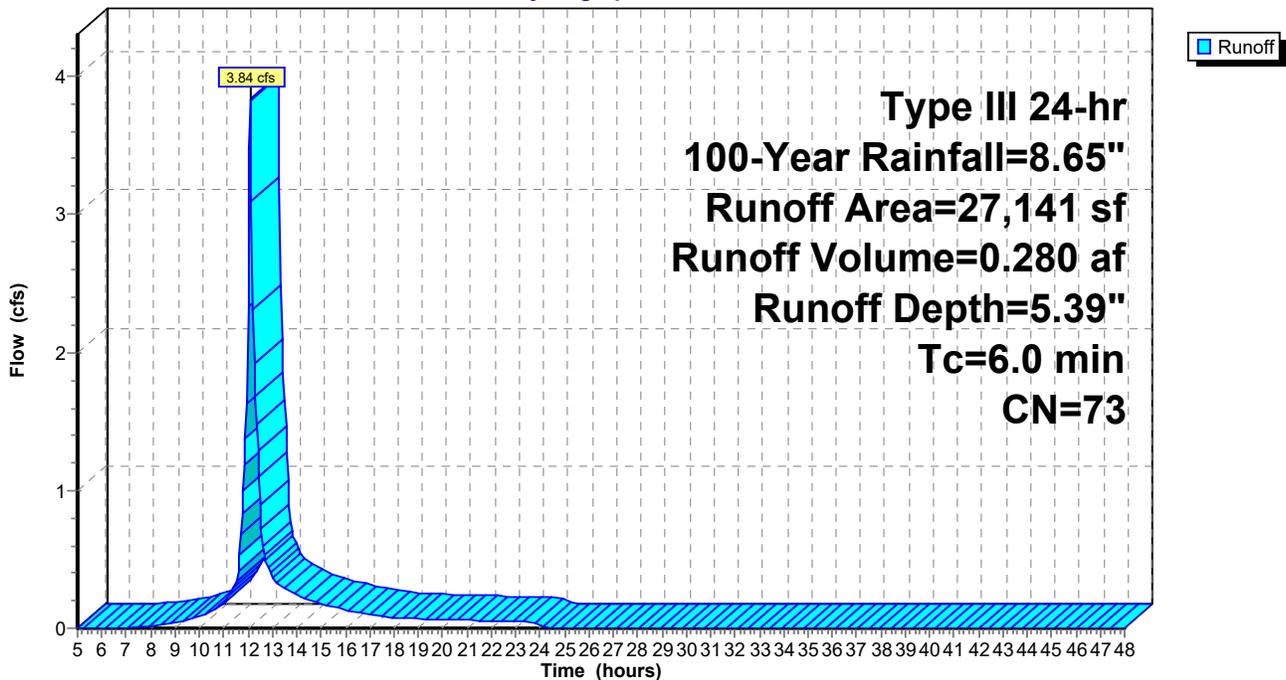

Summary for Reach DP-1: WETLAND


[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 1.487 ac, 50.70% Impervious, Inflow Depth = 5.08" for 100-Year event
Inflow = 8.75 cfs @ 12.12 hrs, Volume= 0.629 af
Outflow = 8.75 cfs @ 12.12 hrs, Volume= 0.629 af, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs

Reach DP-1: WETLAND

Hydrograph

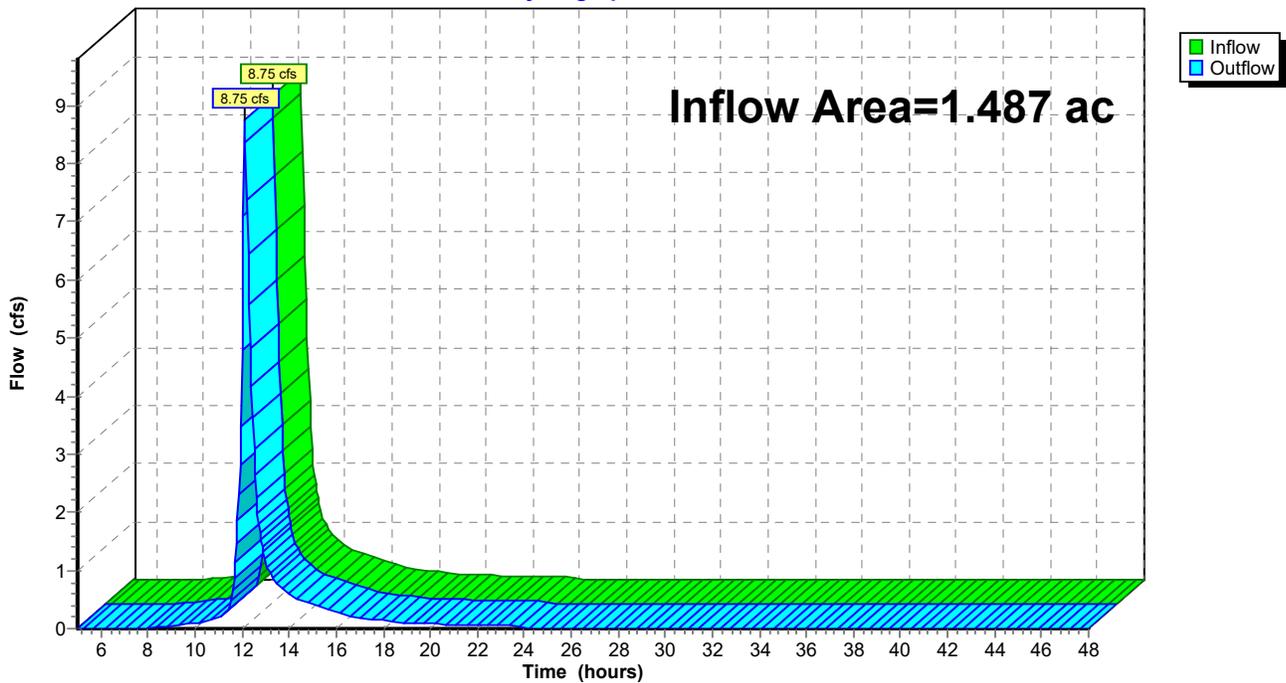

222-182 POST DEVELOPMENT

Type III 24-hr 100-Year Rainfall=8.65"

Prepared by McKenzie Engineering Group, Inc.

Printed 3/27/2023

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Page 50

Summary for Reach DP-2: FRONT PROPERTY LINE/WASHINGTON ST.


[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 0.090 ac, 74.17% Impervious, Inflow Depth > 7.61" for 100-Year event
Inflow = 0.73 cfs @ 12.09 hrs, Volume= 0.057 af
Outflow = 0.73 cfs @ 12.09 hrs, Volume= 0.057 af, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs

Reach DP-2: FRONT PROPERTY LINE/WASHINGTON ST.

Hydrograph

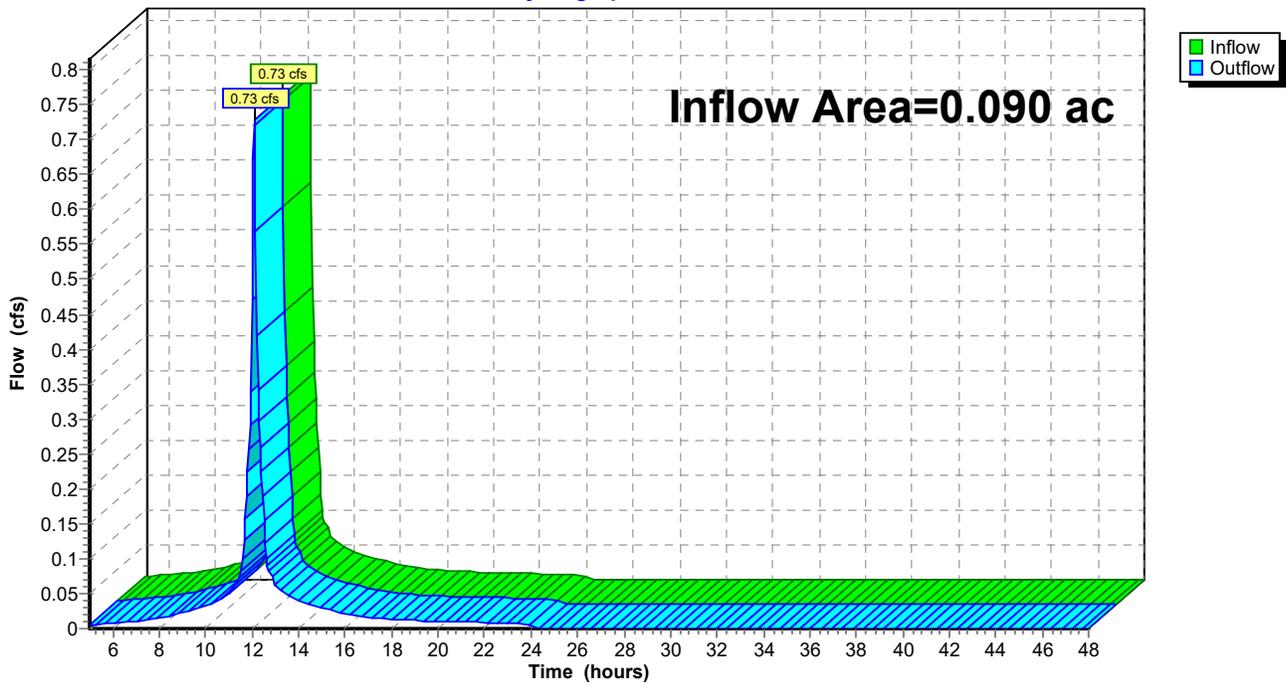

222-182 POST DEVELOPMENT

Type III 24-hr 100-Year Rainfall=8.65"

Prepared by McKenzie Engineering Group, Inc.

Printed 3/27/2023

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Page 51

Summary for Reach DP-3: SOUTHERN PROPERTY LINE


[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 0.067 ac, 0.00% Impervious, Inflow Depth = 5.51" for 100-Year event
Inflow = 0.42 cfs @ 12.09 hrs, Volume= 0.031 af
Outflow = 0.42 cfs @ 12.09 hrs, Volume= 0.031 af, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs

Reach DP-3: SOUTHERN PROPERTY LINE

Hydrograph

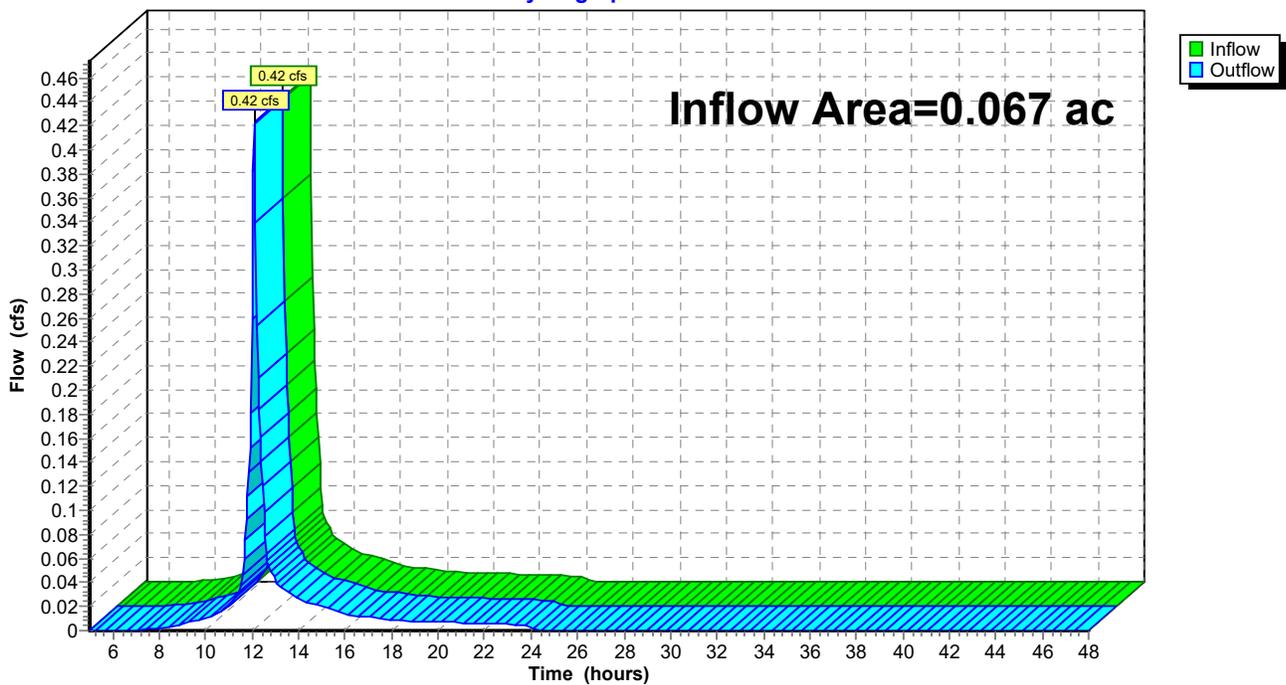

222-182 POST DEVELOPMENT

Type III 24-hr 100-Year Rainfall=8.65"

Prepared by McKenzie Engineering Group, Inc.

Printed 3/27/2023

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Page 52

Summary for Pond 2P: SUBSURFACE INFILTRATION SYSTEM

[82] Warning: Early inflow requires earlier time span

Inflow Area = 0.864 ac, 84.39% Impervious, Inflow Depth > 7.80" for 100-Year event
 Inflow = 7.04 cfs @ 12.09 hrs, Volume= 0.561 af
 Outflow = 5.39 cfs @ 12.16 hrs, Volume= 0.561 af, Atten= 23%, Lag= 4.4 min
 Discarded = 0.10 cfs @ 7.30 hrs, Volume= 0.212 af
 Primary = 5.29 cfs @ 12.16 hrs, Volume= 0.350 af
 Routed to Reach DP-1 : WETLAND

Routing by Dyn-Stor-Ind method, Time Span= 5.00-48.00 hrs, dt= 0.05 hrs
 Peak Elev= 103.13' @ 12.16 hrs Surf.Area= 4,182 sf Storage= 6,153 cf

Plug-Flow detention time= 131.8 min calculated for 0.561 af (100% of inflow)
 Center-of-Mass det. time= 132.3 min (900.0 - 767.7)

Volume	Invert	Avail.Storage	Storage Description
#1A	100.60'	2,974 cf	30.75"W x 136.00'L x 2.54'H Field A 10,629 cf Overall - 3,195 cf Embedded = 7,435 cf x 40.0% Voids
#2A	101.10'	3,195 cf	Cultec R-150XLHD x 117 Inside #1 Effective Size= 29.8"W x 18.0"H => 2.65 sf x 10.25'L = 27.2 cf Overall Size= 33.0"W x 18.5"H x 11.00'L with 0.75' Overlap Row Length Adjustment= +0.75' x 2.65 sf x 9 rows
		6,169 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Discarded	100.60'	1.020 in/hr Exfiltration over Surface area
#2	Primary	101.64'	15.0" Round Culvert L= 20.0' RCP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 101.64' / 101.41' S= 0.0115 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

Discarded OutFlow Max=0.10 cfs @ 7.30 hrs HW=100.63' (Free Discharge)

↑1=Exfiltration (Exfiltration Controls 0.10 cfs)

Primary OutFlow Max=5.24 cfs @ 12.16 hrs HW=103.12' TW=0.00' (Dynamic Tailwater)

↑2=Culvert (Barrel Controls 5.24 cfs @ 4.55 fps)

222-182 POST DEVELOPMENT

Type III 24-hr 100-Year Rainfall=8.65"

Prepared by McKenzie Engineering Group, Inc.

Printed 3/27/2023

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC

Page 53

Pond 2P: SUBSURFACE INFILTRATION SYSTEM - Chamber Wizard Field A

Chamber Model = Cultec R-150XLHD (Cultec Recharger® 150XLHD)

Effective Size= 29.8"W x 18.0"H => 2.65 sf x 10.25'L = 27.2 cf

Overall Size= 33.0"W x 18.5"H x 11.00'L with 0.75' Overlap

Row Length Adjustment= +0.75' x 2.65 sf x 9 rows

33.0" Wide + 6.0" Spacing = 39.0" C-C Row Spacing

13 Chambers/Row x 10.25' Long +0.75' Row Adjustment = 134.00' Row Length +12.0" End Stone x 2 = 136.00' Base Length

9 Rows x 33.0" Wide + 6.0" Spacing x 8 + 12.0" Side Stone x 2 = 30.75' Base Width

6.0" Stone Base + 18.5" Chamber Height + 6.0" Stone Cover = 2.54' Field Height

117 Chambers x 27.2 cf +0.75' Row Adjustment x 2.65 sf x 9 Rows = 3,194.7 cf Chamber Storage

10,629.3 cf Field - 3,194.7 cf Chambers = 7,434.6 cf Stone x 40.0% Voids = 2,973.8 cf Stone Storage

Chamber Storage + Stone Storage = 6,168.5 cf = 0.142 af


Overall Storage Efficiency = 58.0%

Overall System Size = 136.00' x 30.75' x 2.54'

117 Chambers

393.7 cy Field

275.4 cy Stone

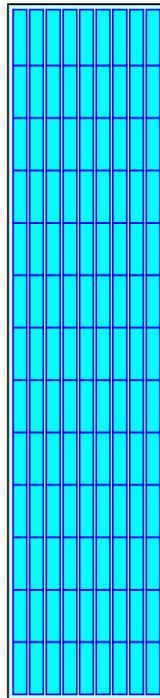

222-182 POST DEVELOPMENT

Prepared by McKenzie Engineering Group, Inc.

HydroCAD® 10.10-7a s/n 00452 © 2021 HydroCAD Software Solutions LLC


Type III 24-hr 100-Year Rainfall=8.65"

Printed 3/27/2023

Page 54

Pond 2P: SUBSURFACE INFILTRATION SYSTEM

Hydrograph

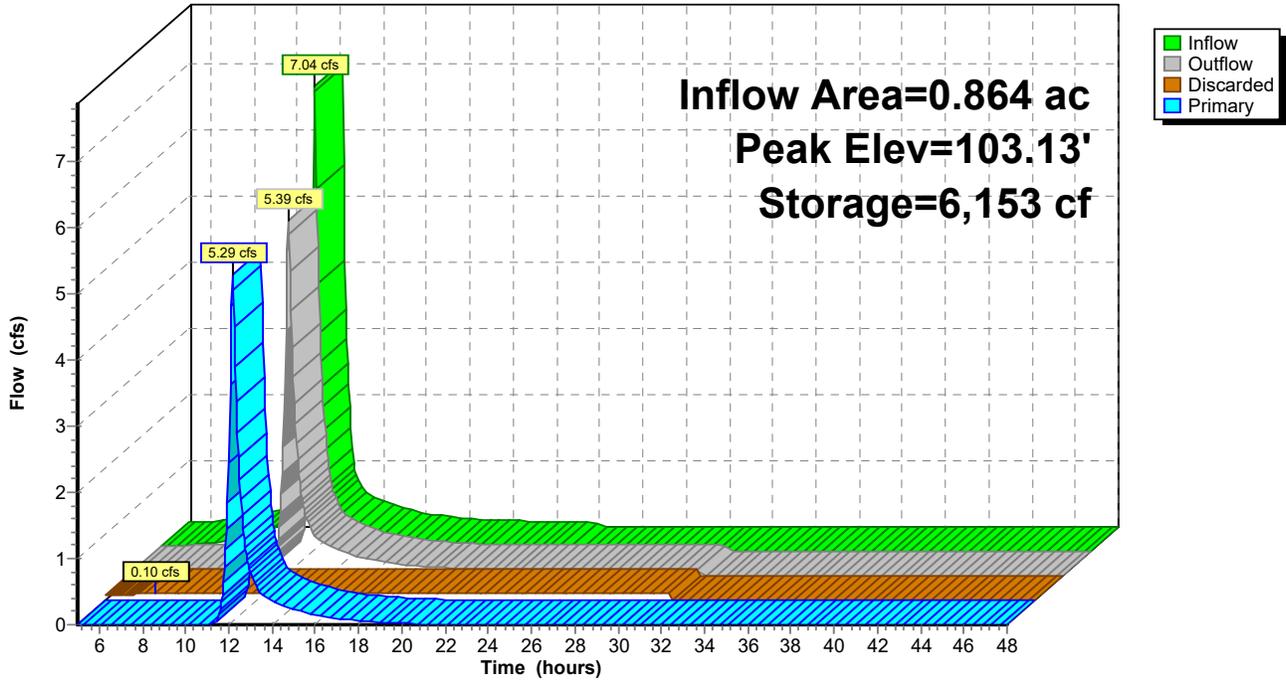

A P P E N D I X C

Checklist for Stormwater Report



Checklist for Stormwater Report

A. Introduction

Important: When filling out forms on the computer, use only the tab key to move your cursor - do not use the return key.



A Stormwater Report must be submitted with the Notice of Intent permit application to document compliance with the Stormwater Management Standards. The following checklist is NOT a substitute for the Stormwater Report (which should provide more substantive and detailed information) but is offered here as a tool to help the applicant organize their Stormwater Management documentation for their Report and for the reviewer to assess this information in a consistent format. As noted in the Checklist, the Stormwater Report must contain the engineering computations and supporting information set forth in Volume 3 of the [Massachusetts Stormwater Handbook](#). The Stormwater Report must be prepared and certified by a Registered Professional Engineer (RPE) licensed in the Commonwealth.

The Stormwater Report must include:

- The Stormwater Checklist completed and stamped by a Registered Professional Engineer (see page 2) that certifies that the Stormwater Report contains all required submittals.¹ This Checklist is to be used as the cover for the completed Stormwater Report.
- Applicant/Project Name
- Project Address
- Name of Firm and Registered Professional Engineer that prepared the Report
- Long-Term Pollution Prevention Plan required by Standards 4-6
- Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan required by Standard 8²
- Operation and Maintenance Plan required by Standard 9

In addition to all plans and supporting information, the Stormwater Report must include a brief narrative describing stormwater management practices, including environmentally sensitive site design and LID techniques, along with a diagram depicting runoff through the proposed BMP treatment train. Plans are required to show existing and proposed conditions, identify all wetland resource areas, NRCS soil types, critical areas, Land Uses with Higher Potential Pollutant Loads (LUHPPL), and any areas on the site where infiltration rate is greater than 2.4 inches per hour. The Plans shall identify the drainage areas for both existing and proposed conditions at a scale that enables verification of supporting calculations.

As noted in the Checklist, the Stormwater Management Report shall document compliance with each of the Stormwater Management Standards as provided in the Massachusetts Stormwater Handbook. The soils evaluation and calculations shall be done using the methodologies set forth in Volume 3 of the Massachusetts Stormwater Handbook.

To ensure that the Stormwater Report is complete, applicants are required to fill in the Stormwater Report Checklist by checking the box to indicate that the specified information has been included in the Stormwater Report. If any of the information specified in the checklist has not been submitted, the applicant must provide an explanation. The completed Stormwater Report Checklist and Certification must be submitted with the Stormwater Report.

¹ The Stormwater Report may also include the Illicit Discharge Compliance Statement required by Standard 10. If not included in the Stormwater Report, the Illicit Discharge Compliance Statement must be submitted prior to the discharge of stormwater runoff to the post-construction best management practices.

² For some complex projects, it may not be possible to include the Construction Period Erosion and Sedimentation Control Plan in the Stormwater Report. In that event, the issuing authority has the discretion to issue an Order of Conditions that approves the project and includes a condition requiring the proponent to submit the Construction Period Erosion and Sedimentation Control Plan before commencing any land disturbance activity on the site.



Checklist for Stormwater Report

B. Stormwater Checklist and Certification

The following checklist is intended to serve as a guide for applicants as to the elements that ordinarily need to be addressed in a complete Stormwater Report. The checklist is also intended to provide conservation commissions and other reviewing authorities with a summary of the components necessary for a comprehensive Stormwater Report that addresses the ten Stormwater Standards.


Note: Because stormwater requirements vary from project to project, it is possible that a complete Stormwater Report may not include information on some of the subjects specified in the Checklist. If it is determined that a specific item does not apply to the project under review, please note that the item is not applicable (N.A.) and provide the reasons for that determination.

A complete checklist must include the Certification set forth below signed by the Registered Professional Engineer who prepared the Stormwater Report.

Registered Professional Engineer's Certification

I have reviewed the Stormwater Report, including the soil evaluation, computations, Long-term Pollution Prevention Plan, the Construction Period Erosion and Sedimentation Control Plan (if included), the Long-term Post-Construction Operation and Maintenance Plan, the Illicit Discharge Compliance Statement (if included) and the plans showing the stormwater management system, and have determined that they have been prepared in accordance with the requirements of the Stormwater Management Standards as further elaborated by the Massachusetts Stormwater Handbook. I have also determined that the information presented in the Stormwater Checklist is accurate and that the information presented in the Stormwater Report accurately reflects conditions at the site as of the date of this permit application.

Registered Professional Engineer Block and Signature

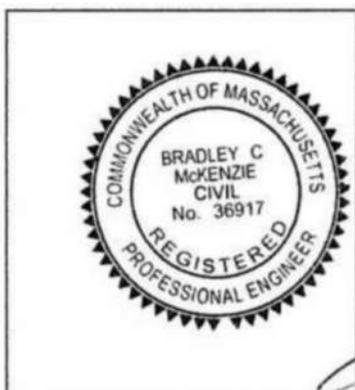


Signature and Date

3/6/2023

Checklist

Project Type: Is the application for new development, redevelopment, or a mix of new and redevelopment?

- New development
- Redevelopment
- Mix of New Development and Redevelopment



Checklist for Stormwater Report

Checklist (continued)

LID Measures: Stormwater Standards require LID measures to be considered. Document what environmentally sensitive design and LID Techniques were considered during the planning and design of the project:

- No disturbance to any Wetland Resource Areas
- Site Design Practices (e.g. clustered development, reduced frontage setbacks)
- Reduced Impervious Area (Redevelopment Only)
- Minimizing disturbance to existing trees and shrubs
- LID Site Design Credit Requested:
 - Credit 1
 - Credit 2
 - Credit 3
- Use of “country drainage” versus curb and gutter conveyance and pipe
- Bioretention Cells (includes Rain Gardens)
- Constructed Stormwater Wetlands (includes Gravel Wetlands designs)
- Treebox Filter
- Water Quality Swale
- Grass Channel
- Green Roof
- Other (describe): Subsurface Infiltration Chambers

Standard 1: No New Untreated Discharges

- No new untreated discharges
- Outlets have been designed so there is no erosion or scour to wetlands and waters of the Commonwealth
- Supporting calculations specified in Volume 3 of the Massachusetts Stormwater Handbook included.



Checklist for Stormwater Report

Checklist (continued)

Standard 2: Peak Rate Attenuation

- Standard 2 waiver requested because the project is located in land subject to coastal storm flowage and stormwater discharge is to a wetland subject to coastal flooding.
- Evaluation provided to determine whether off-site flooding increases during the 100-year 24-hour storm.
- Calculations provided to show that post-development peak discharge rates do not exceed pre-development rates for the 2-year and 10-year 24-hour storms. If evaluation shows that off-site flooding increases during the 100-year 24-hour storm, calculations are also provided to show that post-development peak discharge rates do not exceed pre-development rates for the 100-year 24-hour storm.

Standard 3: Recharge

- Soil Analysis provided.
- Required Recharge Volume calculation provided.
- Required Recharge volume reduced through use of the LID site Design Credits.
- Sizing the infiltration, BMPs is based on the following method: Check the method used.
 - Static
 - Simple Dynamic
 - Dynamic Field¹
- Runoff from all impervious areas at the site discharging to the infiltration BMP.
- Runoff from all impervious areas at the site is *not* discharging to the infiltration BMP and calculations are provided showing that the drainage area contributing runoff to the infiltration BMPs is sufficient to generate the required recharge volume.
- Recharge BMPs have been sized to infiltrate the Required Recharge Volume.
- Recharge BMPs have been sized to infiltrate the Required Recharge Volume *only* to the maximum extent practicable for the following reason:
 - Site is comprised solely of C and D soils and/or bedrock at the land surface
 - M.G.L. c. 21E sites pursuant to 310 CMR 40.0000
 - Solid Waste Landfill pursuant to 310 CMR 19.000
 - Project is otherwise subject to Stormwater Management Standards only to the maximum extent practicable.
- Calculations showing that the infiltration BMPs will drain in 72 hours are provided.
- Property includes a M.G.L. c. 21E site or a solid waste landfill and a mounding analysis is included.

¹ 80% TSS removal is required prior to discharge to infiltration BMP if Dynamic Field method is used.



Checklist for Stormwater Report

Checklist (continued)

Standard 3: Recharge (continued)

- The infiltration BMP is used to attenuate peak flows during storms greater than or equal to the 10-year 24-hour storm and separation to seasonal high groundwater is less than 4 feet and a mounding analysis is provided.
- Documentation is provided showing that infiltration BMPs do not adversely impact nearby wetland resource areas.

Standard 4: Water Quality

The Long-Term Pollution Prevention Plan typically includes the following:

- Good housekeeping practices;
 - Provisions for storing materials and waste products inside or under cover;
 - Vehicle washing controls;
 - Requirements for routine inspections and maintenance of stormwater BMPs;
 - Spill prevention and response plans;
 - Provisions for maintenance of lawns, gardens, and other landscaped areas;
 - Requirements for storage and use of fertilizers, herbicides, and pesticides;
 - Pet waste management provisions;
 - Provisions for operation and management of septic systems;
 - Provisions for solid waste management;
 - Snow disposal and plowing plans relative to Wetland Resource Areas;
 - Winter Road Salt and/or Sand Use and Storage restrictions;
 - Street sweeping schedules;
 - Provisions for prevention of illicit discharges to the stormwater management system;
 - Documentation that Stormwater BMPs are designed to provide for shutdown and containment in the event of a spill or discharges to or near critical areas or from LUHPPL;
 - Training for staff or personnel involved with implementing Long-Term Pollution Prevention Plan;
 - List of Emergency contacts for implementing Long-Term Pollution Prevention Plan.
- A Long-Term Pollution Prevention Plan is attached to Stormwater Report and is included as an attachment to the Wetlands Notice of Intent.
 - Treatment BMPs subject to the 44% TSS removal pretreatment requirement and the one inch rule for calculating the water quality volume are included, and discharge:
 - is within the Zone II or Interim Wellhead Protection Area
 - is near or to other critical areas
 - is within soils with a rapid infiltration rate (greater than 2.4 inches per hour)
 - involves runoff from land uses with higher potential pollutant loads.
 - The Required Water Quality Volume is reduced through use of the LID site Design Credits.
 - Calculations documenting that the treatment train meets the 80% TSS removal requirement and, if applicable, the 44% TSS removal pretreatment requirement, are provided.



Checklist for Stormwater Report

Checklist (continued)

Standard 4: Water Quality (continued)

- The BMP is sized (and calculations provided) based on:
 - The ½" or 1" Water Quality Volume or
 - The equivalent flow rate associated with the Water Quality Volume and documentation is provided showing that the BMP treats the required water quality volume.
- The applicant proposes to use proprietary BMPs, and documentation supporting use of proprietary BMP and proposed TSS removal rate is provided. This documentation may be in the form of the propriety BMP checklist found in Volume 2, Chapter 4 of the Massachusetts Stormwater Handbook and submitting copies of the TARP Report, STEP Report, and/or other third party studies verifying performance of the proprietary BMPs.
- A TMDL exists that indicates a need to reduce pollutants other than TSS and documentation showing that the BMPs selected are consistent with the TMDL is provided.

Standard 5: Land Uses With Higher Potential Pollutant Loads (LUHPPLs)

- The NPDES Multi-Sector General Permit covers the land use and the Stormwater Pollution Prevention Plan (SWPPP) has been included with the Stormwater Report.
- The NPDES Multi-Sector General Permit covers the land use and the SWPPP will be submitted **prior to** the discharge of stormwater to the post-construction stormwater BMPs.
- The NPDES Multi-Sector General Permit does **not** cover the land use.
- LUHPPLs are located at the site and industry specific source control and pollution prevention measures have been proposed to reduce or eliminate the exposure of LUHPPLs to rain, snow, snow melt and runoff, and been included in the long term Pollution Prevention Plan.
- All exposure has been eliminated.
- All exposure has **not** been eliminated and all BMPs selected are on MassDEP LUHPPL list.
- The LUHPPL has the potential to generate runoff with moderate to higher concentrations of oil and grease (e.g. all parking lots with >1000 vehicle trips per day) and the treatment train includes an oil grit separator, a filtering bioretention area, a sand filter or equivalent.

Standard 6: Critical Areas

- The discharge is near or to a critical area and the treatment train includes only BMPs that MassDEP has approved for stormwater discharges to or near that particular class of critical area.
- Critical areas and BMPs are identified in the Stormwater Report.



Checklist for Stormwater Report

Checklist (continued)

Standard 7: Redevelopments and Other Projects Subject to the Standards only to the maximum extent practicable

- The project is subject to the Stormwater Management Standards only to the maximum Extent Practicable as a:
 - Limited Project
 - Small Residential Projects: 5-9 single family houses or 5-9 units in a multi-family development provided there is no discharge that may potentially affect a critical area.
 - Small Residential Projects: 2-4 single family houses or 2-4 units in a multi-family development with a discharge to a critical area
 - Marina and/or boatyard provided the hull painting, service and maintenance areas are protected from exposure to rain, snow, snow melt and runoff
 - Bike Path and/or Foot Path
- Redevelopment Project
- Redevelopment portion of mix of new and redevelopment.
- Certain standards are not fully met (Standard No. 1, 8, 9, and 10 must always be fully met) and an explanation of why these standards are not met is contained in the Stormwater Report.
- The project involves redevelopment and a description of all measures that have been taken to improve existing conditions is provided in the Stormwater Report. The redevelopment checklist found in Volume 2 Chapter 3 of the Massachusetts Stormwater Handbook may be used to document that the proposed stormwater management system (a) complies with Standards 2, 3 and the pretreatment and structural BMP requirements of Standards 4-6 to the maximum extent practicable and (b) improves existing conditions.

Standard 8: Construction Period Pollution Prevention and Erosion and Sedimentation Control

A Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan must include the following information:

- Narrative;
 - Construction Period Operation and Maintenance Plan;
 - Names of Persons or Entity Responsible for Plan Compliance;
 - Construction Period Pollution Prevention Measures;
 - Erosion and Sedimentation Control Plan Drawings;
 - Detail drawings and specifications for erosion control BMPs, including sizing calculations;
 - Vegetation Planning;
 - Site Development Plan;
 - Construction Sequencing Plan;
 - Sequencing of Erosion and Sedimentation Controls;
 - Operation and Maintenance of Erosion and Sedimentation Controls;
 - Inspection Schedule;
 - Maintenance Schedule;
 - Inspection and Maintenance Log Form.
- A Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan containing the information set forth above has been included in the Stormwater Report.



Checklist for Stormwater Report

Checklist (continued)

Standard 8: Construction Period Pollution Prevention and Erosion and Sedimentation Control (continued)

- The project is highly complex and information is included in the Stormwater Report that explains why it is not possible to submit the Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan with the application. A Construction Period Pollution Prevention and Erosion and Sedimentation Control has **not** been included in the Stormwater Report but will be submitted **before** land disturbance begins.
- The project is **not** covered by a NPDES Construction General Permit.
- The project is covered by a NPDES Construction General Permit and a copy of the SWPPP is in the Stormwater Report.
- The project is covered by a NPDES Construction General Permit but no SWPPP been submitted. The SWPPP will be submitted BEFORE land disturbance begins.

Standard 9: Operation and Maintenance Plan

- The Post Construction Operation and Maintenance Plan is included in the Stormwater Report and includes the following information:
 - Name of the stormwater management system owners;
 - Party responsible for operation and maintenance;
 - Schedule for implementation of routine and non-routine maintenance tasks;
 - Plan showing the location of all stormwater BMPs maintenance access areas;
 - Description and delineation of public safety features;
 - Estimated operation and maintenance budget; and
 - Operation and Maintenance Log Form.
- The responsible party is **not** the owner of the parcel where the BMP is located and the Stormwater Report includes the following submissions:
 - A copy of the legal instrument (deed, homeowner's association, utility trust or other legal entity) that establishes the terms of and legal responsibility for the operation and maintenance of the project site stormwater BMPs;
 - A plan and easement deed that allows site access for the legal entity to operate and maintain BMP functions.

Standard 10: Prohibition of Illicit Discharges

- The Long-Term Pollution Prevention Plan includes measures to prevent illicit discharges;
- An Illicit Discharge Compliance Statement is attached;
- NO Illicit Discharge Compliance Statement is attached but will be submitted **prior to** the discharge of any stormwater to post-construction BMPs.

A P P E N D I X D

**Illicit Discharge Compliance Statement
Supplemental BMP Calculations**


Illicit Discharge Compliance Statement

I, Bradley C. McKenzie, P.E., hereby notify the Weymouth Conservation Commission that I have not witnessed, nor am aware of any existing illicit discharges at the site known as 550-560 Washington Street in Weymouth, Massachusetts. I also hereby certify that the development of said property as illustrated on the final plans entitled "Site Development Plan, 550-560 Washington Street, (APN 29-330-3) Weymouth, Massachusetts," prepared by McKenzie Engineering Group, Inc. dated March 8, 2023 and as revised and approved by the Weymouth Conservation Commission and maintenance thereof in accordance with the "Construction Phase Operations and Maintenance Plan" and "Long-Term Operations and Maintenance Plan" prepared by McKenzie Engineering Group, Inc. dated March 8, 2023 and as revised and approved by the Weymouth Conservation Commission will not create any new illicit discharges. There is no warranty implied regarding future illicit discharges that may occur as a result of improper construction or maintenance of the stormwater management system or unforeseen accidents.

Name: Bradley C. McKenzie, P.E.

Company: McKenzie Engineering Group, Inc.

Title: _____

Signature:  _____

Date: 3/6/23



Assinippi Office Park
 150 Longwater Drive, Suite 101
 Norwell, MA 02061

**550-560 WASHINGTON STREET
 WEYMOUTH, MA**

3/28/2023

WATER QUALITY VOLUME ANALYSIS

POND	IMPERVIOUS AREA (SF) CN=98	PRECIPITATION (IN)	WATER QUALITY VOLUME REQUIRED (CF)	TREATMENT VOLUME PROVIDED (CF) UP TO INVERT ELEVATION	NET TREATMENT VOLUME PROVIDED (CF)
P-1	31,751	1.00	2,646	2,651	5
TOTAL	31,751		2,646	2,651	5

WATER QUALITY VOLUME ANALYSIS - PROPRIETARY STORMWATER TREATMENT UNITS (FIRST DEFENSE UNITS)*

	IMPERVIOUS AREA (SF) CN=98	PRECIPITATION (IN)	qu (Fig 4) Tc 6 min. (CSM/IN)	AREA (SM)	WATER QUALITY REQUIRED (CFS)
FD-1	31,751	1.00	774	1.139E-03	0.882

*Use 4' Diameter First Defense Units



Assinippi Office Park
 150 Longwater Drive, Suite 101
 Norwell, MA 02061

550-560 WASHINGTON STREET
 WEYMOUTH, MA

3/28/2023

REQUIRED RECHARGE VOLUME (CF) "STATIC METHOD"

WATERSHED #	IMPERVIOUS AREA (SF)	TARGET DEPTH FACTOR (F) A SOIL	IMPERVIOUS AREA (SF)	TARGET DEPTH FACTOR (F) B SOIL	IMPERVIOUS AREA (SF)	TARGET DEPTH FACTOR (F) C SOIL	IMPERVIOUS AREA (SF)	TARGET DEPTH FACTOR (F) D SOIL	REQUIRED RECHARGE VOLUME (CF)
TOTAL SITE		0.60		0.35	35,756	0.25		0.10	745
		0.60		0.35		0.25		0.10	0
		0.60		0.35		0.25		0.10	0
							TOTAL		745

CAPTURE ADJUSTMENT

WATERSHED #	TOTAL IMPERVIOUS AREA (SF)	TOTAL IMPERVIOUS COLLECTED	% DIRECTED TOWARDS INFILTRATION SYSTEM	STANDARD NO. 3 <100% - > 65% CAPTURED	CAPTURE ADJUSTMENT	ADJUSTED REQUIRED RECHARGE VOLUME (CF)
TOTAL SITE	35,756	31,751	88.80%	CAPTURE ADJUSTMENT REQUIRED	1.13	839

* Required Water Quality Volume based on 1 inch of runoff; Required Recharge Volume based on 0.25 inches ; Target Volume is Required Water Quality Volume of 2,646CF

PROVIDED RECHARGE VOLUME (CF)

BELOW LOWEST INVERT

REQUIRED RECHARGE VOLUME (CF)	POND	STORAGE VOLUME PROVIDED (CF)	NET STORAGE VOLUME PROVIDED (CF)
839	P-1	2,651	1,812
TOTAL		2,651	1,812



Assinippi Office Park
150 Longwater Drive, Suite 101
Norwell, MA 02061

**550-560 WASHINGTON STREET
WEYMOUTH, MA**

3/28/2023

DRAWDOWN WITHIN 72 HOURS ANALYSIS

POND	RAWLS RATE (IN/HR)	STORAGE VOLUME PROVIDED (CF)	BOTTOM AREA (FT ²)	DRAWDOWN (HR)
P-1*	1.0200	6,099	4,182	17



Standard 4: Total Suspended Solids Calculation: Subsurface Chambers P-1

NAME: 550-560 Washington Street
Weymouth, MA
CLIENT: Union Realty Trust
COUNTY: Norfolk

Proj. No.: 222-182
Date: 3/1/2023
Revised:
Computed by: ESS
Checked by: BCM

Assinippi Office Park
150 Longwater Drive, Suite 101
Norwell, MA 02061

	B BMP	C TSS Removal Rate	D Starting TSS Load (*F)	E Amount Removed (C*D)	F Remaining Load (D-E)
TSS Removal Calculation		0.00	1.00	0.00	1.00
	Deep Sump and Hooded Catch Basin	0.25	1.00	0.25	0.75
	First Defense-Recommended TSS Removal Per Mass STEP	0.70	0.75	0.53	0.23
	Subsurface Infiltration Structure	0.80	0.23	0.18	0.05
		0.00	0.05	0.00	0.05

Total TSS Removal = 96%

*Equals remaining load from previous BMP (E)
which enters the BMP

Sediment Trap Sizing for Proposed Outlets

Key: input data in cell


$$\text{Equation: } d_{100} = (0.0125(Q_{100})^{4/3}) / (Tw * D_0)$$

Flared End Section Infil. Basin Outlet (highest Q_{100})

Outlet Pipe Diameter (D_0):	<input type="text" value="15"/> in. /	1.25 ft.		
100-yr Flow (Q_{100}):	<input type="text" value="5.29"/> cfs			
Depth of Trap (Y) (1/2 pipe diameter, 1ft. min):	7.5 in. /	0.625 ft.	use -->	1 ft.
Depth of Tailwater (Tw) (assume 0.2')	0.2 ft.			
Min. Stone Size (d_{100}) (8" min.)	0.461 ft. /	5.53 in.	use -->	8 in.

Trap Size

Length (l) ($3' + 3' + 3(D_0)$)	9.75 ft.
Width (w) ($3' + 3' + 2(D_0)$)	8.5 ft.

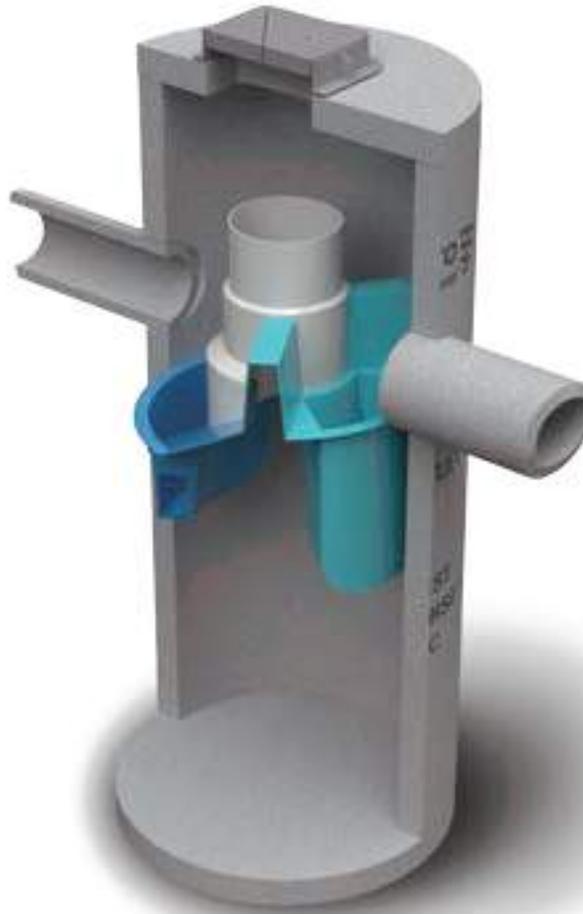

Operation and Maintenance Manual

First Defense[®] and First Defense[®] High Capacity

Vortex Separator for Stormwater Treatment

Table of Contents

3	FIRST DEFENSE® BY HYDRO INTERNATIONAL <ul style="list-style-type: none">- INTRODUCTION- OPERATION- POLLUTANT CAPTURE AND RETENTION
4	MODEL SIZES & CONFIGURATIONS <ul style="list-style-type: none">- FIRST DEFENSE® COMPONENTS
5	MAINTENANCE <ul style="list-style-type: none">- OVERVIEW- MAINTENANCE EQUIPMENT CONSIDERATIONS- DETERMINING YOUR MAINTENANCE SCHEDULE
6	MAINTENANCE PROCEDURES <ul style="list-style-type: none">- INSPECTION- FLOATABLES AND SEDIMENT CLEAN OUT
8	FIRST DEFENSE® INSTALLATION LOG
9	FIRST DEFENSE® INSPECTION AND MAINTENANCE LOG

COPYRIGHT STATEMENT: The contents of this manual, including the graphics contained herein, are intended for the use of the recipient to whom the document and all associated information are directed. Hydro International plc owns the copyright of this document, which is supplied in confidence. It must not be used for any purpose other than that for which it is supplied and must not be reproduced, in whole or in part stored in a retrieval system or transmitted in any form or by any means without prior permission in writing from Hydro International plc. First Defense® is a trademarked hydrodynamic vortex separation device of Hydro International plc. A patent covering the First Defense® has been granted.

DISCLAIMER: Information and data contained in this manual is exclusively for the purpose of assisting in the operation and maintenance of Hydro International plc's First Defense®. No warranty is given nor can liability be accepted for use of this information for any other purpose. Hydro International plc has a policy of continuous product development and reserves the right to amend specifications without notice.

HYDRO MAINTENANCE SERVICES

Hydro International has been engineering stormwater treatment systems for over 30 years. We understand the mechanics of removing pollutants from stormwater and how to keep systems running at an optimal level.

NOBODY KNOWS OUR SYSTEMS BETTER THAN WE DO



AVOID SERVICE NEGLIGENCE

Sanitation services providers not intimately familiar with stormwater treatment systems are at risk of the following:

- Inadvertently breaking parts or failing to clean/replace system components appropriately.
- Charging you for more frequent maintenance because they lacked the tools to service your system properly in the first place.
- Billing you for replacement parts that might have been covered under your Hydro warranty plan
- Charging for maintenance that may not yet have been required.

LEAVE THE DIRTY WORK TO US

Trash, sediment and polluted water is stored inside treatment systems until they are removed by our team with a vactor truck. Sometimes teams must physically enter the system chambers in order to prepare the system for maintenance and install any replacement parts. Services include but are not limited to:

- Solids removal
- Removal of liquid pollutants
- Replacement media installation (when applicable)



BETTER TOOLS, BETTER RESULTS

Not all vacor trucks are created equal. Appropriate tools and suction power are needed to service stormwater systems appropriately. Companies who don't specialize in stormwater treatment won't have the tools to properly clean systems or install new parts.



SERVICE WARRANTY

Make sure you're not paying for service that is covered under your warranty plan. Only Hydro International's service teams can identify tune-ups that should be on us, not you.

TREATMENT SYSTEMS SERVICED BY HYDRO:

- Stormwater filters
- Stormwater separators
- Baffle boxes
- Biofilters/biorention systems
- Storage structures
- Catch basins
- Stormwater ponds
- Permeable pavement



SAVE TIME & MONEY: CALL HYDRO FOR A QUOTE

1 (888) 382-7808

LEARN MORE AT HYDRO-INT.COM/SERVICE

I. First Defense® by Hydro International

Introduction

The First Defense® is an enhanced vortex separator that combines an effective and economical stormwater treatment chamber with an integral peak flow bypass. It efficiently removes total suspended solids (TSS), trash and hydrocarbons from stormwater runoff without washing out previously captured pollutants. The First Defense® is available in several model configurations (refer to *Section II. Model Sizes & Configurations*, page 4) to accommodate a wide range of pipe sizes, peak flows and depth constraints.

Operation

The First Defense® operates on simple fluid hydraulics. It is self-activating, has no moving parts, no external power requirement and is fabricated with durable non-corrosive components. No manual procedures are required to operate the unit and maintenance is limited to monitoring accumulations of stored pollutants and periodic clean-outs. The First Defense® has been designed to allow for easy and safe access for inspection, monitoring and clean-out procedures. Neither entry into the unit nor removal of the internal components is necessary for maintenance, thus safety concerns related to confined-space-entry are avoided.

Pollutant Capture and Retention

The internal components of the First Defense® have been designed to optimize pollutant capture. Sediment is captured and retained in the base of the unit, while oil and floatables are stored on the water surface in the inner volume (Fig.1).

The pollutant storage volumes are isolated from the built-in bypass chamber to prevent washout during high-flow storm events. The sump of the First Defense® retains a standing water level between storm events. This ensures a quiescent flow regime at the onset of a storm, preventing resuspension and washout of pollutants captured during previous events.

Accessories such as oil absorbent pads are available for enhanced oil removal and storage. Due to the separation of the oil and floatable storage volume from the outlet, the potential for washout of stored pollutants between clean-outs is minimized.

Applications

- Stormwater treatment at the point of entry into the drainage line
- Sites constrained by space, topography or drainage profiles with limited slope and depth of cover
- Retrofit installations where stormwater treatment is placed on or tied into an existing storm drain line
- Pretreatment for filters, infiltration and storage

Advantages

- Inlet options include surface grate or multiple inlet pipes
- Integral high capacity bypass conveys large peak flows without the need for “offline” arrangements using separate junction manholes
- Proven to prevent pollutant washout at up to 500% of its treatment flow
- Long flow path through the device ensures a long residence time within the treatment chamber, enhancing pollutant settling
- Delivered to site pre-assembled and ready for installation

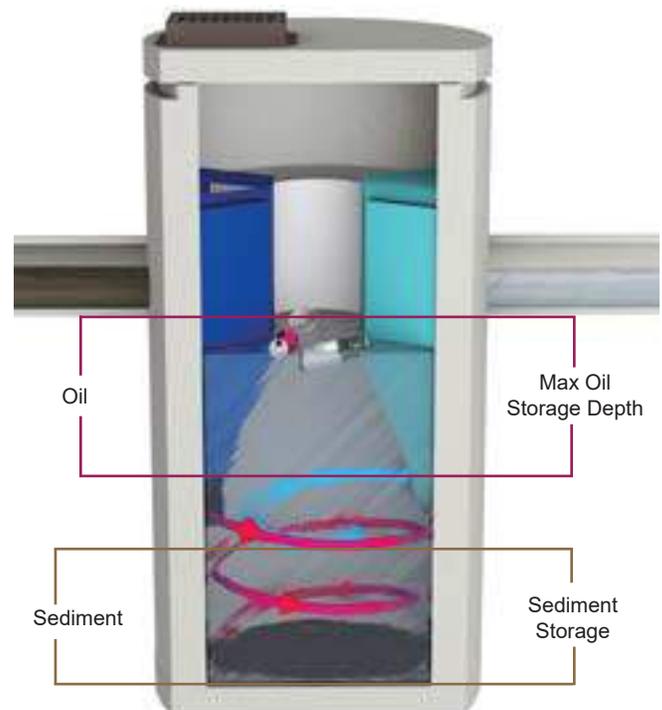


Fig.1 Pollutant storage volumes in the First Defense®.

II. Model Sizes & Configurations

The First Defense® inlet and internal bypass arrangements are available in several model sizes and configurations. The components of the First Defense®-4HC and First Defense®-6HC have modified geometries as to allow greater design flexibility needed to accommodate various site constraints.

All First Defense® models include the internal components that are designed to remove and retain total suspended solids (TSS), gross solids, floatable trash and hydrocarbons (Fig.2a - 2b). First Defense® model parameters and design criteria are shown in Table 1.

First Defense® Components

- 1. Built-In Bypass
- 2. Inlet Pipe
- 3. Inlet Chute
- 4. Floatables Draw-off Port
- 5. Outlet Pipe
- 6. Floatables Storage
- 7. Sediment Storage
- 8. Inlet Grate or Cover

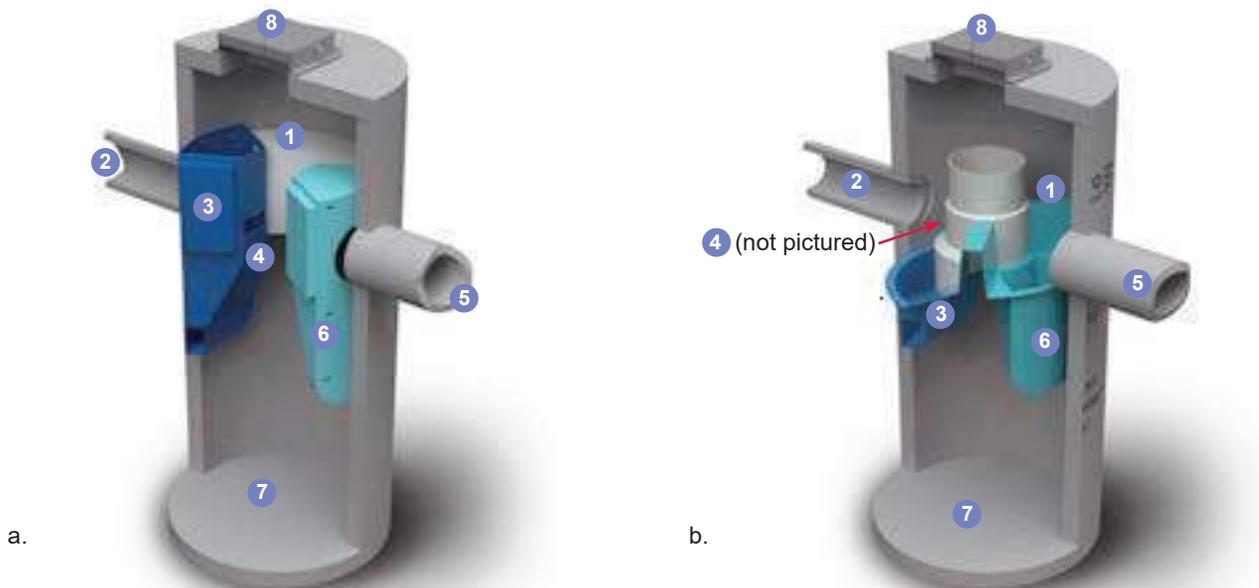


Fig.2a) First Defense®-4 and First Defense®-6; b) First Defense®-4HC and First Defense®-6HC, with higher capacity dual internal bypass and larger maximum pipe diameter.

First Defense® High Capacity Model Number	Diameter	Typical TSS Treatment Flow Rates		Peak Online Flow Rate	Maximum Pipe Diameter ¹	Oil Storage Capacity	Typical Sediment Storage Capacity ²	Minimum Distance from Outlet Invert to Top of Rim ³	Standard Distance from Outlet Invert to Sump Floor
		NJDEP Certified	106µm						
	(ft / m)	(cfs / L/s)	(cfs / L/s)	(cfs / L/s)	(in / mm)	(gal / L)	(yd ³ / m ³)	(ft / m)	(ft / m)
FD-3HC	3 / 0.9	0.84 / 23.7	1.60 / 45.3	15 / 424	18 / 457	125 / 473	0.4 / 0.3	2.0 - 3.5 / 0.6 - 1.0	3.71 / 1.13
FD-4HC	4 / 1.2	1.50 / 42.4	1.88 / 50.9	18 / 510	24 / 600	191 / 723	0.7 / 0.5	2.3 - 3.9 / 0.7 - 1.2	4.97 / 1.5
FD-5HC	5 / 1.5	2.34 / 66.2	2.94 / 82.1	20 / 566	24 / 609	300 / 1135	1.1 / .84	2.5 - 4.5 / 0.7 - 1.3	5.19 / 1.5
FD-6HC	6 / 1.8	3.38 / 95.7	4.73 / 133.9	32 / 906	30 / 750	496 / 1,878	1.6 / 1.2	3.0 - 5.1 / 0.9 - 1.6	5.97 / 1.8
FD-8HC	8 / 2.4	6.00 / 169.9	7.52 / 212.9	50 / 1,415	48 / 1219	1120 / 4239	2.8 / 2.1	3.0 - 6.0 / 0.9 - 1.8	7.40 / 2.2

¹Contact Hydro International when larger pipe sizes are required.
²Contact Hydro International when custom sediment storage capacity is required.
³Minimum distance for models depends on pipe diameter.

III. Maintenance

Overview

The First Defense® protects the environment by removing a wide range of pollutants from stormwater runoff. Periodic removal of these captured pollutants is essential to the continuous, long-term functioning of the First Defense®. The First Defense® will capture and retain sediment and oil until the sediment and oil storage volumes are full to capacity. When sediment and oil storage capacities are reached, the First Defense® will no longer be able to store removed sediment and oil. Maximum pollutant storage capacities are provided in Table 1.

The First Defense® allows for easy and safe inspection, monitoring and clean-out procedures. A commercially or municipally owned sump-vac is used to remove captured sediment and floatables. Access ports are located in the top of the manhole.

Maintenance events may include Inspection, Oil & Floatables Removal, and Sediment Removal. Maintenance events do not require entry into the First Defense®, nor do they require the internal components of the First Defense® to be removed. In the case of inspection and floatables removal, a vactor truck is not required. However, a vactor truck is required if the maintenance event is to include oil removal and/or sediment removal.

Maintenance Equipment Considerations

The internal components of the First Defense®-HC have a centrally located circular shaft through which the sediment storage sump can be accessed with a sump vac hose. The open diameter of this access shaft is 15 inches in diameter (Fig.3). Therefore, the nozzle fitting of any vactor hose used for maintenance should be less than 15 inches in diameter.

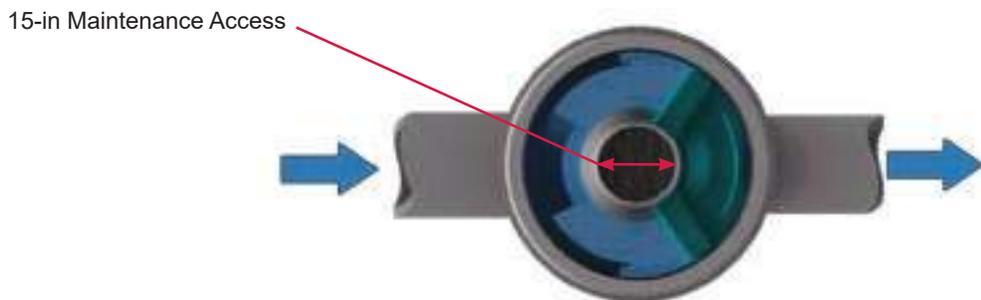


Fig.3 The central opening to the sump of the First Defense®-HC is 15 inches in diameter.

Determining Your Maintenance Schedule

The frequency of clean out is determined in the field after installation. During the first year of operation, the unit should be inspected every six months to determine the rate of sediment and floatables accumulation. A simple probe such as a Sludge-Judge® can be used to determine the level of accumulated solids stored in the sump. This information can be recorded in the maintenance log (see page 9) to establish a routine maintenance schedule.

The vactor procedure, including both sediment and oil / floatables removal, for a 6-ft First Defense® typically takes less than 30 minutes and removes a combined water/oil volume of about 765 gallons.

Inspection Procedures

1. Set up any necessary safety equipment around the access port or grate of the First Defense® as stipulated by local ordinances. Safety equipment should notify passing pedestrian and road traffic that work is being done.
2. Remove the grate or lid to the manhole.
3. Without entering the vessel, look down into the chamber to inspect the inside. Make note of any irregularities. Fig.4 shows the standing water level that should be observed.
4. Without entering the vessel, use the pole with the skimmer net to remove floatables and loose debris from the components and water surface.
5. Using a sediment probe such as a Sludge Judge®, measure the depth of sediment that has collected in the sump of the vessel.
6. On the Maintenance Log (see page 9), record the date, unit location, estimated volume of floatables and gross debris removed, and the depth of sediment measured. Also note any apparent irregularities such as damaged components or blockages.
7. Securely replace the grate or lid.
8. Take down safety equipment.
9. Notify Hydro International of any irregularities noted during inspection.

Floatables and Sediment Clean Out

Floatables clean out is typically done in conjunction with sediment removal. A commercially or municipally owned sump-vac is used to remove captured sediment and floatables (Fig.5).

Floatables and loose debris can also be netted with a skimmer and pole. The access port located at the top of the manhole provides unobstructed access for a vactor hose and skimmer pole to be lowered to the base of the sump.

Scheduling

- Floatables and sump clean out are typically conducted once a year during any season.
- Floatables and sump clean out should occur as soon as possible following a spill in the contributing drainage area.



Fig.4 Floatables are removed with a vactor hose (First Defense model FD-4, shown).

Recommended Equipment

- Safety Equipment (traffic cones, etc)
- Crow bar or other tool to remove grate or lid
- Pole with skimmer or net (if only floatables are being removed)
- Sediment probe (such as a Sludge Judge®)
- Vactor truck (flexible hose recommended)
- First Defense® Maintenance Log

Floatables and sediment Clean Out Procedures

1. Set up any necessary safety equipment around the access port or grate of the First Defense® as stipulated by local ordinances. Safety equipment should notify passing pedestrian and road traffic that work is being done.
2. Remove the grate or lid to the manhole.
3. Without entering the vessel, look down into the chamber to inspect the inside. Make note of any irregularities.
4. Remove oil and floatables stored on the surface of the water with the vactor hose (Fig.5) or with the skimmer or net (not pictured).
5. Using a sediment probe such as a Sludge Judge®, measure the depth of sediment that has collected in the sump of the vessel and record it in the Maintenance Log (page 9).
6. Once all floatables have been removed, drop the vactor hose to the base of the sump. Vactor out the sediment and gross debris off the sump floor (Fig.5).
7. Retract the vactor hose from the vessel.
8. On the Maintenance Log provided by Hydro International, record the date, unit location, estimated volume of floatables and gross debris removed, and the depth of sediment measured. Also note any apparent irregularities such as damaged components, blockages, or irregularly high or low water levels.
9. Securely replace the grate or lid.



Fig.5 Sediment is removed with a vactor hose (First Defense model FD-4, shown).

Maintenance at a Glance

Inspection	<ul style="list-style-type: none"> - Regularly during first year of installation - Every 6 months after the first year of installation
Oil and Floatables Removal	<ul style="list-style-type: none"> - Once per year, with sediment removal - Following a spill in the drainage area
Sediment Removal	<ul style="list-style-type: none"> - Once per year or as needed - Following a spill in the drainage area

NOTE: For most clean outs the entire volume of liquid does not need to be removed from the manhole. Only remove the first few inches of oils and floatables from the water surface to reduce the total volume of liquid removed during a clean out.



First Defense[®] Installation Log

HYDRO INTERNATIONAL REFERENCE NUMBER:	
SITE NAME:	
SITE LOCATION:	
OWNER:	CONTRACTOR:
CONTACT NAME:	CONTACT NAME:
COMPANY NAME:	COMPANY NAME:
ADDRESS:	ADDRESS:
TELEPHONE:	TELEPHONE:
FAX:	FAX:

INSTALLATION DATE: / /

MODEL SIZE (CIRCLE ONE): FD-4 FD-4HC FD-6 FD-6HC

INLET (CIRCLE ALL THAT APPLY): GRATED INLET (CATCH BASIN) INLET PIPE (FLOW THROUGH)

DO IT RIGHT THE FIRST TIME

LEARN MORE AT HYDRO-INT.COM/SERVICE



CALL 1 (888) 382-7808 TO SCHEDULE AN INSPECTION

Stormwater Solutions

94 Hutchins Drive
Portland, ME 04102

Tel: (207) 756-6200
Fax: (207) 756-6212
stormwaterinquiry@hydro-int.com

www.hydro-int.com

APPENDIX E

Soil Testing Data



Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

A. Facility Information

Union Realty Trust, Raymond D. Jennings III Trustee

Owner Name

550-560 Washington Street

Street Address

Weymouth

City

MA

State

APN 29-330-3

Map/Lot #

02188

Zip Code

B. Site Information

1. (Check one) New Construction Upgrade Repair

2. Soil Survey Available? Yes No If yes:

NRCS

Source

602

Soil Map Unit

Urban Land, 0-15% slopes

Soil Name

Coarse-loamy melt-out till derived from
granite, gneiss, and/or schist

Soil Parent material

excavated and filled land

Soil Limitations

ridges, hills

Landform

3. Surficial Geological Report Available? Yes No

If yes:

USGS/2018

Year Published/Source

Thin Till

Map Unit

nonsorted, nonstratified matrix of sand, some silt, and little clay containing scattered pebble, cobble and boulder clasts

Description of Geologic Map Unit:

4. Flood Rate Insurance Map Within a regulatory floodway? Yes No

5. Within a velocity zone? Yes No

6. Within a Mapped Wetland Area? Yes No

If yes, MassGIS Wetland Data Layer:

adjacent to bordering
vegetated wetlands

Wetland Type

7. Current Water Resource Conditions (USGS):

2/27/23

Month/Day/ Year

Range: Above Normal

Normal Below Normal

8. Other references reviewed:



Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

C. On-Site Review *(minimum of two holes required at every proposed primary and reserve disposal area)*

Deep Observation Hole Number: 1 2/28/23 8:30am snowing 42.205915° -70.953924°
Hole # Date Time Weather Latitude Longitude:

1. Land Use restaurant adjacent to wooded area boulders & stones
(e.g., woodland, agricultural field, vacant lot, etc.) Vegetation Surface Stones (e.g., cobbles, stones, boulders, etc.)

Description of Location: gravel & bituminous concrete parking area adjacent to woods

2. Soil Parent Material: meltout till ridges, hills bs
Landform Position on Landscape (SU, SH, BS, FS, TS)

3. Distances from: Open Water Body feet Drainage Way feet Wetlands >30 feet
 Property Line >30 feet Drinking Water Well feet Other feet

4. Unsuitable Materials Present: Yes No If Yes: Disturbed Soil Fill Material Weathered/Fractured Rock Bedrock

5. Groundwater Observed: Yes No If yes: Depth Weeping from Pit Depth Standing Water in Hole

Soil Log

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features			Coarse Fragments % by Volume		Soil Structure	Soil Consistence (Moist)	Other
				Depth	Color	Percent	Gravel	Cobbles & Stones			
0-6	FILL	FILL		-	-	-	15				GRAVEL
6-36	Bw	SL	10YR 5/4	-	-	-	10	10	M	F	VERY STONEY
36-105	C	SL	10YR 4/3	-	-	-	5	20	M	F	VERY STONEY

Additional Notes:
refusal @ bottom



Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

C. On-Site Review *(minimum of two holes required at every proposed primary and reserve disposal area)*

Deep Observation Hole Number: 2 2/28/23 9:30am snowing 42.205915° -70.953924°
Hole # Date Time Weather Latitude Longitude:

1. Land Use: restaurant adjacent to wooded area boulders & stones
(e.g., woodland, agricultural field, vacant lot, etc.) Vegetation Surface Stones (e.g., cobbles, stones, boulders, etc.) Slope (%)

Description of Location: gravel & bituminous concrete parking area adjacent to woods

2. Soil Parent Material: meltout till ridges, hills bs
Landform Position on Landscape (SU, SH, BS, FS, TS)

3. Distances from: Open Water Body _____ feet Drainage Way _____ feet Wetlands >25 feet
Property Line >10 feet Drinking Water Well _____ feet Other _____ feet

4. Unsuitable

Materials Present: Yes No If Yes: Disturbed Soil Fill Material Weathered/Fractured Rock Bedrock

5. Groundwater Observed: Yes No If yes: _____ Depth Weeping from Pit _____ Depth Standing Water in Hole

Soil Log

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features			Coarse Fragments % by Volume		Soil Structure	Soil Consistence (Moist)	Other
				Depth	Color	Percent	Gravel	Cobbles & Stones			
0-6	FILL	FILL		-	-	-	15				GRAVEL
6-32	Bw	SL	10YR 5/6	-	-	-	10	10	M	F	VERY STONEY
32-84	C	SL	10YR 4/3	-	-	-	5	20	M	F	VERY STONEY

Additional Notes:
refusal @ bottom



Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

D. Determination of High Groundwater Elevation

1. Method Used:
- | | | |
|---|----------------------|----------------------|
| | Obs. Hole # <u>1</u> | Obs. Hole # <u>2</u> |
| <input type="checkbox"/> Depth observed standing water in observation hole | _____ inches | _____ inches |
| <input type="checkbox"/> Depth weeping from side of observation hole | _____ inches | _____ inches |
| <input type="checkbox"/> Depth to soil redoximorphic features (mottles) | _____ inches | _____ inches |
| <input type="checkbox"/> Depth to adjusted seasonal high groundwater (S_h) (USGS methodology) | _____ inches | _____ inches |

Index Well Number _____

Reading Date _____

$$S_h = S_c - [S_r \times (OW_c - OW_{max}) / OW_r]$$

Obs. Hole/Well# _____ S_c _____ S_r _____ OW_c _____ OW_{max} _____ OW_r _____ S_h _____

2. Estimated Depth to High Groundwater: _____ inches
 1: >105"
 2: >84"

E. Depth of Pervious Material

1. Depth of Naturally Occurring Pervious Material

a. Does at least four feet of naturally occurring pervious material exist in all areas observed throughout the area proposed for the soil absorption system?

Yes No

b. If yes, at what depth was it observed (exclude A and O Horizons)?

Upper boundary: 6 inches Lower boundary: 84+ inches

c. If no, at what depth was impervious material observed?

Upper boundary: _____ inches Lower boundary: _____ inches



Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

F. Certification

I certify that I am currently approved by the Department of Environmental Protection pursuant to 310 CMR 15.017 to conduct soil evaluations and that the above analysis has been performed by me consistent with the required training, expertise and experience described in 310 CMR 15.017. I further certify that the results of my soil evaluation, as indicated in the attached Soil Evaluation Form, are accurate and in accordance with 310 CMR 15.100 through 15.107.

Signature of Soil Evaluator

Erik Schoumaker / SE14264

Typed or Printed Name of Soil Evaluator / License #

2/28/23

Date

6/30/24

Expiration Date of License

Name of Approving Authority Witness

Approving Authority

Note: In accordance with 310 CMR 15.018(2) this form must be submitted to the approving authority within 60 days of the date of field testing, and to the designer and the property owner with [Percolation Test Form 12](#).

Field Diagrams: Use this area for field diagrams:



Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

A. Facility Information

Union Realty Trust, Raymond D. Jennings III Trustee

Owner Name

550-560 Washington Street

Street Address

Weymouth

City

MA

State

APN 29-330-3

Map/Lot #

02188

Zip Code

B. Site Information

1. (Check one) New Construction Upgrade Repair

2. Soil Survey Available? Yes No If yes:

NRCS

Source

602

Soil Map Unit

Urban Land, 0-15% slopes

Soil Name

Coarse-loamy melt-out till derived from
granite, gneiss, and/or schist

Soil Parent material

excavated and filled land

Soil Limitations

ridges, hills

Landform

3. Surficial Geological Report Available? Yes No

If yes:

USGS/2018

Year Published/Source

Thin Till

Map Unit

nonsorted, nonstratified matrix of sand, some silt, and little clay containing scattered pebble, cobble and boulder clasts

Description of Geologic Map Unit:

4. Flood Rate Insurance Map Within a regulatory floodway? Yes No

5. Within a velocity zone? Yes No

6. Within a Mapped Wetland Area? Yes No

If yes, MassGIS Wetland Data Layer:

adjacent to bordering
vegetated wetlands

Wetland Type

7. Current Water Resource Conditions (USGS):

2/27/23

Month/Day/ Year

Range: Above Normal

Normal Below Normal

8. Other references reviewed:



Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

C. On-Site Review *(minimum of two holes required at every proposed primary and reserve disposal area)*

Deep Observation Hole Number: 3 2/28/23 10am snowing 42.205915° -70.953924°
Hole # Date Time Weather Latitude Longitude:

1. Land Use restaurant adjacent to wooded area boulders & stones
(e.g., woodland, agricultural field, vacant lot, etc.) Vegetation Surface Stones (e.g., cobbles, stones, boulders, etc.)

Description of Location: gravel & bituminous concrete parking area adjacent to woods

2. Soil Parent Material: meltout till ridges, hills bs
Landform Position on Landscape (SU, SH, BS, FS, TS)

3. Distances from: Open Water Body feet Drainage Way feet Wetlands >50 feet
 Property Line >50 feet Drinking Water Well feet Other feet

4. Unsuitable Materials Present: Yes No If Yes: Disturbed Soil Fill Material Weathered/Fractured Rock Bedrock

5. Groundwater Observed: Yes No If yes: Depth Weeping from Pit Depth Standing Water in Hole

Soil Log

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features			Coarse Fragments % by Volume		Soil Structure	Soil Consistence (Moist)	Other
				Depth	Color	Percent	Gravel	Cobbles & Stones			
0-6	FILL	FILL		-	-	-	15				GRAVEL
6-32	Bw	SL	10YR 5/4	-	-	-	10	10	M	F	VERY STONEY
32-69	C	SL	10YR 4/3	-	-	-	5	20	M	F	VERY STONEY

Additional Notes:
refusal @ bottom



Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

C. On-Site Review *(minimum of two holes required at every proposed primary and reserve disposal area)*

Deep Observation Hole Number: _____

Hole # _____ Date _____ Time _____ Weather _____ Latitude _____ Longitude: _____

1. Land Use: _____
(e.g., woodland, agricultural field, vacant lot, etc.) Vegetation _____ Surface Stones (e.g., cobbles, stones, boulders, etc.) _____ Slope (%) _____

Description of Location: _____

2. Soil Parent Material: _____
Landform _____ Position on Landscape (SU, SH, BS, FS, TS) _____

3. Distances from: Open Water Body _____ feet Drainage Way _____ feet Wetlands _____ feet
Property Line _____ feet Drinking Water Well _____ feet Other _____ feet

4. Unsuitable

Materials Present: Yes No If Yes: Disturbed Soil Fill Material Weathered/Fractured Rock Bedrock

5. Groundwater Observed: Yes No If yes: _____ Depth Weeping from Pit _____ Depth Standing Water in Hole

Soil Log

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features			Coarse Fragments % by Volume		Soil Structure	Soil Consistence (Moist)	Other
				Depth	Color	Percent	Gravel	Cobbles & Stones			

Additional Notes: _____



Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

F. Certification

I certify that I am currently approved by the Department of Environmental Protection pursuant to 310 CMR 15.017 to conduct soil evaluations and that the above analysis has been performed by me consistent with the required training, expertise and experience described in 310 CMR 15.017. I further certify that the results of my soil evaluation, as indicated in the attached Soil Evaluation Form, are accurate and in accordance with 310 CMR 15.100 through 15.107.

Signature of Soil Evaluator

Erik Schoumaker / SE14264

Typed or Printed Name of Soil Evaluator / License #

2/28/23

Date

6/30/24

Expiration Date of License

Name of Approving Authority Witness

Approving Authority

Note: In accordance with 310 CMR 15.018(2) this form must be submitted to the approving authority within 60 days of the date of field testing, and to the designer and the property owner with [Percolation Test Form 12](#).

Field Diagrams: Use this area for field diagrams:

A P P E N D I X F

**Best Management Practices
Operation and Maintenance Plans**

**CONSTRUCTION PHASE POLLUTION
PREVENTION AND EROSION AND
SEDIMENTATION CONTROL PLAN
(BEST MANAGEMENT PRACTICES
OPERATION AND MAINTENANCE PLAN)**

for

550-560 Washington Street

In

**Weymouth, Massachusetts
(Assessor's Map 29, Block 330, Lot 3)**

Submitted to:

TOWN OF WEYMOUTH

Prepared for:

**Union Realty Trust
560 Washington Street
Weymouth, Massachusetts 02188**

Prepared by:



**Professional Civil Engineering • Project Management • Land Planning
150 Longwater Drive, Suite 101, Norwell, Massachusetts 02061
Tel.: (781) 792-3900 Facsimile: (781) 792-0333
www.mckeng.com**

March 6, 2023

TABLE OF CONTENTS

	Page
Erosion and Sedimentation Controls - Best Management Practices (BMP's)	
- Structural Practices	1
- Stabilization Practices	5
- Dust Control	11
- Non-Stormwater Discharges	11
- Soil Stockpiling	11
- Anticipated Construction Schedule	12
- Inspection/Maintenance	13
- Inspection Schedule and Evaluation Checklist	14
- Spill Containment and Management Plan	16
Plans	
- Site Topographic Map (Existing Conditions Plans within Plan Set)	
- Site Development Map (Grading and Drainage Plans within Plan Set)	
- Site Erosion and Sedimentation Plan (Erosion and Sedimentation Control Plan within Plan Set)	
- Construction Detail Plan (Construction Details within Plan Set)	

Construction Phase Best Management Practices (BMP's)

Erosion and Sedimentation will be controlled at the site by utilizing Structural Practices, Stabilization Practices, and Dust Control. These practices correspond with plans entitled "Site Development Plan, 550-560 Washington Street, (APN 29-330-3), Weymouth, Massachusetts", issued March 8, 2023 and as revised hereinafter referred to as the Site Plans.

Responsible Party Contact Information:

Stormwater Management System Owner: Union Realty Trust
Raymond Jennings
560 Washington Street
Weymouth, MA 02188
Phone: (781) 389-2426

Town of Weymouth Contact Information:

Weymouth Department of Public Works
120 Winter Street
Weymouth, MA 02189
Phone: 781-337-5100

Weymouth Conservation Commission
Andrew Hultin, Agent
75 Middle Street
Weymouth, MA 02189
Phone: (781) 340-5007

Weymouth Building Department
Thomas Barry, Building Inspector
75 Middle Street
Weymouth, MA 02189
Phone: (781) 340-5004

Structural Practices:

- 1) **Compost Filter Tube Barrier Controls** – A compost filter tube barrier will be constructed along downward slopes at the limit of work in locations shown on the plans. This control will be installed prior to major soil disturbance on the site. The sediment silt sack barrier should be installed as shown on the Construction Detail Plan.

Compost Filter Tube Design/Installation Requirements *

- a) Locate the compost filter tube where identified on the plans.
- b) The compost filter tube line should be nearly level through most of its length to impound a broad, temporary pool. The last 10 to 20 feet at each end of the silt sack should be swung slightly uphill (approximately 0.5 feet in elevation) to provide storage capacity.

- c) The compost filter tube shall be staked every 8 linear feet with 1-inch by 1-inch stakes.
- d) Compost filter tubes should be removed when they have served their useful purpose, but not before the upslope area has been permanently stabilized through one growing season. Retained sediment must be removed and properly disposed of, or mulched and seeded.

Compost Filter Tube Inspection/Maintenance *

- a) Compost filter tubes should be inspected immediately after each rainfall event of 1-inch or greater, and at least daily during prolonged rainfall. Inspect the depth of sediment, fabric tears, and to see that the fence posts are firmly in the ground. Repair or replace as necessary.
 - b) Remove sediment deposits promptly after storm events to provide adequate storage volume for the next rain and to reduce pressure on the fence. Sediment will be removed from behind the sediment fence when it becomes about ½ foot deep at the compost filter tube. Take care to avoid undermining fence during cleanout.
 - c) If the fabric tears, decomposes, or in any way becomes ineffective, replace it immediately.
 - d) Remove all compost filter tube materials after the contributing drainage area has been properly stabilized. Sediment deposits remaining after the fabric has been removed should be graded to conform with the existing topography and vegetated.
- 2) **Sediment Fence Controls** – A sediment fence will be constructed along the limit of work as needed to prevent the spreading of fine sediments from the site. This control will be installed prior to major soil disturbance on the site. The sediment fence should be installed as shown on the Erosion Control Detail Plan and be Amoco woven polypropylene 1198 or equivalent.

Sediment Fence Design/Installation Requirements *

- e) Locate the fence upland of the hay bale barriers and where identified on the plans.
- f) The fence line should be nearly level through most of its length to impound a broad, temporary pool. The last 10 to 20 feet at each end of the fence should be swung slightly uphill (approximately 0.5 feet in elevation) to provide storage capacity.
- g) Excavate a trench approximately 8 inches deep and 4 inches wide, or a V-trench; along the line of the fence, upslope side.
- h) Fasten support wire fence (14 gauge with 6-inch mesh) securely to the upslope side of the fence posts with wire ties or staples. Wire should extend 6 inches into the trench.

- i) Attach continuous length of fabric to upslope side of fence posts. Avoid joints, particularly at low points in the fence line. Where joints are necessary, fasten fabric securely to support posts and overlap to the next post.
- j) Place the bottom one foot of fabric in the trench. Backfill with compacted earth or gravel.
- k) Filter cloth shall be fastened securely to the woven wire fence with ties spaced every 24 inches at the top, mid-section, and bottom.
- l) Sediment fences should be removed when they have served their useful purpose, but not before the upslope area has been permanently stabilized through one growing season and only following approval by the Engineering Department or their representative. Retained sediment must be removed and properly disposed of, or mulched and seeded.

Sediment Fence Inspection/Maintenance *

- e) Silt fences should be inspected immediately after each rainfall event of 1-inch or greater, and at least daily during prolonged rainfall. Inspect the depth of sediment, fabric tears, if the fabric is securely attached to the fence posts, and to see that the fence posts are firmly in the ground. Repair or replace as necessary.
 - f) Remove sediment deposits promptly after storm events to provide adequate storage volume for the next rain and to reduce pressure on the fence. Sediment will be removed from behind the sediment fence when it becomes about ½ foot deep at the fence. Take care to avoid undermining fence during cleanout.
 - g) If the fabric tears, decomposes, or in any way becomes ineffective, replace it immediately.
 - h) Remove all fencing materials after the contributing drainage area has been properly stabilized. Sediment deposits remaining after the fabric has been removed should be graded to conform to the existing topography and vegetation.
- 3) **Stabilized Construction Entrance** – A stabilized construction entrance will be placed at the proposed entrance at Washington Street. The construction entrance will keep mud and sediment from being tracked off the construction site onto Washington Street by vehicles leaving the site. The stabilized construction entrance will be installed immediately after the clear and grubbing of the roadway entrance and associated roadway fill to maintain access to the site are completed. The stormwater runoff from the entrance will be diverted to a temporary sedimentation basin. The stabilized construction entrance shall be constructed as shown on the Construction Detail Plans.

Construction Entrance Design/Construction Requirements *

- a) Grade foundation for positive drainage towards the temporary sedimentation basin.
- b) Stone for a stabilized construction entrance shall consist of 1 to 3-inch stone placed on a stable foundation.
- c) Pad dimensions: The minimum length of the gravel pad should be 50 feet. The pad should extend the full width of the proposed roadway, or wide enough so that the largest construction vehicle will fit in the entrance with room to spare; whichever is greater.
- d) A geotextile filter fabric shall be placed between the stone fill and the earth surface below the pad to reduce the migration of soil particles from the underlying soil into the stone and vice versa. The filter fabric should be Amoco woven polypropylene 1198 or equivalent.
- e) Washing: If the site conditions are such that the majority of mud is not removed from the vehicle tires by the gravel pad, then the tires should be washed before the vehicle enters the street. The wash area shall be located at the stabilized construction entrance.
- f) Water employed in the washing process shall be directed to the temporary sedimentation basin/dewatering area as shown on the plans prior to discharge. Sediment should be prevented from entering any watercourses.

Construction Entrance Inspection/Maintenance *

- a) The entrance should be maintained in a condition that will prevent tracking or flowing of sediment onto Washington Street. This may require periodic topdressing with additional stone
- b) The construction entrance and sediment disposal area shall be inspected weekly and after heavy rains or heavy use.
- c) Mud and sediment tracked or washed onto public road shall be immediately removed by sweeping.
- d) Once mud and soil particles clog the voids in the gravel and the effectiveness of the gravel pad is no longer satisfactory, the pad must be topdressed with new stone. Replacement of the entire pad may be necessary when the pad becomes completely clogged.
- e) If washing facilities are used, the temporary sedimentation basin/dewatering area should be cleaned out as often as necessary to assure that adequate trapping efficiency and storage volume is available. Any water pumped from the temporary sedimentation basin shall be directed into a sediment dirt bag or equivalent inlet protection prior to discharge. Discharge should not be across the disturbed construction site but rather to undisturbed areas.
- f) The pad shall be reshaped as needed for drainage and runoff control.

- g) Broken road pavement on Washington Street shall be repaired immediately.
- h) All temporary erosion and sediment control measures shall be removed within 30 days after final site stabilization is achieved or after the temporary practices are no longer needed and only following approval by the Public Works Department or their representative. Trapped sediment shall be removed or stabilized on site. Disturbed soil areas resulting from removal shall be permanently stabilized.

Stabilization Practices:

Stabilization measures shall be implemented as soon as practicable in portions of the site where construction activities have temporarily or permanently ceased, but in no case more than 14 days after the construction activity in that portion of the site has temporarily or permanently ceased, with the following exceptions.

- Where the initiation of stabilization measures by the 14th day after construction activity temporary or permanently cease is precluded by snow cover, stabilization measures shall be initiated as soon as practicable.
 - Where construction activity will resume on a portion of the site within 21 days from when activities ceased, (e.g. the total time period that construction activity is temporarily ceased is less than 21 days) then stabilization measures do not have to be initiated on that portion of the site by the 14th day after construction activity temporarily ceased.
 - The contractor shall provide erosion control measures around all soil stockpiles.
- 1) **Temporary Seeding** – Temporary seeding will allow a short-term vegetative cover on disturbed site areas that may be in danger of erosion. Temporary seeding will be done at stock piles and disturbed portions of the site where construction activity will temporarily cease for at least 21 days. The temporary seedings will stabilize cleared and unvegetated areas that will not be brought into final grade for several weeks or months.

Temporary Seeding Planting Procedures *

- a) Planting should preferably be done between April 1st and June 30th, and September 1st through September 31st. If planting is done in the months of July and August, irrigation may be required. If planting is done between October 1st and March 31st, mulching should be applied immediately after planting. If seeding is done during the summer months, irrigation of some sort will probably be necessary.
- b) Before seeding, install structural practice controls. Utilize Amoco supergro or equivalent.
- c) Select the appropriate seed species for temporary cover from the following table.

Species	Seeding Rate (lbs/1,000 sq.ft.)	Seeding Rate (lbs/acre)	Recommended Seeding Dates	Seed Cover required
Annual Ryegrass	1	40	April 1 st to June 1 st August 15 th to Sept. 15 th	¼ inch
Foxtail Millet	0.7	30	May 1 st to June 30 th	½ to ¾ inch
Oats	2	80	April 1 st to July 1 st August 15 th to Sept. 15 th	1 to 1-½ inch
Winter Rye	3	120	August 15 th to Oct. 15 th	1 to 1-½ inch

Apply the seed uniformly by hydroseeding, broadcasting, or by hand.

- d) Use effective mulch tacked and/or tied with netting to protect seedbed and encourage plant growth.

Temporary Seeding Inspection/Maintenance *

- a) Inspect within 6 weeks of planting to see if stands are adequate. Check for damage within 24 hours of the end to a heavy rainfall, defined as a 2-year storm event (i.e., 3.2 inches of rainfall within a twenty-four hour period). Stands should be uniform and dense. Reseed and mulch damaged and sparse areas immediately. Tack or tie down mulch as necessary.
- b) Seeds should be supplied with adequate moisture. Furnish water as needed, especially in abnormally hot or dry weather. Water application rates should be controlled to prevent runoff.
- 2) **Geotextiles** - Geotextiles such as jute netting will be used in combination with other practices such as mulching to stabilize slopes. The following geotextile materials or equivalent are to be utilized for structural and nonstructural controls as shown in the following table.

Practice	Manufacturer	Product	Remarks
Sediment Fence	Amoco	Woven polypropylene 1198 or equivalent	0.425 mm opening
Construction Entrance	Amoco	Woven polypropylene 2002 or equivalent	0.300 mm opening
Outlet Protection	Amoco	Nonwoven polypropylene 4551 or equivalent	0.150 mm opening
Erosion Control (slope stability)	Amoco	Supergro or equivalent	Erosion control revegetation mix, open polypropylene fiber on degradable polypropylene net scrim

Amoco may be reached at (800) 445-7732

Geotextile Installation

- a) Netting and matting require firm, continuous contact between the materials and the soil. If there is no contact, the material will not hold the soil and erosion will occur underneath the material.

Geotextile Inspection/Maintenance *

- a) In the field, regular inspections should be made to check for cracks, tears, or breaches in the fabric. The appropriate repairs should be made.
- 3) **Mulching and Netting** – Mulching will provide immediate protection to exposed soils during the period of short construction delays, or over winter months through the application of plant residues, or other suitable materials, to exposed soil areas. In areas, which have been seeded either for temporary or permanent cover, mulching should immediately follow seeding. On steep slopes, mulch must be supplemented with netting.

Mulch Maintenance *

- a) Inspect after rainstorms to check for movement of mulch or erosion. If washout, breakage, or erosion occurs, repair surface, reseed, remulch, and install new netting.
- b) Grass mulches that blow or wash away should be repaired promptly.
- c) If plastic netting is used to anchor mulch, care should be taken during initial mowings to keep the mower height high. Otherwise, the netting can wrap up on the mower blade shafts. After a period of time, the netting degrades and becomes less of a problem.
- d) Continue inspections until vegetation is well established.
- 4) **Land Grading** – Grading on fill slopes, cut slopes, and stockpile areas will be done with full siltation controls in place.

Land Grading Design/Installation Requirements

- a) Areas to be graded should be cleared and grubbed of all timber, logs, brush, rubbish, and vegetated matter that will interfere with the grading operation. Topsoil should be stripped and stockpiled for use on critical disturbed areas for establishment of vegetation. Cut slopes to be topsoiled should be thoroughly scarified to a minimum depth of 3-inches prior to placement of topsoil.
- b) Fill materials should be generally free of brush, rubbish, rocks, and stumps. Frozen materials or soft and easily compressible materials should not be used in fills intended to support buildings, parking lots, roads, conduits, or other structures.
- c) Earth fill intended to support structural measures should be compacted to a minimum of 90 percent of Standard Proctor Test density with proper moisture

control, or as otherwise specified by the engineer responsible for the design. Compaction of other fills should be to the density required to control sloughing, erosion or excessive moisture content. Maximum thickness of fill layers prior to compaction should not exceed 9 inches.

- d) The uppermost one foot of fill slopes should be compacted to at least 85 percent of the maximum unit weight (based on the modified AASHTO compaction test). This is usually accomplished by running heavy equipment over the fill.
- e) Fill should consist of material from borrow areas and excess cut will be stockpiled in areas shown on the Site Plans. All disturbed areas should be free draining, left with a neat and finished appearance, and should be protected from erosion.
- f) Infiltration basins shall be excavated, graded and shaped to subgrade elevation and shall then be suitably protected with installation of erosion control measures to prevent sediment-laden runoff from washing into the basins. The basins shall also be protected from heavy equipment activity from this point forward. Prior to application of loam and seed to infiltration basin surfaces, the contractor shall remove any unsuitable soil such as silt or clay that may have been deposited during construction. The surface shall be scarified with a York rake or other small tractor mounted equipment. The loam and seed shall then be applied as required by this document.

Land Grading Stabilization Inspection/Maintenance *

- a) All slopes should be checked periodically to see that vegetation is in good condition. Any rills or damage from erosion and animal burrowing should be repaired immediately to avoid further damage.
 - b) If seeps develop on the slopes, the area should be evaluated to determine if the seep will cause an unstable condition. Subsurface drains or a gravel mulch may be required to solve seep problems. However, no seeps are anticipated.
 - c) Areas requiring revegetation should be repaired immediately. Control undesirable vegetation such as weeds and woody growth to avoid bank stability problems in the future.
- 5) **Topsoiling** * – Topsoiling will help establish vegetation on all disturbed areas throughout the site during the seeding process. The soil texture of the topsoil to be used will be a sandy loam to a silt loam texture with 15% to 20% organic content.

Topsoiling Placement

- a) Topsoil should not be placed while in a frozen or muddy condition, when the subgrade is excessively wet, or when conditions exist that may otherwise be detrimental to proper grading or proposed seeding.
- b) Do not place topsoil on slopes steeper than 2.5:1, as it will tend to erode.

- c) If topsoil and subsoil are not properly bonded, water will not infiltrate the soil profile evenly and it will be difficult to establish vegetation. The best method is to actually work the topsoil into the layer below for a depth of at least 6 inches.
- 6) **Permanent Seeding** – Permanent Seeding should be done immediately after the final design grades are achieved. Native species of plants should be used to establish perennial vegetative cover on disturbed areas. The revegetation should be done early enough in the fall so that a good cover is established before cold weather comes and growth stops until the spring. A good cover is defined as vegetation covering 75 percent or more of the ground surface.

Permanent Seeding Seedbed Preparation

- a) In infertile or coarse-textured subsoil, it is best to stockpile topsoil and re-spread it over the finished slope at a minimum 2 to 6-inch depth and roll it to provide a firm seedbed. The topsoil must have a sandy loam to silt loam texture with 15% to 20% organic content. If construction fill operations have left soil exposed with a loose, rough, or irregular surface, smooth with blade and roll.
- b) Loosen the soil to a depth of 3-5 inches with suitable agricultural or construction equipment.
- c) Areas not to receive topsoil shall be treated to firm the seedbed after incorporation of the lime and fertilizer so that it is depressed no more than ½ - 1 inch when stepped on with a shoe. Areas to receive topsoil shall not be firmed until after topsoiling and lime and fertilizer is applied and incorporated, at which time it shall be treated to firm the seedbed as described above.

Permanent Seeding Grass Selection/Application

- a) Select an appropriate cool or warm season grass based on site conditions and seeding date. Apply the seed uniformly by hydro-seeding, broadcasting, or by hand. Uniform seed distribution is essential. On steep slopes, hydroseeding may be the most effective seeding method. Surface roughening is particularly important when preparing slopes for hydroseeding.
- b) Lime and fertilize. Organic fertilizer shall be utilized in areas within the 100 foot buffer zone to a wetland resource area.
- c) Mulch the seedlings. Anchor the mulch with erosion control netting or fabric on sloping areas. Amoco supergro or equivalent should be utilized.

Permanent Seeding Inspection/Maintenance *

- a) Frequently inspect seeded areas for failure and make necessary repairs and reseed immediately. Conduct or follow-up survey after one year and replace failed plants where necessary.
- b) If vegetative cover is inadequate to prevent rill erosion, overseed and fertilize in accordance with soil test results.

- c) If a stand has less than 40% cover, reevaluate choice of plant materials and quantities of lime and fertilizer. Re-establish the stand following seedbed preparation and seeding recommendations, omitting lime and fertilizer in the absence of soil test results. If the season prevents resowing, mulch or jute netting is an effective temporary cover.
- d) Seeded areas should be fertilized during the second growing season. Lime and fertilize thereafter at periodic intervals, as needed.

Fueling and Maintenance of Equipment and Vehicles:

- 1. Refueling/maintenance Rules – The site supervisor shall produce a written document received by all subcontractors and employees that delineates their responsibilities on site. This document shall include language that shall permit the maintenance of vehicles only in designated locations on the job site. In the event of mechanical failure of a vehicle, the vehicle shall be moved to the designated maintenance area on the site to perform maintenance. The site supervisor shall document receipt of these instructions by obtaining the signatures of subcontractors and individuals that may enter the site and the date in which they were notified of their responsibilities. Refueling for vehicles or equipment shall occur either within the designated washout area or shall utilize temporary drip protection measures at the location of fueling. The site supervisor or their representative shall be present at the time of any fueling procedure. The site supervisor shall have a fuel spill plan and measures on site to initiate containment and clean-up in the event a fuel spill occurs.
- 2. Installation Schedule: Prior to start of Work
- 3. Maintenance and Inspection: The site supervisor shall maintain a log of individuals receiving these instructions.
- 4. Specific Pollution Prevention Practices

Pollution Prevention Practice # 1

- a. Description: Fueling operations shall take place in designated area(s) as shown on site maps. Provide temporary drip protection during fueling operations which take place outside of designated area(s). Materials necessary to address a spill shall be made readily available in a location known to the site supervisor or his/her designee.
- b. Installation: Fueling operation procedures shall be in effect throughout the project duration.
- c. Maintenance Requirements: All emergency response equipment listed in the Emergency Response Equipment Inventory shall be made readily available and kept in a designated location known to the site supervisor or his/her designee. All such materials shall be replenished as necessary to the listed amounts.

Dust Control:

Dust control will be utilized throughout the entire construction process of the site. For example, keeping disturbed surfaces moist during windy periods will be an effective control measure, especially for construction access roads. The use of dust control will prevent the movement of soil to offsite areas. However, care must be taken to not create runoff from excessive use of water to control dust. The following are methods of Dust Control that may be used on-site:

- Vegetative Cover – The most practical method for disturbed areas not subject to traffic.
- Calcium Chloride – Calcium chloride may be applied by mechanical spreader as loose, dry granules or flakes at a rate that keeps the surface moist but not so high as to cause water pollution or plant damage.
- Sprinkling – The site may be sprinkled until the surface is wet. Sprinkling will be effective for dust control on haul roads and other traffic routes.
- Stone – Stone will be used to stabilize construction roads; will also be effective for dust control.

The general contractor shall employ an on-site water vehicle for the control of dust as necessary.

Non-Stormwater Discharges:

The construction de-watering and all non-stormwater discharges will be directed into a sediment dirt bag (or equivalent inlet protection) or a sediment basin. Sediment material removed shall be disposed of in accordance with all applicable local, state, and federal regulations.

The developer and site general contractor will comply with the E.P.A.'s Final General Permit for Construction De-watering Discharges, (N.P.D.E.S., Section 402 and 40 C.F.R. 122.26(b)(14)(x).

Soil Stockpiling:

Topsoil and subsoil from the driveway grading will be stockpiled in locations shown on the plans.

Stockpile Material Construction Procedure

- 1) Topsoil and subsoil that are stripped will be stockpiled for later distribution on disturbed areas.
- 2) The stockpiles will be located as shown on the plans. These locations will allow them to not interfere with work on the site.
- 3) Seed the stockpiles with a temporary erosion control mix if the stockpile is to remain undisturbed for more than 30 days. The stockpiles must be stable and the side slopes should not exceed 2:1.
- 4) Sediment Fence/Hay Bale Barrier erosion control measures should be placed surrounding each stockpile.
- 5) As needed, the stockpiled topsoil and subsoil are redistributed throughout the site.

Anticipated Construction Schedule:

To prevent excessive erosion and silting, the following construction sequence coupled with other widely accepted principals for reducing erosion and sedimentation shall be implemented in the development of the site.

1. Obtain all plan approvals and other applicable permits.
2. Flag the work limits and mark trees and buffer areas for protection.
3. Hold a pre-construction meeting prior to any construction activity.
4. Install stabilization practices for erosion and sediment control prior to commencing construction activities. Refer to "Erosion and Sedimentation Control Plan" and place siltation fence and haybale barriers at locations indicated on the site plans.
5. Clear and grub up as required for the construction of the driveway and related infrastructure.
6. Construct stabilized construction entrance.
7. Excavate topsoil and subsoil from cut and fill areas and stockpile on site in locations shown on the plan. consideration should be given to locating stockpiles on the uphill side of disturbed areas, where possible, to act as temporary diversions.
8. Construct cut and fill areas, installing haybale check dams at toes of all 3:1 or greater slopes, and at ends of all cut areas. All fill will be installed using 12" maximum compaction lifts. Place all slope protection where indicated on the plan. the stormwater extended detention basin shall be constructed immediately after the driveway rough grading is completed and the area has been cleared of vegetation.
9. Install closed drainage system and other utilities. All catch basins shall be covered with siltsack or equivalent inlet protection.
10. Grade driveway to subgrade elevation and construct side slopes. Apply temporary stabilization measures where warranted. Refer to "Erosion and Sedimentation Control Plan".
11. Place gravel subbase.
12. Place the bituminous concrete binder course on driveway and parking lot.
13. Grade slopes and stabilize cut areas at toe of slopes. blend all slopes into existing topography and loam and seed all disturbed areas. slopes greater than 3:1 shall be stabilized with jute mesh.
14. Place the final wearing course of pavement.
15. Complete fine grading of shoulders and place pavement in miscellaneous areas.
16. Remove temporary erosion control devices once adequate growth is established. adequate growth is defined as vegetation covering 75% or more of the ground surface.

Inspection/Maintenance:

Operator personnel must inspect the construction site at least once every 14 calendar days and within 24 hours of a storm event of ½-inch or greater. The applicant shall be responsible to secure the services of a design professional or similar professional (inspector) on an on-going basis throughout all phases of the project. Refer to the Inspection/Maintenance Requirements presented earlier in the “Structural and Stabilization Practices.” The inspector should review the erosion and sediment controls with respect to the following:

- Whether or not the measure was installed/performed correctly.
- Whether or not there has been damage to the measure since it was installed or performed.
- What should be done to correct any problems with the measure.

The inspector should complete the Stormwater Management Construction Phase BMP Inspection Schedule and Evaluation Checklist, as attached, for documenting the findings and should request the required maintenance or repair for the pollution prevention measures when the inspector finds that it is necessary for the measure to be effective. The inspector should notify the appropriate person to make the changes and submit copies of the form to the Weymouth Highway Department.

Project Location: 550-560 Washington Street, Map 29, Block 330, Lot 3, Weymouth, MA
Stormwater Management – Construction Phase
Best Management Practices – Inspection Schedule and Evaluation Checklist

Date:

Construction Practices

Best Management Practice	Inspection Frequency	Date Inspected	Inspector	Minimum Maintenance and Key Items to Check	Cleaning/Repair Needed: (List Items)	Date of Cleaning/Repair	Performed by
Silt Sock and Sediment Fence Controls	After heavy rainfall events (minimum weekly)			1. Sediment Fence Design/Installation Requirements 2. Sediment Fence Inspection/Maintenance	<input type="checkbox"/> yes <input type="checkbox"/> no		
Stabilized Construction Entrance	After heavy rainfall events (minimum weekly)			1. Construction Entrance Design/Construction Requirements 2. Construction Entrance Inspection/Maintenance	<input type="checkbox"/> yes <input type="checkbox"/> no		
Temporary Sedimentation Basins	After heavy rainfall events (minimum weekly)			1. Sediment Basin Inspection/Maintenance	<input type="checkbox"/> yes <input type="checkbox"/> no		
Temporary Seeding	After heavy rainfall events (minimum weekly)			1. Temporary Seeding Planting Procedures 2. Temporary Seeding Inspection/Maintenance	<input type="checkbox"/> yes <input type="checkbox"/> no		
Geotextiles	After heavy rainfall events (minimum weekly)			1. Geotextile Inspection/Maintenance	<input type="checkbox"/> yes <input type="checkbox"/> no		
Mulching & Netting	After heavy rainfall events (minimum weekly)			1. Mulch Maintenance	<input type="checkbox"/> yes <input type="checkbox"/> no		
Land Grading	After heavy rainfall events (minimum weekly)			1. Land Grading Stabilization Inspection/Maintenance	<input type="checkbox"/> yes <input type="checkbox"/> no		

Permanent Seeding	After heavy rainfall events (minimum weekly)			1. Permanent Seeding Inspection/ Maintenance	<input type="checkbox"/> yes <input type="checkbox"/> no		
Dust Control	After heavy rainfall events (minimum weekly)				<input type="checkbox"/> yes <input type="checkbox"/> no		
Soil Stockpiling	After heavy rainfall events (minimum weekly)				<input type="checkbox"/> yes <input type="checkbox"/> no		

(1) Refer to the Massachusetts Stormwater Handbook issued January 2, 2008.

Notes (Include deviations from : Definitive Subdivision Decision and Special Conditions and Approved Plan):

Stormwater Control Manager _____

HAZARDOUS WASTE / OIL SPILL REPORT

Date ___ / ___ / ___

Time _____ AM / PM

Exact location (Transformer #) _____

Type of equipment _____ Make _____ Size _____

S / N _____ Weather Conditions _____

On or near water Yes If yes, name of body of water _____
 No

Type of chemical / oil spilled _____

Amount of chemical / oil spilled _____

Cause of spill _____

Measures taken to contain or clean up spill _____

Amount of chemical / oil recovered _____ Method _____

Material collected as a result of clean up

_____ drums containing _____

_____ drums containing _____

_____ drums containing _____

Location and method of debris disposal _____

Name and address of any person, firm, or corporation suffering damages _____

Procedures, method, and precautions instituted to prevent a similar occurrence from recurring _____

Spill reported to General Office by _____ Time _____ AM / PM

Spill reported to DEP / National Response Center by _____

DEP Date ___ / ___ / ___ Time _____ AM / PM Inspector _____

NRC Date ___ / ___ / ___ Time _____ AM / PM Inspector _____

Additional comments _____

EMERGENCY RESPONSE EQUIPMENT INVENTORY

The following equipment and materials shall be maintained at all times and stored in a secure area for long-term emergency response need.

--	SORBENT PADS	1 BALE
--	SAND BAGS (empty)	5
--	SPEEDI-DRI ABSORBENT	2 – 40LB BAGS
--	12" INFLATABLE PIPE PLUG	1
--	SQUARE END SHOVELS	1
--	PRY BAR	1
--	CATCH BASIN COVER	1

EMERGENCY NOTIFICATION PHONE NUMBERS

1. FACILITY MANAGER
NAME: _____ BEEPER: _____
PHONE: _____ CELL PHONE: _____

ALTERNATE:
NAME: Raymond Jennings BEEPER: N/A
PHONE: 781-389-2426 CEL PHONE: N/A

2. FIRE DEPARTMENT
EMERGENCY: 911
BUSINESS: (781) 337-5151

POLICE DEPARTMENT
EMERGENCY: 911
BUSINESS: (781) 335-1212

DEPARTMENT OF PUBLIC WORKS
CONTACT:
BUSINESS: (781) 337-5100
ALTERNATE:

CONSERVATION COMMISSION
CONTACT: Andrew Hultin, Agent
BUSINESS: (781) 340-5007

BOARD OF HEALTH
CONTACT:
BUSINESS: (781) 335-2000

3. MASSACHUSETTS DEPARTMENT OF ENVIRONMENTAL PROTECTION
EMERGENCY: (617) 556-1133
SOUTHEAST REGION - LAKEVILLE OFFICE: (508) 946-2700

4. NATIONAL RESPONSE CENTER
PHONE: (800) 424-8802

ALTERNATE: U.S. ENVIRONMENTAL PROTECTION AGENCY
EMERGENCY: (617) 223-7265
BUSINESS: (617) 860-4300

**POST-DEVELOPMENT BEST MANAGEMENT
PRACTICE
OPERATION AND MAINTENANCE PLAN &
LONG-TERM POLLUTION PREVENTION PLAN**

for

550-560 Washington Street

In

**Weymouth, Massachusetts
(Assessor's Map 29, Block 330, Lot 3)**

Submitted to:

TOWN OF WEYMOUTH

Prepared for:

**Union Realty Trust
560 Washington Street
Weymouth, Massachusetts 02188**

Prepared by:



**Professional Civil Engineering • Project Management • Land Planning
150 Longwater Drive, Suite 101, Norwell, Massachusetts 02061
Tel.: (781) 792-3900 Facsimile: (781) 792-0333
www.mckeng.com**

March 6, 2023

TABLE OF CONTENTS

	Page
Long Term Best Management Practices (BMP's)	
- Responsible Party Contact Information	1
- Long-Term Operation and Maintenance	1
- BMP Operation and Maintenance	2
- Maintenance Responsibilities	4
- Long-Term Pollution Prevention Plan	4
- Inspection Schedule and Evaluation Checklist	7
- Spill Containment and Management Plan	8
- First Defense Unit Operation & Maintenance Manual	12
- ACF R-Tank Maintenance Manual	24

**Post-Development Best Management Practice
Operation and Maintenance Plan &
Long-Term Pollution Prevention Plan**

**Post-Development Best Management Practices (BMPs)
Operation and Maintenance Plan**

Responsible Party/Property Owner/Developer contact information:

Property Owner: Union Realty Trust
Raymond Jennings
560 Washington Street
Weymouth, MA 02188
Phone: (781) 389-2426

Developer Contact Information:

Union Realty Trust
Raymond Jennings
560 Washington Street
Weymouth, MA 02188
Phone: (781) 389-2426

Best Management Practices (BMPs) of the Commonwealth of Massachusetts Department of Environmental Protection's (DEP's) Stormwater Management Policy (SMP) have been implemented and utilized for the project. The following information provided is to be used as a guideline for monitoring and maintaining the performance of the drainage facilities and to ensure that the quality of water runoff meets the standards set forth by the SMP. The structural Best Management Practices (BMPs) shall be inspected during rainfall conditions during the first year of operation to verify functionality.

BMPs included in the design consist of the use of:

- Paved areas maintenance
- Deep sump catch basins with hooded outlets
- Proprietary pretreatments units
- Subsurface infiltration tank systems
- Trench drains
- Outlet protection
- Restrictions on the use of pesticides and herbicides within the 100-foot buffer zone
- Snow removal

Operation:

Once the stormwater management systems have been constructed and the driveway and parking lot has been permanently stabilized and put into action, the operation of the stormwater management system will function as intended. Stormwater runoff is directed into the catch basins and closed drainage system to the First Defense units, and lastly to the subsurface infiltration systems. The subsurface stormwater management systems have been designed to attenuate peak flows for the 1-year through 100-year storm events.

Maintenance:

- 1. Paved Areas** –Sweepers shall sweep paved areas periodically during dry weather to remove excess sediments and to reduce the amount of sediments that the drainage system shall have to remove from the runoff. The sweeping shall be conducted primarily between March 15th and November 15th. Special attention should be made to sweeping paved surfaces in March and April before spring rains wash residual sand into the drainage system.

The frequency of sweeping shall average:

- Monthly if by a high-efficiency vacuum sweeper
- Bi-weekly if by a regenerative air sweeper
- Weekly if by a mechanical sweeper

Salt used for de-icing on the parking lot during winter months shall be limited as much as possible as this will reduce the need for removal and treatment. Sand containing the minimum amount of calcium chloride (or approved equivalent) needed for handling may be applied as part of the routine winter maintenance activities.

Cost: The property owner should consult local sweeping contractors for detailed cost estimates.

- 2. Catch Basins** - Catch basin grates shall be checked quarterly and following heavy rainfalls to verify that the inlet openings are not clogged by debris. Debris shall be removed from the grates and disposed of properly. Deep sump catch basins shall be inspected and cleaned bi-annually of all accumulated sediments. Catch basins with hoods shall be inspected annually to check oil build-up and outlet obstructions. Material shall be removed from catch basins and disposed of in accordance with all applicable regulations.

Cost: Estimated \$50 - \$100 per cleaning as needed. The property owner should consult local vacuum cleaning contractors for detailed cost estimates.

- 3. Proprietary Pretreatment Units** – The proprietary pretreatment units shall be inspected and maintained from the surface, without entry into the unit a minimum of annually and following heavy rain events. Perform maintenance once the stored volume reaches 15% of the unit capacity, or immediately in the event of a spill. Perform Maintenance at quarterly intervals during the first year of installation, so an accurate maintenance schedule can be established. Sediment and debris should be removed through the 12-inch diameter outlet pipe. Alternatively, oil and floatables should be removed through the 12-inch oil inspection port. The requirements for the disposal from the units should be in compliance with all local, state and federal regulations. Please refer to the Manufacturer’s Manual for additional detail on proper inspection and maintenance of the First Defense units.

Cost: Cleaning should be included along with the routine maintenance of the catch basins. The property owner should consult local vacuum cleaning contractors for detailed cost estimates.

4. Subsurface Infiltration Tank System –Proper maintenance of the subsurface infiltration system is essential to the long-term effectiveness of the infiltration function. The subsurface infiltration system shall have inspection ports and additional inspections should be scheduled during the first few months to ensure proper stabilization and function. Thereafter, they shall be checked semiannually and following heavy rainfalls, defined as a 1-year storm event exceeding 2.5 inches of rainfall within a twenty-four-hour period. Water levels in the chambers shall be checked to verify proper drainage. Ponding water in a chamber indicates failure from the bottom. If water remains within the chambers after 48-hours following a storm event, steps to restore the infiltration function shall be taken, as directed by a qualified stormwater management professional. In order to rectify the problem, accumulated sediment must be removed from the bottom of the chamber. The stone aggregate and filter fabric must be removed and replaced and the underlying soil layer must be scarified to encourage proper infiltration. Material removed from the system shall be disposed of in accordance with all applicable local, state, and federal regulations. Please refer to the Manufacturer’s Manual for additional detail on proper inspection and maintenance of the ACF R-Tanks.

Cost: The property owner should consult local landscape contractors for a detailed cost estimate.

5. Outlet Protection - All outfall protection structures shall be inspected quarterly and following major storm events defined as a storm event exceeding one inch of rainfall within a twenty-four-hour period to check for signs for erosion. Any necessary repairs shall be performed promptly and cleaned to remove accumulated sediment as necessary. Material removed shall be disposed of in accordance with all applicable local, state, and federal regulations. Rip-Rap overflow structure shall be weeded and cleaned on a quarterly basis to ensure that water overflowing the spillway will not become obstructed by debris.

6. Pesticides, Herbicides, and Fertilizers - Pesticides and herbicides shall be used sparingly. Fertilizers should be restricted to the use of organic fertilizers only.

All structural BMP’s as identified on the site plans will be owned and maintained by the property owner of the development and shall run with the title of the property.

Cost: Included in the routine landscaping maintenance schedule. The Owner should consult local landscaping contractors for details.

7. Snow Removal - Snow accumulations removed from driveway and parking areas should be placed in upland areas only, where sand and other debris will remain after snowmelt for later removal. Excess snow should be removed from the site and properly disposed of in an approved snow disposal facility. Care must be exercised not to deposit snow in the following areas: in the rain gardens, bioswales, and where sand and debris can get into the watercourse.

Cost: The owner should consult local snow removal contractors for a detailed cost estimate.

Maintenance Responsibilities:

All post construction maintenance activities will be documented and kept on file in the form of an Evaluation Checklist, see attached form.

All structural BMPs as identified on the site plans will be owned and maintained by the developer or property owner. All post construction maintenance activities shall run with the title of the property.

Long-Term Pollution Prevention Plan

Good Housekeeping:

To develop and implement an operation and maintenance program with the goal of preventing or reducing pollutant runoff by keeping potential pollutants from coming into contact with stormwater or being transported off site without treatment, the following efforts will be made:

- Property Management awareness and training on how to incorporate pollution prevention techniques into maintenance operations.
- Follow appropriate best management practices (BMPs) by proper maintenance and inspection procedures.

Storage and Disposal of Household Waste and Toxics:

This management measure involves educating the general public on the management considerations for hazardous materials. Failure to properly store hazardous materials dramatically increases the probability that they will end up in local waterways. Many people have hazardous chemicals stored throughout their homes, especially in garages and storage sheds. Practices such as covering hazardous materials or even storing them properly, can have dramatic impacts. Property owners are encouraged to support the household hazardous product collection events sponsored by the Town of Weymouth.

MADEP has prepared several materials for homeowners on how to properly use and dispose of household hazardous materials:

<http://www.mass.gov/dep/recycle/reduce/househol.htm>

For consumer questions on household hazardous waste call the following number:

DEP Household Hazardous Waste Hotline 800-343-3420

The following is a list of management considerations for hazardous materials as outlined by the EPA:

- Ensuring sufficient aisle space to provide access for inspections and to improve the ease of material transport;
- Storing materials well away from high-traffic areas to reduce the likelihood of accidents that might cause spills or damage to drums, bags, or containers.
- Stacking containers in accordance with the manufacturers' directions to avoid damaging the container or the product itself;
- Storing containers on pallets or equivalent structures. This facilitates inspection for leaks and prevents the containers from coming into contact with wet floors, which can cause corrosion. This consideration also reduces the incidence of damage by pests.

The following is a list of commonly used hazardous materials used in the household:

Batteries – automotive and rechargeable
.....nickel cadmium batteries
.....(no alkaline batteries)
Gasoline
Oil-based paints
Fluorescent light bulbs and lamps
Pool chemicals
Propane tanks
Lawn chemicals,
fertilizers and weed killers
Turpentine
Bug sprays
Antifreeze
Paint thinners, strippers, varnishes and
..... stains
Arts and crafts chemicals
Charcoal lighter fluid

Disinfectant
Drain clog dissolvers
Driveway sealer
Flea dips, sprays and collars
Houseplant insecticides
Metal polishes
Mothballs
Motor oil and filters
Muriatic acid (concrete cleaner)
Nail polishes and nail polish
removers
Oven cleaner
Household pest and rat poisons
Rug and upholstery cleaners
Shoe polish
Windshield wiper fluid

Vehicle Washing:

This management measure involves educating the general public on the water quality impacts of the outdoor washing of automobiles and how to avoid allowing polluted runoff to enter the storm drain system. Outdoor car washing has the potential to result in high loads of nutrients, metals, and hydrocarbons during dry weather conditions in many watersheds, as the detergent-rich water used to wash the grime off our cars flows down the street and into the storm drain. The following management practices will be encouraged:

- Washing cars on gravel, grass, or other permeable surfaces.
- Blocking off the storm drain during car washing and redirecting wash water onto grass or landscaping to provide filtration.
- Using hoses with nozzles that automatically turn off when left unattended.
- Using only biodegradable soaps.
- Minimize the amounts of soap and water used. Wash cars less frequently.
- Promote use of commercial car wash services.

Landscape Maintenance:

This management measure seeks to control the storm water impacts of landscaping and lawn care practices through education and outreach on methods that reduce nutrient loadings and the amount of storm water runoff generated from lawns. Nutrient loads generated by fertilizer use on suburban lawns can be significant, and recent research has shown that lawns produce more surface runoff than previously thought.

Using proper landscaping techniques can effectively increase the value of a property while benefiting the environment. These practices can benefit the environment by reducing water use; decreasing energy use (because less water pumping and treatment is required); minimizing runoff of storm and irrigation water that transports soils,

fertilizers, and pesticides; and creating additional habitat for plants and wildlife. The following lawn and landscaping management practices will be encouraged:

- Mow lawns at the highest recommended height.
- Minimize lawn size and maintain existing native vegetation.
- Collect rainwater for landscaping/gardening needs (rain barrels and cisterns to capture roof runoff).
- Raise public awareness for promoting the water efficient maintenance practices by informing users of water efficient irrigation techniques and other innovative approaches to water conservation.
- Abide by water restrictions and other conservation measures implemented by the Town of Weymouth.
- Water only when necessary.
- Use automatic irrigation systems to reduce water use.

Integrated Pest Management (IPM):

This management measure seeks to limit the adverse impacts of insecticides and herbicides by providing information on alternative pest control techniques other than chemicals or explaining how to determine the correct dosages needed to manage pests.

The presence of pesticides in stormwater runoff has a direct impact on the health of aquatic organisms and can present a threat to humans through contamination of drinking water supplies. The pesticides of greatest concern are insecticides, such as diazinon and chlorpyrifos, which even at very low levels can be harmful to aquatic life. The major source of pesticides to urban streams is home application of products designed to kill insects and weeds in the lawn and garden. The following IPM practices will be encouraged:

- Lawn care and landscaping management programs including appropriate pesticide use management as part of program.
- Raise public awareness by referring homeowners to “A Homeowner’s Guide to Environmentally Sound Lawncare, Maintaining a Healthy Lawn the IPM Way”, Massachusetts Department of Food and Agriculture, Pesticide Bureau or link <http://www.mass.gov/dep/water/resources/nonpoint.htm#megaman>>

Pet Waste Management:

Pet waste management involves using a combination of pet waste collection programs, pet awareness and education, to alert residents to the proper disposal techniques for pet droppings. The following management practices will be encouraged:

- Raise awareness of homeowners that are also pet owners that they are encouraged to pick up after their pets and dispose of the waste either in the trash, including on their own lawns and walking trails.
- Provide signage along walking trails.

Proper Management of Deicing Chemicals and Snow:

Roadways shall be maintained by the Developer/Property Owners. The following deicing chemicals and snow storage practices will be encouraged:

- Select effective snow disposal sites adjacent to or on pervious surfaces in upland areas away from water resources and wells. At these locations, the snow meltwater can filter in to the soil, leaving behind sand and debris, which can be removed in the springtime.
- No roadway deicing materials shall be stockpiled on site unless all storage areas are protected from exposure to rain, snow, snowmelt and runoff.
- Avoid dumping snow into any waterbody, including wetlands, cranberry bogs, detention/infiltration basins, and grassed swales/channels.
- Avoid disposing of snow on top of storm drain catch basins.

Project Location: 550-560 Washington Street, Assessor's Map 29, Block 330, Lot 3, Weymouth, MA

Stormwater Management – Post Construction Phase

Best Management Practices – Inspection Schedule and Evaluation Checklist

Long Term Practices

Best Management Practice	Inspection Frequency (1)	Date Inspected	Inspector	Minimum Maintenance and Key Items to Check (1)	Cleaning/Repair Needed: <input type="checkbox"/> yes <input type="checkbox"/> no (List Items)	Date of Cleaning/Repair	Performed by
Street Sweeping Maintenance	4-times annually - specifically in Spring and Fall			1. Sediment build-up 2. Trash and debris 3. Minor Spills (vehicular)			
Deep Sump and Hooded Catch basin	After heavy rainfall events (minimum quarterly)			1. Sediment level exceeds 8" 2. Trash and debris 3. Floatable oils or hydrocarbons 4. Grate or outlet blockages			
Proprietary Pretreatment Units	After heavy rainfall events (minimum annually)			1. Sediment level exceeds Manufacturer's specification 2. Trash and debris 3. Floatable oils or hydrocarbons 4. Outlet blockages			
Subsurface Infiltration Tanks	After heavy rainfall events (minimum semi-annually)			1. Sediment build-up 2. Standing Water greater than 48 hours			
Outlet Protection	Quarterly			1. Sediment build-up 2. Trash and debris 3. Displacement of rip rap 4. Excess vegetation			

(1) Refer to the Massachusetts Stormwater Management, Volume Two: Stormwater Technical Handbook (February 2008) for recommendations regarding frequency for inspection and maintenance of specific BMP's.

Notes (Include deviations from: Con Com Order of Conditions, PB Approval, Construction Sequence and Approved Plan):

1.

Stormwater Control Manager _____

Stamp:

HAZARDOUS WASTE / OIL SPILL REPORT

Date ___ / ___ / ___

Time _____ AM / PM

Exact location (Transformer #) _____

Type of equipment _____ Make _____ Size _____

S / N _____ Weather Conditions _____

On or near water Yes If yes, name of body of water _____
 No

Type of chemical / oil spilled _____

Amount of chemical / oil spilled _____

Cause of spill _____

Measures taken to contain or clean up spill _____

Amount of chemical / oil recovered _____ Method _____

Material collected as a result of clean up

_____ drums containing _____

_____ drums containing _____

_____ drums containing _____

Location and method of debris disposal _____

Name and address of any person, firm, or corporation suffering damages _____

Procedures, method, and precautions instituted to prevent a similar occurrence from recurring _____

Spill reported to General Office by _____ Time _____ AM / PM

Spill reported to DEP / National Response Center by _____

DEP Date ___ / ___ / ___ Time _____ AM / PM Inspector _____

NRC Date ___ / ___ / ___ Time _____ AM / PM Inspector _____

Additional comments _____

EMERGENCY RESPONSE EQUIPMENT INVENTORY

The following equipment and materials shall be maintained at all times and stored in a secure area for long-term emergency response need.

--	SORBENT PADS	1 BALE
--	SAND BAGS (empty)	5
--	SPEEDI-DRI ABSORBENT	2 – 40LB BAGS
--	12" INFLATABLE PIPE PLUG	1
--	SQUARE END SHOVELS	1
--	PRY BAR	1
--	CATCH BASIN COVER	1

EMERGENCY NOTIFICATION PHONE NUMBERS

1. FACILITY MANAGER
NAME: _____ BEEPER: _____
PHONE: _____ CELL PHONE: _____

ALTERNATE:
NAME: Raymond Jennings BEEPER: N/A
PHONE: 781-389-2426 CEL PHONE: N/A

2. FIRE DEPARTMENT
EMERGENCY: 911
BUSINESS: (781) 337-5151

POLICE DEPARTMENT
EMERGENCY: 911
BUSINESS: (781) 335-1212

DEPARTMENT OF PUBLIC WORKS
CONTACT:
BUSINESS: (781) 337-5100
ALTERNATE:

CONSERVATION COMMISSION
CONTACT: Andrew Hultin, Agent
BUSINESS: (781) 340-5007

BOARD OF HEALTH
CONTACT:
BUSINESS: (781) 335-2000

3. MASSACHUSETTS DEPARTMENT OF ENVIRONMENTAL PROTECTION
EMERGENCY: (617) 556-1133
SOUTHEAST REGION - LAKEVILLE OFFICE: (508) 946-2700

4. NATIONAL RESPONSE CENTER
PHONE: (800) 424-8802

ALTERNATE: U.S. ENVIRONMENTAL PROTECTION AGENCY
EMERGENCY: (617) 223-7265
BUSINESS: (617) 860-4300